

# AGRICULTURAL WASTE MANAGEMENT SYSTEM

NATIONAL RESOURCES CONSERVATION SERVICE  
U. S. DEPARTMENT OF AGRICULTURE

CASSILYN SCHWEIGHOFER

WAYNE COUNTY, PENNSYLVANIA

ADDRESS: 678 COCHECTON TURNPIKE  
TYLER HILL, PA 18469

NRCS TAKES SAFETY VERY SERIOUSLY, HOWEVER, THE SAFETY COMMITMENT AND THE JOB SITE PRACTICES OF THE CONTRACTOR ARE BEYOND CONTROL OF NRCS. IT IS STRONGLY RECOMMENDED THAT SAFE WORKING CONDITIONS AND ACCIDENT PREVENTION PRACTICES BE THE TOP PRIORITY OF ANY JOB SITE. LOCAL, STATE, AND FEDERAL SAFETY AND HEALTH STANDARDS SHOULD ALWAYS BE FOLLOWED TO HELP INSURE WORKER SAFETY. MAKE CERTAIN ALL EMPLOYEES KNOW THE SAFEST AND MOST PRODUCTIVE WAY OF CONSTRUCTING THE DESIGNED PRACTICES. EMERGENCY PROCEDURES SHOULD BE KNOWN BY ALL EMPLOYEES. DAILY MEETINGS HIGHLIGHTING SAFETY PROCEDURES ARE ALSO RECOMMENDED. IT IS THE CONTRACTOR'S RESPONSIBILITY TO ENSURE A SAFE WORK ENVIRONMENT FOR THEIR EMPLOYEES.

## CONSTRUCTION NOTES

1. CLEAR AND GRUB THE ENTIRE AREA WITHIN THE WORK LIMITS.
2. ALL FILL MATERIAL MUST NOT CONTAIN FROZEN MATERIAL, SOD, ROOTS, OR OTHER PERISHABLE MATERIAL, OR ROCK LARGER THAN EIGHT INCHES IN DIAMETER.
3. SIX INCHES TOPSOIL WILL BE INCORPORATED INTO THE EARTHFILL TO MEET THE NEAT LINES SHOWN ON THE TYPICAL SECTION.
4. ALL AREAS TOP-DRESSED WITH TOPSOIL AND DISTURBED DURING CONSTRUCTION WILL BE SEEDED ACCORDING TO NRCS CRITICAL AREA PLANTING SPECIFICATION.

## AS-BUILT/ DESIGN INFORMATION

QUALITY ASSURANCE STATEMENT			ENGINEER STATEMENT		
To the best of my knowledge, I certify that the practices have been installed as per the attached drawings and specifications, based on the information provided to me and/or observations I have made.			In my professional opinion, I certify that the practices have been installed as per the attached drawings and specifications, based on the information provided to me and/or observations I have made.		

Practice Code	CIN	Description	Planned Amount	Inspector (Initials)	As-Built Amount (by Inspector)	Certification (Engineer/JAA Signature)	Date Certified
313							
342							
367							
468							
484							
500							
516							
558							
560							
561							
606							
614							
620							

## GENERAL NOTES

1. FAILURE TO CONSTRUCT THIS FACILITY IN ACCORDANCE WITH THE NRCS DESIGN OR AUTHORIZED MODIFICATIONS WILL RESULT IN WITHDRAWAL OF NRCS TECHNICAL AND FINANCIAL ASSISTANCE.
2. ALL FEDERAL, STATE, AND LOCAL LAWS, RULES, AND REGULATIONS GOVERNING THE CONSTRUCTION OF THIS FACILITY SHALL BE STRICTLY FOLLOWED. THE OWNER OR OPERATOR IS RESPONSIBLE FOR OBTAINING ALL CONSTRUCTION PERMITS.
3. IT IS THE RESPONSIBILITY OF THE EXCAVATING CONTRACTOR TO COMPLY WITH PA ACT 187 (1996) AND ALL ITS REVISIONS BEFORE PERFORMING ANY EXCAVATION. THE PA ONE-CALL PHONE NUMBER IS 1-(800)-242-1776. THE SERIAL NUMBER FOR DESIGN IS: 20213422657 DATED: 12/8/2021.
4. A MEETING BETWEEN THE LANDOWNER, CONTRACTOR, AND NRCS REPRESENTATIVE SHALL BE REQUIRED PRIOR TO ANY EXCAVATION OR CONSTRUCTION WORK.
5. A COPY OF THE NRCS SPECIFICATIONS AND DRAWINGS SHALL BE ONSITE DURING ALL PHASES OF CONSTRUCTION. A COPY OF THE DRAWINGS SHALL BE PROVIDED TO THE TRUSS MANUFACTURE.
6. OSHA REGULATIONS SHALL BE FOLLOWED AT ALL TIMES.
7. THE CONTRACTOR IS RESPONSIBLE FOR IMPLEMENTING ALL MEASURES NECESSARY TO PROTECT WORK IN PROGRESS FROM ENVIRONMENTAL CONDITIONS SUCH AS TEMPERATURE EXTREMES, SURFACE, AND GROUND WATER.
8. THE CONTRACTOR IS RESPONSIBLE FOR VERIFYING ACTUAL FIELD MEASUREMENTS SHOWN ON THE PLANS.
9. IN THE EVENT ROCK, UNSTABLE SOILS, OR SEEPS ARE ENCOUNTERED DURING EXCAVATION, WORK SHALL BE STOPPED AND THE NRCS SHALL DETERMINE HOW TO PROCEED.
10. THE CONTRACTOR IS RESPONSIBLE FOR THE SECURITY OF THE JOB SITE UNTIL THE WORK HAS BEEN CERTIFIED BY THE NRCS.

11. CERTIFICATION OF CONFORMANCE SHALL CERTIFY THAT ALL WORK WAS PERFORMED TO THE NRCS SPECIFICATIONS.

12. THE OWNER IS RESPONSIBLE FOR ENSURING THAT ALL LIVESTOCK ARE REMOVED FROM THE WORK SITE AND THAT LIVESTOCK WILL REMAIN EXCLUDED FROM THE WORK SITE UNTIL THE PROJECT HAS BEEN THROUGH A FINAL CERTIFICATION AND APPROVED FOR USE. TEMPORARY LIVESTOCK CONFINEMENT/EXCLUSION FENCE MAY BE NEEDED TO ENSURE LIVESTOCK ARE NOT ABLE TO ENTER THE WORK SITE.

## INDEX OF DRAWINGS

1. COVER SHEET
2. E&S DETAILS
3. CONSTRUCTION NOTES GENERAL NOTES
4. CONSTRUCTION NOTES CONCRETE NOTES
5. ROOF DESIGN NOTES
6. 30 SCALE PLAN VIEW
7. 30 SCALE PROFILE LOCATIONS PLAN VIEW
8. PROFILE A-A
9. PROFILE B-B
10. PROFILE C-C
11. PROFILE D-D
12. PROFILE E-E
13. PROFILE F-F
14. NORTHERN ROOF RUNOFF UNDERGROUND OUTLET PROFILE
15. SOUTHERN ROOF RUNOFF UNDERGROUND OUTLET PROFILE
16. CONCRETE LAYOUT
17. CONCRETE CONTROL JOINT LAYOUT
18. POST LAYOUT
19. TRUSS AND GIRDER LAYOUT
20. TRUSS DETAIL FOR TRUSS MANUFACTURER
21. FASTENER REQUIREMENTS AT GIRDER TO POST CONNECTION
22. FASTENER REQUIREMENTS
23. WYE BRACE DETAIL
24. KNEE BRACE DETAIL
25. CORD AND DIAGONAL BRACING
26. CROSS BRACING
27. ADDITIONAL BRACING
28. K BRACING
29. END TRUSS ANCHORING DETAILS
30. ENCLOSED SIDEWALL DETAILS
31. 4FT WALL DETAIL
32. 5' WALL DETAIL
33. 8' CRSI WALL DETAIL
34. WALL CORNER DETAIL
35. POST ON WALL ANCHORING DETAIL
36. LIQUID TIGHT JOINT OPTIONS
37. GUTTER DETAIL
38. ROOF RUNOFF PV 30 SCALE
39. ADDITIONAL DETAILS

Designed	B70 STD DWG	1/20
Drawn	July 2021	10/22
Checked	RGD	10/22
Approved	Patricia D. Schweighofer	

COVER SHEET  
CASSILYN SCHWEIGHOFER


United States  
Department of  
Agriculture  
Natural Resources  
Conservation Service

File No.

Drawing No.

Sheet 1 of 39


# E&S POLLUTION CONTROL PLAN AND FINAL SEEDING RECOMMENDATIONS

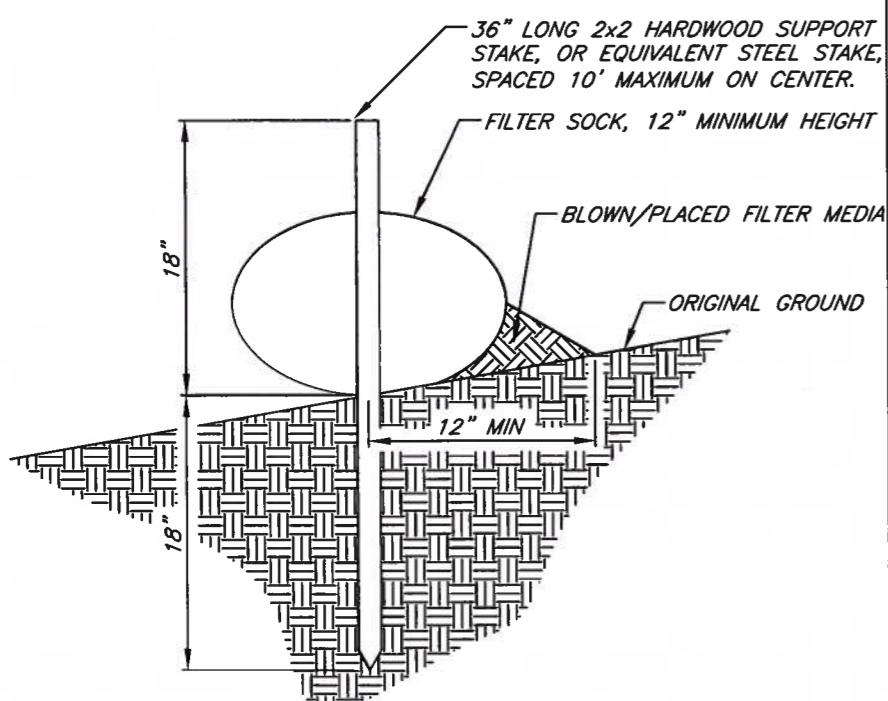

## FILTER SOCK

### NOTES:

1. FILTER SOCK SHALL BE INSTALLED DOWN SLOPE OF THE DISTURBED AREAS OF THE CONSTRUCTION SITE.
2. TRAFFIC SHALL NOT BE PERMITTED TO CROSS FILTER SOCKS.
3. FILTER SOCK SHALL BE PLACED AT LEVEL EXISTING GRADE. BOTH ENDS OF THE SOCK SHALL BE EXTENDED AT LEAST 8' UP SLOPE AT 45 DEGREES TO THE MAIN FENCE ALIGNMENT.
4. STAKES MAY BE INSTALLED IMMEDIATELY DOWN SLOPE OF THE SOCK IF SO SPECIFIED BY THE MANUFACTURER.
5. ACCUMULATED SEDIMENT SHALL BE REMOVED WHEN IT REACHES HALF THE ABOVE GROUND HEIGHT OF THE SOCK.
6. SOCKS SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED SOCKS SHALL BE REPAIRED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS OR REPLACED WITHIN 24 HOURS OF INSPECTION.
7. BIODEGRADABLE FILTER SOCKS SHALL BE REPLACED AFTER 6 MONTHS; PHOTODEGRADABLE SOCKS AFTER 1 YEAR.
8. POLYPROPYLENE SOCKS SHALL BE REPLACED ACCORDING TO THE MANUFACTURER'S RECOMMENDATIONS.
9. UPON STABILIZATION OF THE AREA TRIBUTARY TO THE SOCK, STAKES SHALL BE REMOVED. THE SOCK MAY BE LEFT IN PLACE AND VEGETATED OR REMOVED. IN THE LATTER CASE, THE MESH SHALL BE CUT OPEN AND THE MULCH SPREAD AS A SOIL SUPPLEMENT.
10. ANY SECTION OF SILT FENCE WHICH HAS BEEN UNDERMINED OR TOPPED SHALL BE IMMEDIATELY REPLACED WITH A ROCK FILTER OUTLET.

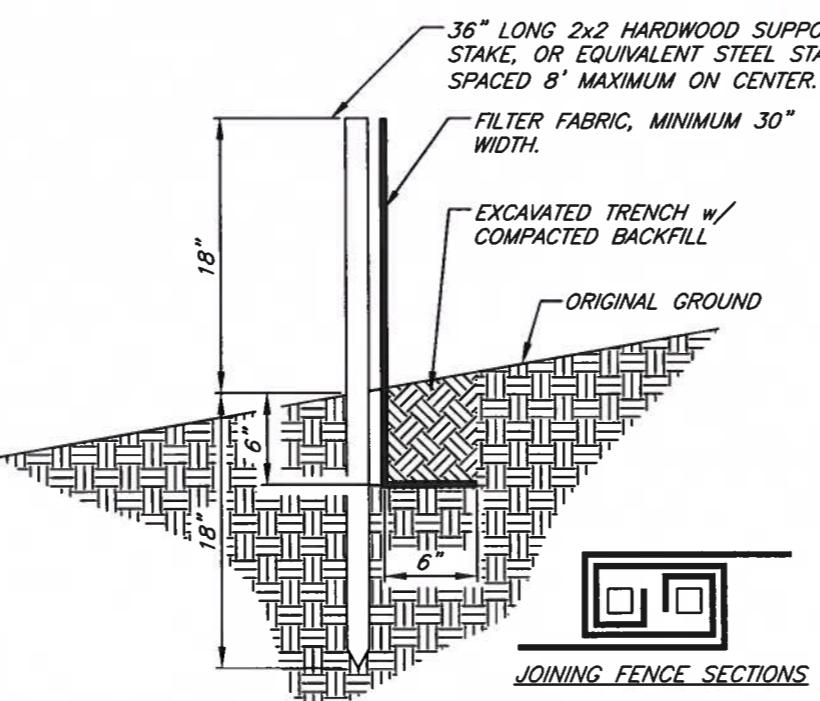

## SILT FENCE

### NOTES:

1. SILT FENCE SHALL BE INSTALLED DOWN SLOPE OF THE DISTURBED AREAS OF THE CONSTRUCTION SITE.
2. SILT FENCE SHALL BE PLACED AT LEVEL EXISTING GRADE. BOTH ENDS OF THE FENCE SHALL BE EXTENDED AT LEAST 8' UP SLOPE AT 45 DEGREES TO THE MAIN FENCE ALIGNMENT.
3. FENCE SHALL BE INSPECTED WEEKLY AND AFTER EACH RUNOFF EVENT. DAMAGED FENCE SHALL BE REPAIRED ACCORDING TO THE MANUFACTURER'S SPECIFICATIONS AND REPLACED WITHIN 24 HOURS OF INSPECTION.
4. SEDIMENT SHALL BE REMOVED WHEN ACCUMULATIONS REACH HALF THE ABOVE GROUND HEIGHT OF THE FENCE.
5. ANY SECTION OF SILT FENCE WHICH HAS BEEN UNDERMINED OR TOPPED SHALL BE IMMEDIATELY REPLACED WITH A ROCK FILTER OUTLET.
6. FENCE SHALL BE REMOVED AND PROPERLY DISPOSED OF WHEN TRIBUTARY AREA IS PERMANENTLY STABILIZED.

### Seeding Recommendation

6. The seed mixture shall be the following or similar if approved by the NRCS representative.

Nurse Crop (required with every permanent seed application):

Oats	64 lbs/acre PLS
Wheat	90 lbs/acre PLS
Annual Rye	40 lbs/acre PLS


Permanent Stabilization:  
Perennial Rye 40 lbs/acre PLS  
PLUS  
Tall Fescue 80 lbs/acre PLS

NOTE: This mixture is suitable for frequent mowing.  
Do not cut shorter than 4".

PLS means pure, live, seed. PLS is the product of the percentage of pure seed times percentage germination divided by 100. For example, to secure the actual planting rate for switchgrass, divide 12 lbs PLS by the PLS percentage shown on the seed tag. Thus, if the PLS content of a given seed lot is 35%, divide by .35 to obtain 34.4 lbs of seed, the amount of seed required to plant 1 acre. If partial completion of any part of the project is accomplished, and this area will be disturbed again BUT not for a period of 20 days or more, those areas must be seeded with a TEMPORARY cover-seeding.

Temporary Seed and mulch will be applied at the following rates:

Annual Ryegrass	40 lbs/Acre
Winter Rye	3 Bu/Acre
Winter Wheat	3 Bu/Acre
Spring Oats	3 Bu/Acre

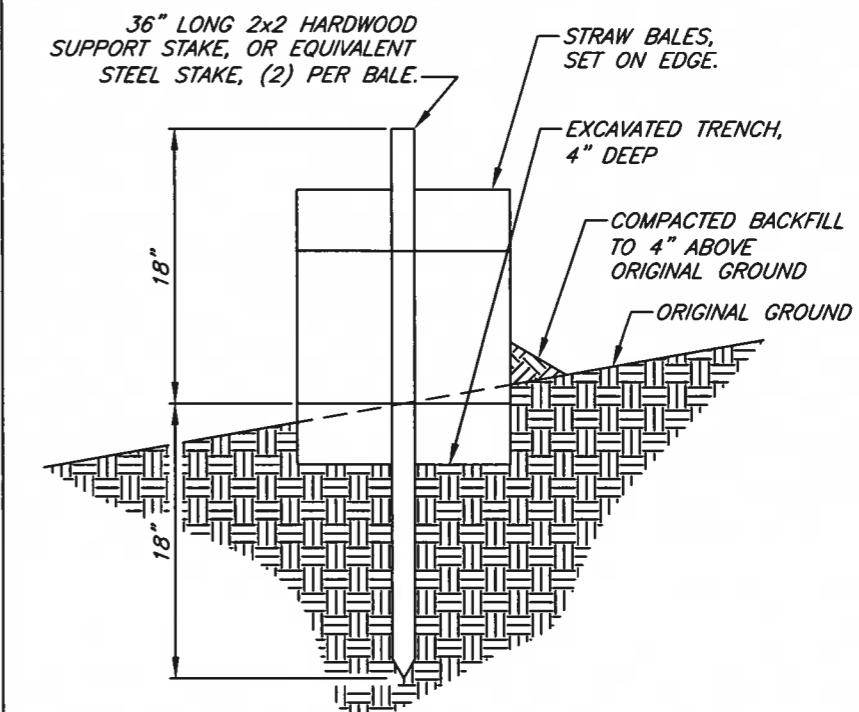

## STRAW BALE BARRIER

### NOTES:

1. STRAW BALES SHALL BE INSTALLED ACROSS SWALES, WATERWAYS, AND DIVERSIONS WHERE SEDIMENT LADEN RUNOFF COULD LEAVE THE CONSTRUCTION SITE.
2. STRAW BALE BARRIERS SHALL NOT BE USED FOR PROJECTS EXTENDING MORE THAN 3 MONTHS.
3. STRAW BALE BARRIERS SHALL BE PLACED AT EXISTING LEVEL GRADE WITH ENDS TIGHTLY ABUTTING THE ADJACENT BALES. THE FIRST STAKE OF EACH BALE SHALL BE ANGLED TOWARD THE ADJACENT BALE TO DRAW THE BALES TOGETHER. STAKES SHALL BE DRIVEN FLUSH WITH THE TOP OF THE BALE. BOTH ENDS OF THE BARRIER SHALL BE EXTENDED AT LEAST 8' UP SLOPE AT 45 DEGREES TO THE MAIN BARRIER ALIGNMENT.
4. SEDIMENT SHALL BE REMOVED WHEN ACCUMULATIONS REACH ONE THIRD THE ABOVE GROUND HEIGHT OF THE BALE. DAMAGED OR DETERIORATED BALES SHALL BE REPLACED IMMEDIATELY UPON INSPECTION.
5. ANY SECTION OF THE STRAW BALE BARRIER WHICH HAS BEEN UNDERMINED OR TOPPED SHALL BE IMMEDIATELY REPLACES WITH A ROCK FILTER OUTLET.
6. BALES SHALL BE REMOVED WHEN THE TRIBUTARY AREA HAS BEEN PERMANENTLY STABILIZED.

THIS EROSION AND SEDIMENTATION PLAN IS BASED ON THE PENNSYLVANIA DEPARTMENT OF ENVIRONMENTAL PROTECTION EROSION AND SEDIMENT POLLUTION CONTROL PROGRAM MANUAL, TECHNICAL GUIDANCE NUMBER 363-2134-008, MARCH 2012.

1. When grading is finished, apply lime and fertilizer in accordance with soil test recommendations.
2. If soil test results are not available, apply 4 ton per acre of agricultural grade limestone and fertilize at the rate of 1,000 lbs. Of 10-20-20 or equivalent per acre.
3. Lime and one-half (1/2) the amount of the fertilizer shall be incorporated 4 to 6 inches into the soil.
4. Work area with chisel plow or similar type equipment, making sure lime and fertilizer are worked well into the soil.
5. Follow with the balance of fertilizer and seed.

NOTE: This mixture is suitable for frequent mowing.  
Do not cut shorter than 4".

PLS means pure, live, seed. PLS is the product of the percentage of pure seed times percentage germination divided by 100. For example, to secure the actual planting rate for switchgrass, divide 12 lbs PLS by the PLS percentage shown on the seed tag. Thus, if the PLS content of a given seed lot is 35%, divide by .35 to obtain 34.4 lbs of seed, the amount of seed required to plant 1 acre. If partial completion of any part of the project is accomplished, and this area will be disturbed again BUT not for a period of 20 days or more, those areas must be seeded with a TEMPORARY cover-seeding.

Temporary Seed and mulch will be applied at the following rates:

Annual Ryegrass	40 lbs/Acre
Winter Rye	3 Bu/Acre
Winter Wheat	3 Bu/Acre
Spring Oats	3 Bu/Acre

### Planting Recommendation

Seed can be applied with a drill or broadcast seeder.  
Band seeding is not permitted.

If broadcast, harrow or disk lightly to cover seed. Roll with cultipacker or similar roller in same direction as seeding. (Double drilling gives better distribution of seeding and helps to spread the water while plants are small. Drill first lengthwise and then crosswise (in a zig-zag pattern). Optimum planting time is early spring or mid summer.

7. As soon as seeding is finished, mulch with 3 Tons/Acre of hay or straw, making a layer 1 to 1.5 inches deep. Set disk straight and go over mulch to press straw into the soil.  
Tackifiers can also be used for anchoring mulch.

Date \_\_\_\_\_  
Designed \_\_\_\_\_  
Drawn \_\_\_\_\_  
Checked \_\_\_\_\_  
Approved \_\_\_\_\_

## E&S DETAILS

United States  
Department of  
Agriculture  
Natural Resources  
Conservation Service



File No. \_\_\_\_\_

Drawing No. \_\_\_\_\_

Sheet 2 of 39

## GENERAL CONSTRUCTION NOTES



File No.

Drawing No.

Sheet 3 of 39

**OWNER RESPONSIBILITIES****ACCESS**

1. The owner is responsible for ensuring that all livestock are removed from the work site and that livestock will remain excluded from the work site until the project has received final certification and is approved for use.
2. The owner is to provide reasonable access to the work site.

**EXCAVATION NOTES****GENERAL**

1. No excavation shall begin until the excavator has complied with all PA One-Call requirements and any utility company responses.
2. All erosion and sedimentation practices shall be installed prior to beginning excavation.
3. OSHA standards shall be followed for all excavation.
4. Topsoil shall be stripped and stockpiled to be re-distributed when the project is complete.
5. All manure-laden soil shall be removed and spread according to the landowner's nutrient management plan.
6. The site shall be excavated until good, stable soil is encountered.
7. If seeps are encountered during excavation, provide clean 2B-stone backfill up to the seep elevation.
8. For Liquid Storage Structures: When hard material is encountered, over-excavate design subgrade by 1.0' and replace with a compacted impermeable layer (i.e. CL/ML) before installing bedding stone; consult with design engineer before doing so.
9. If rock-refusal is met before the design subgrade, changes in design elevations will require NRCS approval.
10. Excess material shall be disposed of as directed by the landowner and the NRCS inspector.
11. A uniform layer of 2B-stone (AASHTO #57), 4" thick shall be placed above subgrade to bed ALL concrete. Stone depth to be measured after compaction. Stone shall not be placed until earthen subgrade elevation and compaction is approved by NRCS inspector.
12. The contractor is responsible for protecting the construction site until the work has been completed and certified by the design engineer. This includes dewatering the site as necessary, as well as preventing upslope runoff from entering the work area. It is strongly recommended that all planned diversions or swales be installed first and all perimeter drain outlets be installed before stone or concrete is placed, if possible.
13. Final grading shall provide positive drainage away from all structures. Swales shall be shaped as necessary along the heavy use area and manure storage to direct stormwater away from the structures.

**EARTHFILL**

1. Earthen backfill shall be placed in a manner that prevents damage to the structures and allows the structures to assume the loads from the earth backfill gradually and uniformly. The height of the earth backfill adjacent to the structure shall be increased at the same rate on all sides of the structure.
2. Backfill shall be placed in even, horizontal layers. If necessary, over-excavate to an approximately level surface and build subgrade in evenly compacted, horizontal lifts of specified thickness.
3. Backfill shall be placed at optimum moisture content. Backfilled material shall have enough moisture so that when formed into a ball, it will not break if struck sharply with a pencil. Backfilling newly poured walls may not begin until 14-days after the final concrete placement. Compact using the following equipment and lift thickness:

**FOOTINGS AND STRUCTURE FLOOR:**

- (3) passes of sheepfoot or vibratory roller in 6-inch lifts

**WITHIN 3 FEET OF WALLS:**

- (3) passes by hand compactor or small, manually directed plate vibrator in 6-inch lifts

**BEYOND 3 FEET OF WALLS:**

- (3) passes by track equipment (>4,000 lbs) in 6-inch lifts
- (4) passes by rubber tired equipment in 6-inch lifts
- (3) passes of vibratory roller in 6-inch lifts

4. Avoid backfill containing rocks or clods greater than 3" diameter, debris, roots, frozen soil, or other unsuitable material as determined by the NRCS inspector.

**PIPES**

1. All pipes shall meet minimum material specifications:
  - 1.1. SCH 40 PVC shall meet ASTM-D1785
  - 1.2. SDR-35 shall meet ASTM-D3034
  - 1.3. Corrugated polyethylene tubing shall meet ASTM-F667 or AASHTO-M252 as detailed below.
    - 1.3.1. ASTM-F667 pipe and fittings may be used when the maximum cover over the pipe does not exceed 9.8'.
    - 1.3.2. AASHTO-M252 pipe and fittings shall be used when the cover over the pipe exceeds 9.8'.
    - 1.3.3. All corrugated polyethylene tubing shall be installed so bedding material is worked in and around the pipe by hand and "knifed" in with a shovel. Haunching and initial backfill material shall be placed with a high level of effort to ensure that the pipe is adequately supported. Compaction tests are not necessary for pipe installation.
2. All fittings for SCH 40 and SDR-35 pipe shall be watertight, and meet the minimum material specifications of the pipe. When pressure flow is necessary; applicable fittings will be defined in the NRCS supplied construction specifications.
3. Fittings for the corrugated polyethylene pipe do not need to be pressure-rated or watertight but must meet the minimum material specifications of the pipe. If fittings need to be pressure-rated or watertight; applicable fittings will be defined in the NRCS supplied construction specifications.
4. All fittings and connections for pipe shall be made with manufacturer-supplied components made for the intended purpose.
5. Pipes shall be installed to specified depth and to minimum design grade.
6. Trenches for pipelines shall be free of rocks and sharp-edged materials. A supply of AASHTO #57 bedding stone, or other suitable granular material, shall be available to bed pipelines in unstable soils or as directed by NRCS inspectors.
7. Pipes shall be backfilled as shown on design details. Any pipe to be placed in a traffic area is to be bedded as per design details and backfilled to the surface with 2A modified or 2RC aggregate. Any pipe not specifically detailed may be backfilled with moist earth, free of large clods or rocks, and hand compacted in 6-inch lifts. DO NOT drive machinery over recently backfilled pipes. Mound backfill 10% of trench depth to allow for settlement.

**GEOTEXTILE****ACCESS ROAD USE:**

1. Geotextile for roads with normal farm machinery use shall be WOVEN or NON-WOVEN with a minimum tensile strength of 200 pounds.
2. Geotextile for roads with heavy equipment shall be WOVEN or NON-WOVEN with a minimum tensile strength of 315 pounds.

**ANIMAL WALKWAY USE:**

3. Geotextile shall be WOVEN or NON-WOVEN with a minimum tensile strength of 160 pounds.

**PLACED BELOW CONCRETE & ON TOP OF BEDDING STONE USE:**

4. Geotextile shall be WOVEN with an Apparent Opening Size (AOS) between 20 and 100, inclusive.

**ALL USES:**

5. Geotextile installed on slopes greater than 8% shall be NON-WOVEN.
6. Geotextile installed where a wet subgrade is an issue shall be WOVEN or NON-WOVEN. The inspector shall have a discussion with the contractor to see which geotextile type the contractor recommends for the wet subgrade issues. The inspector shall then discuss with the design engineer.
7. Allow 1' overlap between adjacent panels of geotextile where applicable.

Date 4/2022

Designed BTO STANDARD DWG Drawn Checked Approved RGD

Date 4/2022

Approved RGD

# CONCRETE CONSTRUCTION NOTES

WAYNE COUNTY, PENNSYLVANIA

Designed BTO STD DWG 2/2021  
Drawn RGD CHE 2/2021  
Checked RGD CHE 2/2021  
Approved RGD CHE 2/2021

## CONCRETE CONSTRUCTION NOTES

### REINFORCEMENT

1. Reinforcing steel is to be Grade 60. Where 6"x6" w2.9xw2.9 (6 gage) is specified; the fabric shall be mats, not rolls, supported on steel chairs. NO CINDER OR CONCRETE BRICKS ARE PERMITTED. Support shall be often enough so reinforcement stays at the required location within the slab or footing. A 5' (MAX) chair spacing is required.
2. Form oil shall not be sprayed on any rebar, waterstops, or concrete.

### CONCRETE

1. 4,000 psi 28-day compressive strength
2. MAXIMUM water-cement ratio 0.50
3. Air-content 5 to 7%, with air-entrainment
4. Max concrete temperature is 90°
5. Slump shall be 2 to 4 inches prior to addition of superplasticizing admixtures being added, 3 to 6 inches without use of superplasticizers.
6. Slump can be 7.5 inches MAX with the addition of superplasticizing admixtures.
7. Concrete admixtures shall met ASTM-C260 for air entrainment, and ASTM C494 Type A, D, F or G for water-reduction and set-retardation and Types C or E for non-corrosive accelerators.
8. Admixtures shall be included in the design mix. Follow dosages and recommendations of manufacturer.
9. The contractor(s) shall provide a design mix to the NRCS for approval prior to ordering concrete. All load tickets shall be provided to and approved by the inspector on site and shall reflect all materials and quantities including admixtures, amount of water (metered water and free moisture in the aggregate), and total size of the batch. The batch ticket must indicate the amount of water that may be added on-site while maintaining the design requirements or no water may be added.
10. **The concrete mix design may contain slag: Not to exceed 20% of the cementitious material.**

### PLACEMENT

1. **Concrete shall only be placed in the presence of an NRCS inspector.**
2. Placement during hot or cold weather will require a written plan in advance detailing concrete conditions, placement provisions, and a curing plan.
3. Concrete shall not be placed until the subgrade, forms, and steel reinforcements have been inspected and approved by the NRCS. Notification shall be given far enough in advance to provide time for inspection.
4. No water may be added after a superplasticizer.
5. Concrete shall be conveyed from the mixer to the forms as rapidly as practical by methods that will prevent segregation of the aggregates or loss of mortar. Concrete shall be placed within 1.5 hours after the introduction of cement to the aggregate unless an approved set-retarding admixture is used in the mix; during periods of hot weather, it may be necessary to reduce this time.
6. Concrete shall not be dropped more than 5 feet vertically. Superplasticized concrete shall not be dropped more than 12 feet vertically.
7. Formed walls shall be placed in 2<sup>1</sup> layers unless superplasticizer is used, in which case the maximum layer shall be 5'. Each layer shall be consolidated to ensure a good bond with the preceding layer.
8. Concrete shall be consolidated by vibrating immediately after placement and extend a minimum of 6" into the previously consolidated layer.
9. Concrete shall be worked into corners, angles, and all around reinforcement and embedded items in a manner that prevents segregation or the formation of "honeycombing".
10. Vibration shall not be used to make concrete flow.
11. If the surface of a previously placed layer of concrete has taken a set to the degree that it will not mix with the preceding layer when vibrated, the contractor shall discontinue placing concrete and form a construction joint to avoid a "cold joint". **Vinyl waterstop and form material shall be on site prior to starting the placement of any concrete.**
12. The landowner has the option of having grooves floated or cut into the structure floor(s) for added traction for animals and equipment. This decision will be conveyed to the contractor(s) during price solicitation.

### CURING

1. Concrete shall be allowed to cure at least 24 hours prior to beginning form or reinforcement placement for adjacent construction.
2. No equipment shall be allowed on concrete slabs or floors until the concrete has cured for a minimum of 7 days. This includes any motorized material handling equipment, pallets of forms, etc. Skid loaders used for transporting concrete into forms shall not be allowed on slabs or floors for a minimum of 14 days.
3. Forms for walls shall not be removed for at least 24 hours after placing the concrete. If forms are removed in less than 7 days, the exposed concrete shall be sprayed with curing compound.
4. Curing compound shall be applied in a uniform layer over all surfaces requiring protection at a rate as designated by the manufacturer. Curing compound shall be reapplied if disturbed within 3 hours after being applied.
5. Walls shall be allowed to cure for a minimum of 7 days before installing "Drill set" post bracket anchors. Walls shall be allowed to cure for a minimum of 3 days before installing posts in/on "Wet set" brackets.
6. All wall ties, honey-combing, and air holes  $> \frac{3}{4}$ " shall be parged with non-shrink grout.
7. Random cracking in the walls and floor shall be evaluated and determined if the concrete needs to be removed or repaired. Removal and repair shall be the responsibility of the contractor and at no increase in cost.
8. If major repairs are required, the contractor shall prepare a written repair plan with all materials and methods clearly stated and shall be approved by the NRCS engineer of authority before proceeding with the repair.

### JOINTS

1. Before new concrete is placed on or against concrete that has set, the surface of construction joints shall be cleaned of all laitance and debris by high-pressure water cutting, washing and wire-brushing, or as approved by the engineer. The surface of the in-place concrete shall be cut to expose clean, sound aggregate, but not so deep to undercut the edges of the large aggregate. All construction joints shall be wetted for at least 1-hour prior to new placement and standing water shall be removed.
2. Slab control joints shall be saw-cut as soon as possible, but no later than 24 hours after placement of the concrete, at the intervals indicated on the drawings. All joints shall be water tight and as shown on the detail drawings. The saw-cuts shall be thoroughly cleaned and dried so the sealant and primer will bond to the concrete.
3. For the joints in the drawings that call for an elastomeric sealant, the sealant shall meet the requirements stated in the Construction Specification, included in this design package, and shall also meet the following: The sealant shall be Type S (Single Componenet), Class 25, and meet the requirement for Type I (Able to be immersed in liquid). Some sealants require a primer to be used before the sealant is applied; primers shall be used no matter if the joint is located in a "submerged" condition or not. It is recommended that the primer is supplied by the same manufacturer as the sealant, this will ensure that the sealant and primer are compatible.

### TESTING REQUIREMENTS

1. **The contractor is responsible for obtaining a 3rd party ACI Certified Technician for field testing of concrete. The concrete plant cannot test their own concrete. Slump, air entrainment, and concrete temperature shall be taken to ensure the concrete meets NRCS requirements.**  
~~- (4) concrete test cylinders shall be taken every 50 cu.yds.~~  
~~- (3) cylinders to be broken at 28 days and (1) cylinder to be saved for a 56 day break, if necessary. This shall be done for every 50 cu.yds sampled.~~  
~~- Slump, air entrainment, and concrete temperature shall be recorded for every 50 cu.yds as well.~~  
~~- All concrete for testing or making cylinders shall be taken from the discharge end of the pump truck.~~  
~~- All test results shall be provided to the inspector. The ACI technician shall be present from start of concrete placement until the last concrete truck leaves the site.~~
2. The contractor is responsible for ensuring that the concrete meets the design requirements. The contractor shall test the concrete as needed; slump, air entrainment, concrete temperature, and cylinders. All concrete for testing or making cylinders shall be taken from the discharge end of the pump truck. The NRCS, PACD, or Conservation District inspector may test the concrete as they feel the need to do so. The contractor is not to rely on the inspector to provide the testing service.

# Roof Structure Design & Construction Notes

- Trusses shall be used for this roof. Shop drawings shall be provided to the NRCS design engineer for approval prior to ordering the trusses and "PE" (Professional Engineer) sealed shop drawings shall be supplied by the Truss Plate Institute certified manufacturer at the time of truss delivery. (Truss and stringer configuration shown in the drawings is for illustration purposes only) NRCS does not design roof trusses.
- \* Make the truss designer aware of knee bracing being used.
- All nails shall have full heads; Clipped heads are not acceptable.
- All nails and bolts used with pressure treated wood shall be hot-dip galvanized nails that meet the minimum galvanized coating requirements for the most restrictive wood preservative treatment method. (i.e. CCA treated wood requires a minimum coating rating of G-90 however ACQ treated wood requires a coating rating of G-185. When the wood types are mixed, use the G-185 connectors. Consult with individual fastener, hardware manufacturer for recommendations)
- CAUTION:** New wood preservative treatment methods require special fasteners and connectors. All plates and fasteners used with ACQ, CBA or CA treatment formulas must conform to ASTM standards; ASTM A153 for Hot-dip fasteners, and A653 for Hot-dip connector and sheet products. This change increases the galvanized coating requirements to a designation of G-185. Stainless steel fasteners and connections may be used in place of Hot-dip galvanized products. Electro Galvanized fasteners/connectors are not permitted for use.
- Nails for general framing can be common, full head size 16d or larger, smooth nails. General framing includes purlins, diagonal braces, lateral braces, etc.
- Bolts, screws, or metal plate connectors may be used instead of nails. Such substitutions shall provide a connection of equal or greater strength and durability, according to the National Forest Products Association's (NFPA) National Design Specification. Alternate connectors must be approved by the design engineer.
- All wood in contact with the ground or manure shall be pressure treated as per American Wood Preserver's Association Standard (posts shall be treated to 0.6#/cu.ft. and all other wood shall be treated to 0.4#/cu.ft.)
- All structural members which includes; All wye and knee bracing, bearing blocks, truss support blocks, and girders/headers; (excluding microllam girders/headers) shall be Southern Yellow Pine No. 2 Grade (Surface dry, used at 19% maximum moisture content). All secondary members such as permanent or continuous bracing shall be (SYP) Southern Pine No. 3, (SPF) Spruce-Pine-Fir No. 2 or better. Purlins shall be SYP No. 2, SPF No. 2, or better if spaced at 2' centers Purlins shall be SYP No. 3 or better if spaced at 1.5' centers
- Posts are to be Glulam 4ply 2"x6", 4ply 2"x8", and 5ply 2"x8" in size & pressure treated, #2 grade SYP (Southern Yellow Pine). Posts are to be fully pressure treated the entire height. Posts to have the following properties: Bending  $F_b = 2350$  psi, Shear  $F_c = 2150$  psi,  $E = 1,700,000$
- Girders are to be 1 3/4" x 9 1/4" 2.0E LVL's having the following minimum properties: Moment = 6271 ft-lbs., Bending = 2900psi, Shear  $F_v = 3453$  lbs. (320 psi), Modulus of Elasticity = 2,000,000 psi.

- Galvanized angle iron (1/4" thick x 3" wide both ways) can be installed on the corners of the posts at entrance locations. Other means of post protection may be used if approved by the design engineer.
- Knee and Wye bracing are required for the posts and girders as shown. Wye bracing shall be installed AFTER all roof framing is complete. No Wye bracing shall be installed on the "inside" of the entrance locations.
- Permanent continuous lateral bracing is required, according to the truss MFG drawings. Continuous lateral bracing must be installed with staggered side by side overlap connections (no butt to butt connections). The ends of the braces must extend fully past the truss and allow a 2-nail connection without using toenails.
- Permanent diagonal bracing is required at each end of the building and at intervals not to exceed what is shown in the drawings. All bracing shall be installed as Per the Truss Plate Institute BCSI-B3 and the detailed drawing.
- Roofing material shall be steel or aluminum. Steel shall be; galvanized steel, painted galvanized steel, or painted steel. Type of roofing to be discussed with landowner prior to bid solicitation. Steel roofing material shall be 29 gauge minimum. Aluminum roofing material shall have a minimum nominal thickness of .018 inches. Galvalume roofing is not permitted for use.
- Roof fasteners shall be a combination of zinc coated steel and neoprene washer. Double stitch the seams of the roof edges. Typical steel roof shall have fasteners on a 9" spacing on the purlins 24" on center.
- End trusses shall be faced with roofing material, as specified above. This shall be discussed with the landowner prior to bid solicitation.
- Ventilation shall be provided at the ridge or through the openings in the end trusses. Ventilation shall be provided to offer at least 2" of opening per 10' of building width.
- Earth backfill around posts shall be placed in compacted 8" lifts.
- Put 1/2" thick expansion joint material or 2 layers of felt paper between the posts and floor concrete.
- The roof was designed to carry a combined loading of 40 psf, according to ASCE-7 (Most Conservative Combined Load Formula), on the entire roof surface. The roof was also designed for a uniform uplift of 16 psf under the entire roof. This roof is designed for "open" sides; major structural changes may be needed if any sides are enclosed. Consult with the design engineer if curtains or other means of siding is being considered.

File No.	2/2022
Drawing No.	2/2022
Sheet No.	2/2022
Approved by	
Designed by	NRCS
Drawn by	
Checked by	
Approved by	


## ROOF STRUCTURE DESIGN AND CONSTRUCTION NOTES



Natural Resources Conservation Service  
United States Department of Agriculture

Sheet No.	5	of 39
-----------	---	-------




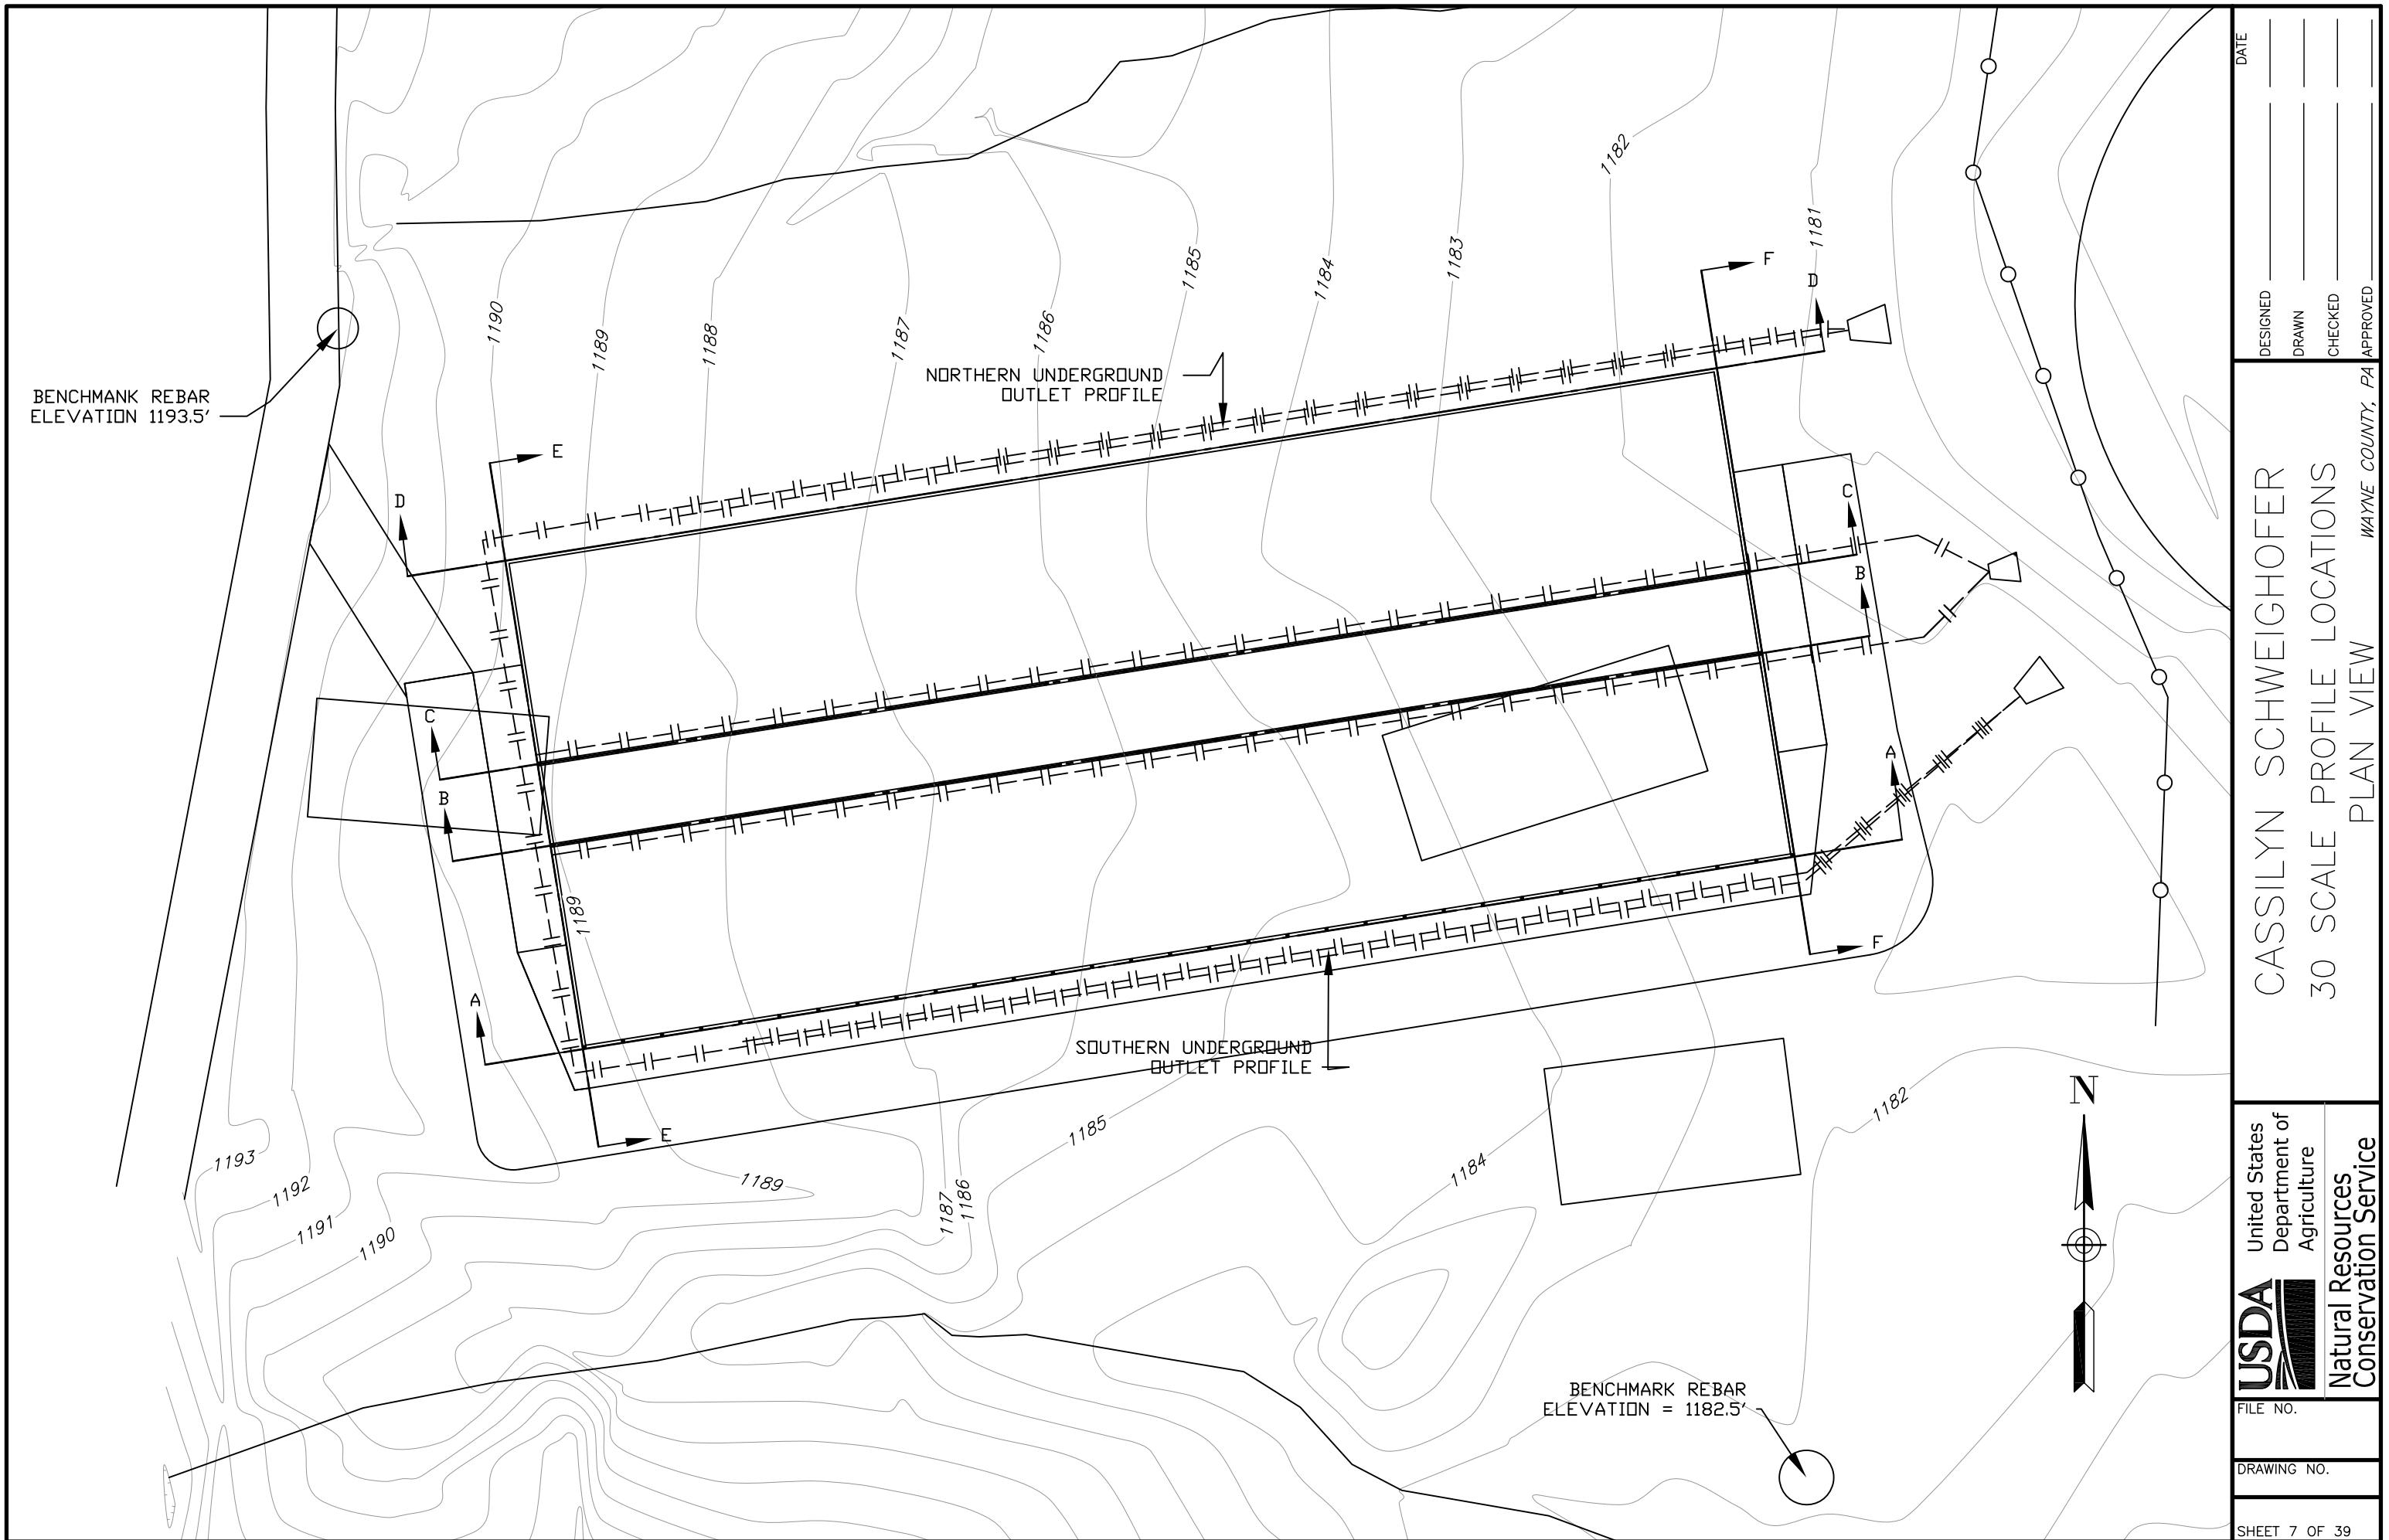

OPEN SIDE. WYE AND K BRACING IS REQUIRED ON THIS SIDE OF BLDG.  
ALL GIRDERS ARE TO BE 1 3/4" X 9 1/4" 2.0E LVLs ATTACHED TO EACH  
SIDE OF POST AND SUPPORTED WITH BEARING BLOCKS.

ALL POST 5PLY 2X8 GLULAM 8' O.C. UNLESS OTHERWISE NOTED.  
ALL TRUSS'S 4' O.C. UNLESS OTHERWISE NOTED.

NOTE: GIRDERS (LVLs) EXTEND 1 1/2" BEYOND END POST  
TO ALLOW FOR ENCLOSED GABLE END. END TRUSS IS NOT NOTCHED INTO  
THE SIDE OF POST. SEE: END TRUSS ANCHORING DETAIL

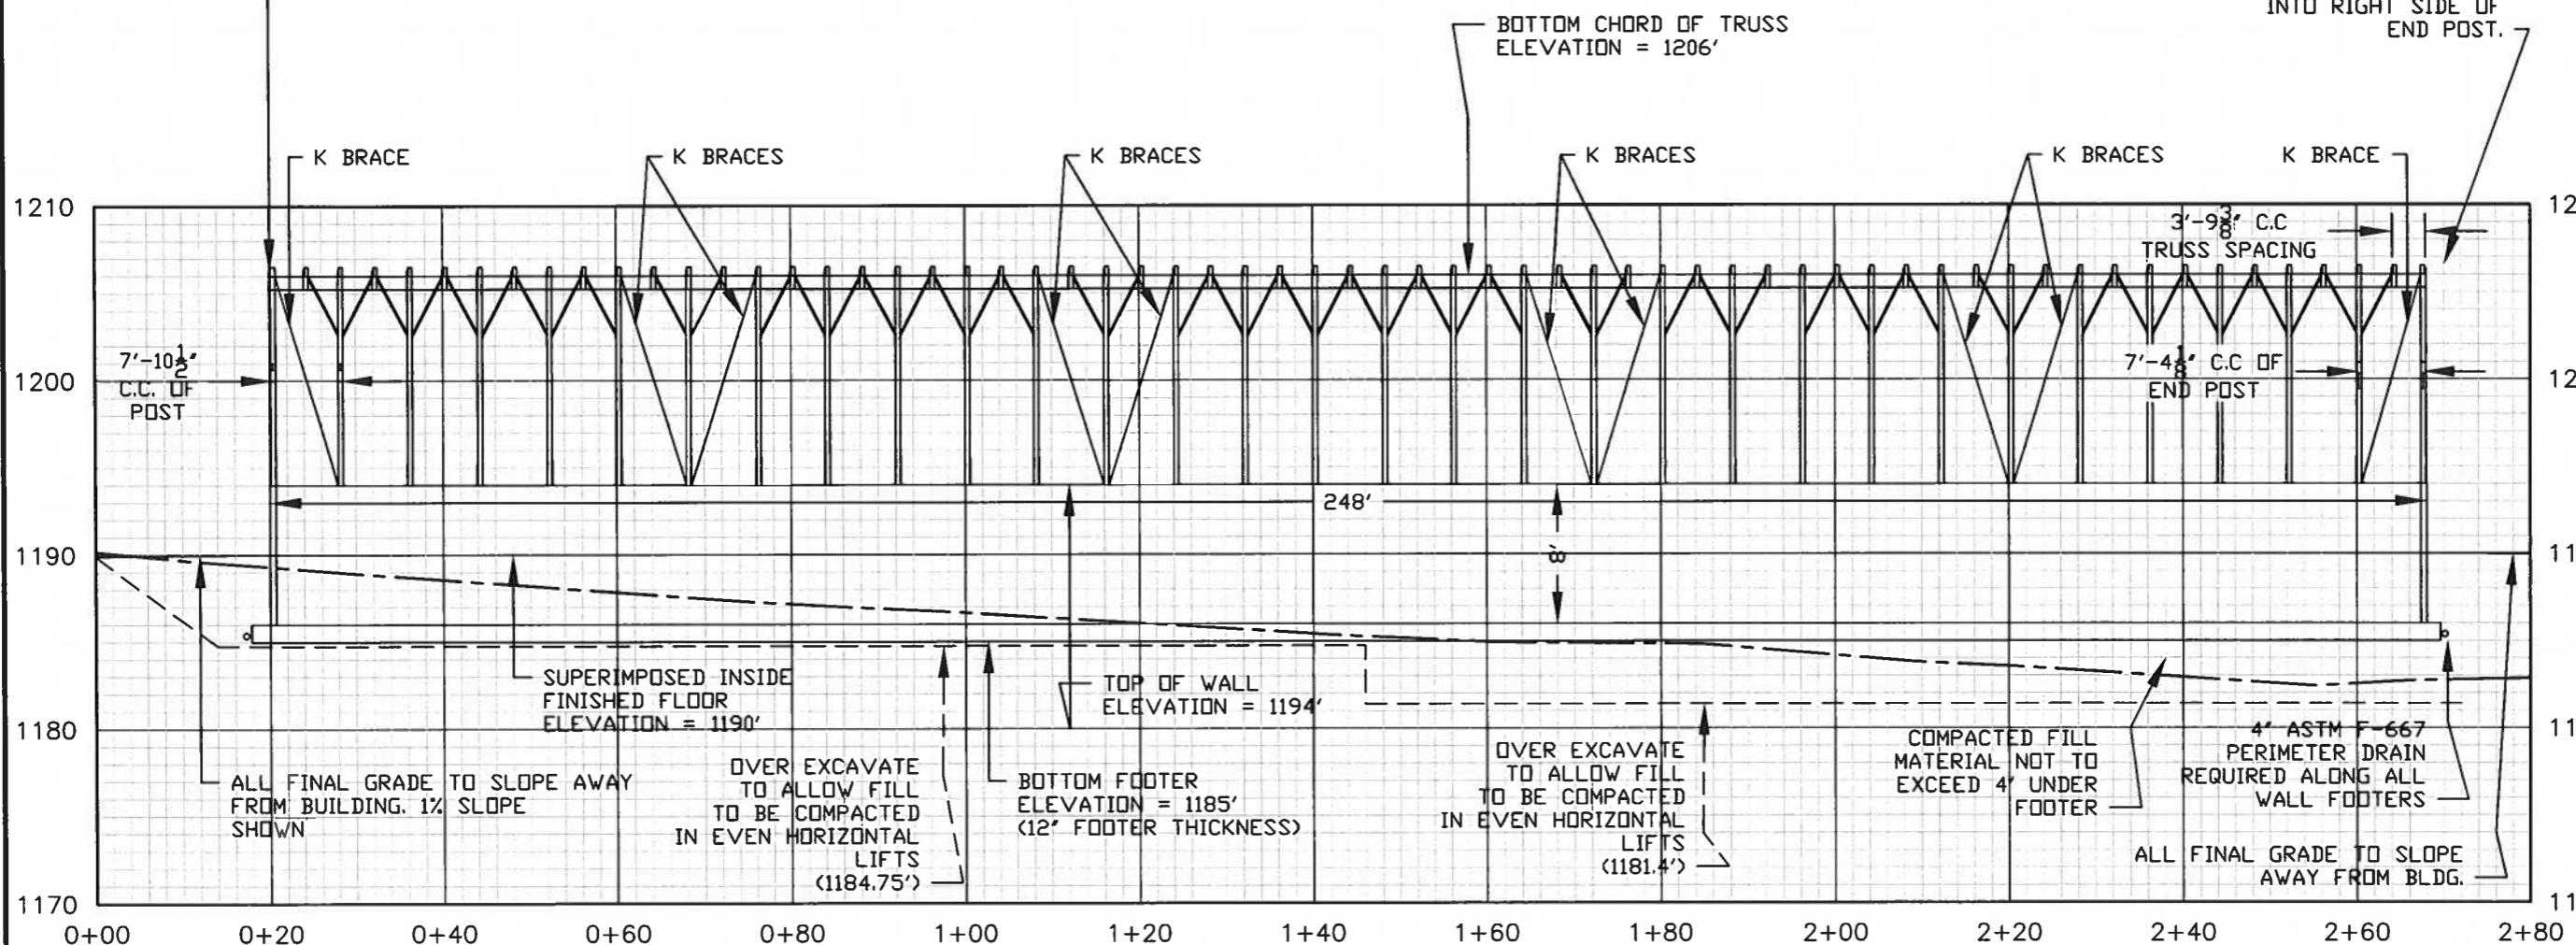

DATE	
DESIGNED	
DRAWN	
CHECKED	
APPROVED	

WAYNE COUNTY, PA

CASSILYN SCHWEIGHOFER PROFILE A-A

United States Department of Agriculture

USDA

Natural Resources Conservation Service

FILE NO.

DRAWING NO.

SHEET 8 OF 39

ALL GIRDERS ARE TO BE 1 3/4" X 9 1/4" 20E LVLs ATTACHED TO EACH SIDE OF POST AND SUPPORTED WITH BEARING BLOCKS.

ALL TRUSS'S 4' O.C. UNLESS OTHERWISE NOTED.  
ALL POSTS 5PLY 2X8 GLULAM 8' O.C. UNLESS OTHERWISE NOTED

— NOTE: GIRDERS (LVL'S) EXTEND 1 1/2" BEYOND END POST  
TO ALLOW FOR ENCLOSED GABLE END. END TRUSS IS NOT NOTCHED INTO  
THE SIDE OF POST. SEE: END TRUSS ANCHORING DETAIL

GIRDERS DO NOT EXTEND BEYOND  
POST. TRUSS IS NOTCHED  
INTO RIGHT SIDE OF  
END POST.

TOP OF 4' WALL  
ELEVATION = 1190.33'  
(ALLOWS FOR 4' FEED CURB)

BOTTOM CHORD OF TRUSS  
ELEVATION = 1206'

7'-10 1/2" C.C. OF POST

3'-9 1/8" C.C. TRUSS SPACING

7'-4 1/8" C.C. OF END POST

ALL FINAL GRADE TO SLOPE AWAY FROM BUILDING

4' ASTM F-667 PERIMETER DRAIN REQUIRED ALONG ALL WALL FOOTERS

SUPERIMPOSED FINISHED FLOOR ELEVATION = 1190'

OVER EXCAVATE TO ALLOW FILL TO BE COMPAKTED IN EVEN HORIZONTAL LIFTS (1185')

BOTTOM FOOTER ELEVATION = 1185.58'

OVER EXCAVATE TO ALLOW FILL TO BE COMPAKTED IN EVEN HORIZONTAL LIFTS (1181.4')

TOP OF 5' WALL ELEVATION = 1191.33'  
(ALLOWS FOR 16' FEED CURB)

ALL FINAL GRADE TO SLOPE AWAY FROM BLDG.

1170 1180 1190 1200 1210

1170 1180 1190 1200 1210

0+00 0+20 0+40 0+60 0+80 1+00 1+20 1+40 1+60 1+80 2+00 2+20 2+40 2+60 2+80

CASSILYN SCHWEIGHOFER

DESIGNED BY

## B-B PROFILE

OUTSIDE END BRACKET (REVERSE)  
USE (2) STURDI WALL SW80 UNIVERSAL  
SERIES BRACKETS FOR END POST(S) ONLY


1 3/8"  
SETBACK FROM  
OUTSIDE OF WALL  
TO EDGE OF POST

EACH END OF INTERIOR WALLS (ONLY) IS TO HAVE THE OUTSIDE POST ANCHOR BRACKET REVERSED AND INSTALLED WITH THE FOOT OF THE BRACKET UNDER THE POST. POST TO BE PRE-NOTCHED AND DRILLED TO ALLOW FOR POST TO SIT EVENLY ON A PORTION OF THE BRACKET AND CONCRETE WALL. NOTE: ALL OTHER POST ANCHOR BRACKETS FOR INTERIOR WALLS ARE TO BE STURDI WALL SW85GL SERIES. THE SW80 UNIVERSAL SERIES ARE ONLY USED ON THE END POSTS.


USDA		United States Department of Agriculture	CASSILYN SCHWEIGHOFER PROFILE B-B	DESIGNED _____ DRAWN _____ CHECKED _____ APPROVED _____
FILE NO.		WAYNE COUNTY, PA		
DRAWING NO.				
SHEET	9 OF 19			

ALL GIRDERS ARE TO BE 1 3/4" X 9 1/4" 2.0E LVLS ATTACHED TO EACH SIDE OF POST AND SUPPORTED WITH BEARING BLOCKS.  
ALL TRUSS'S 4' O.C. UNLESS OTHERWISE NOTED.

ALL POSTS 5PLY 2X8 GLULAM.  
ALL POSTS 8' O.C.  
UNLESS OTHERWISE NOTED

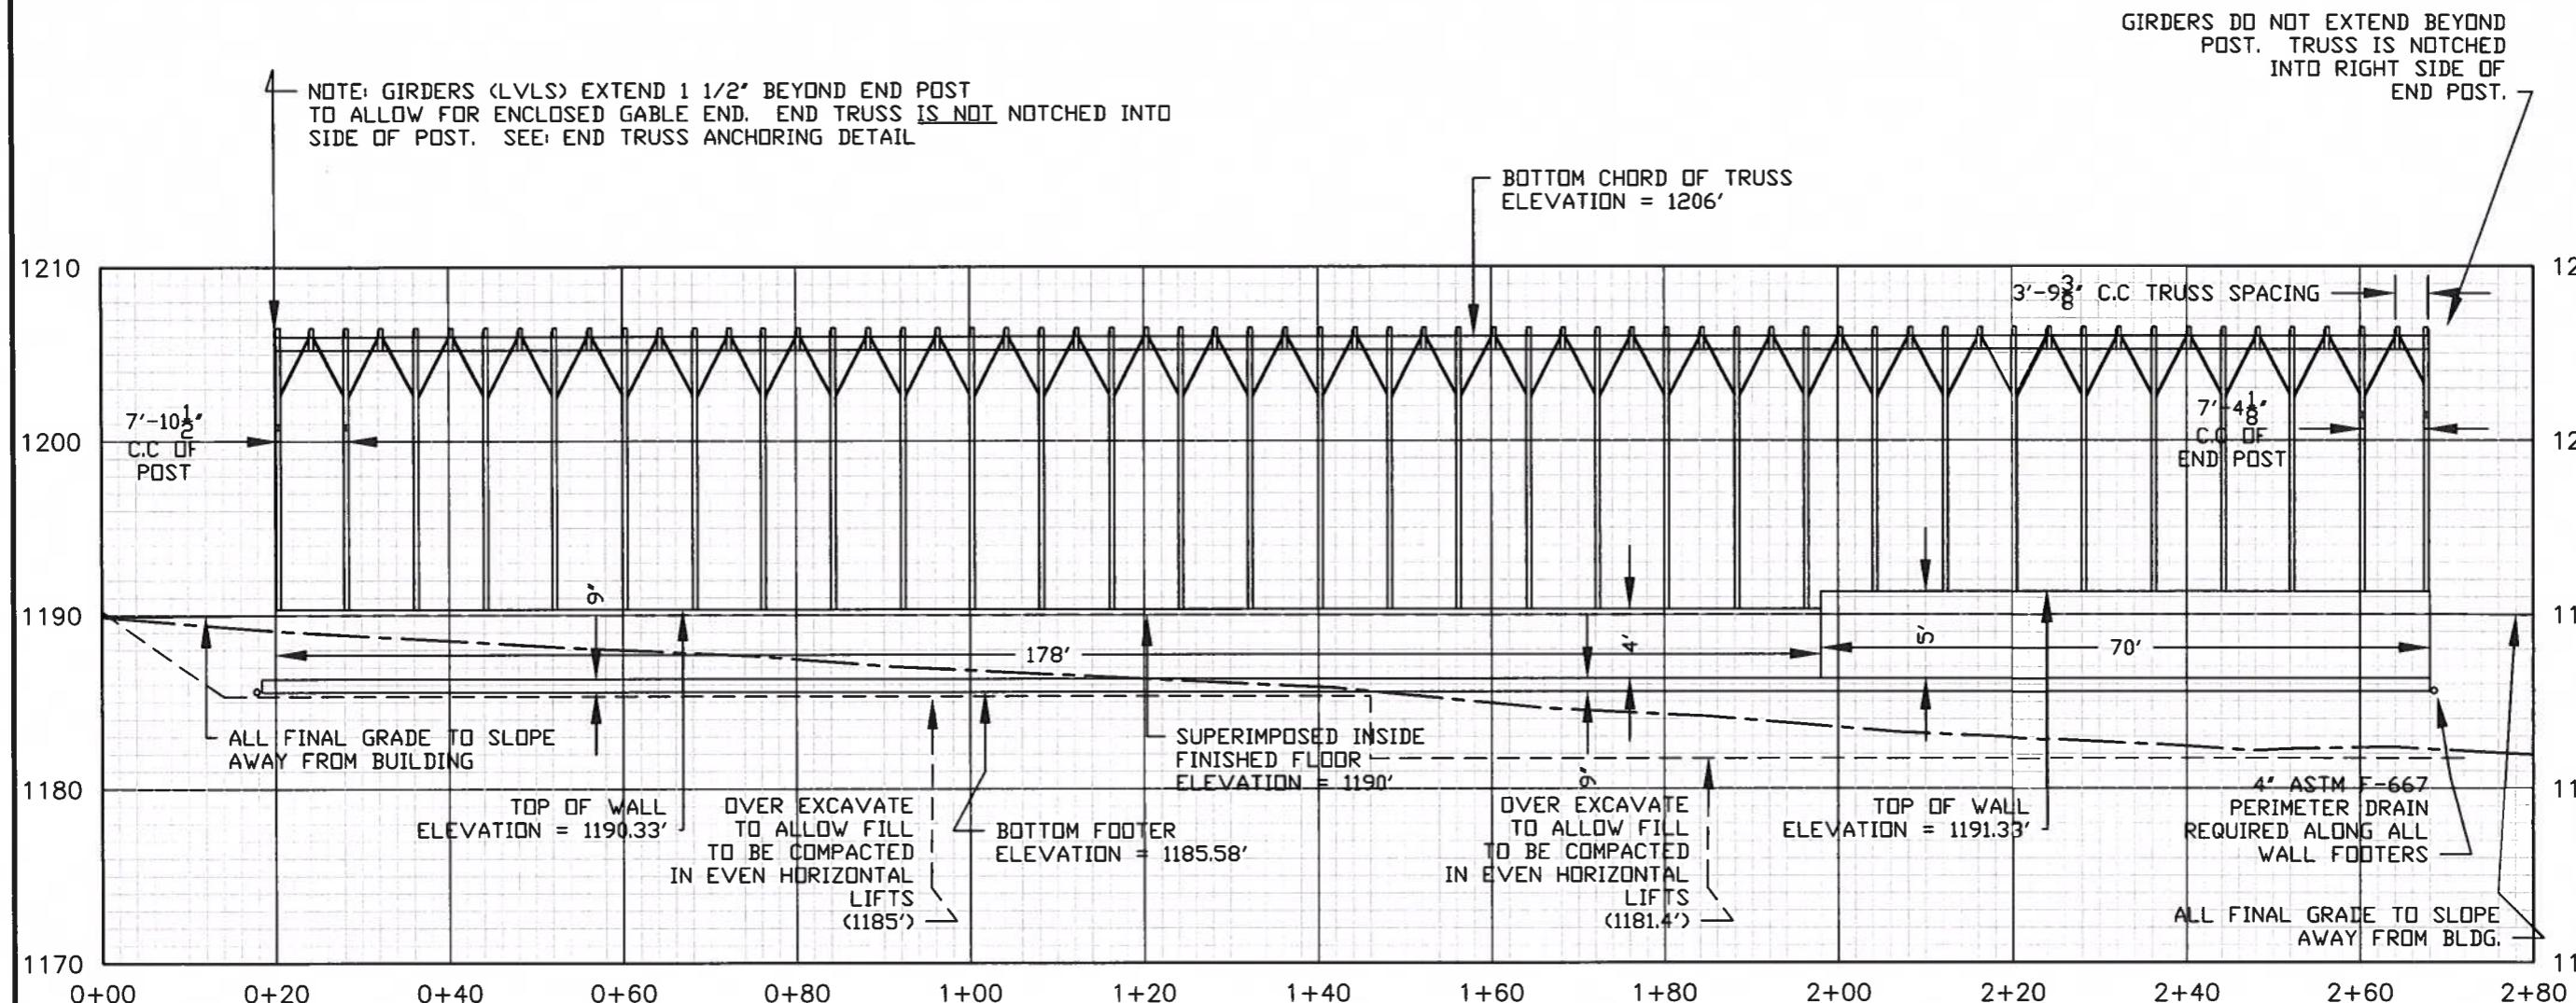

C-C (1) PROFILE

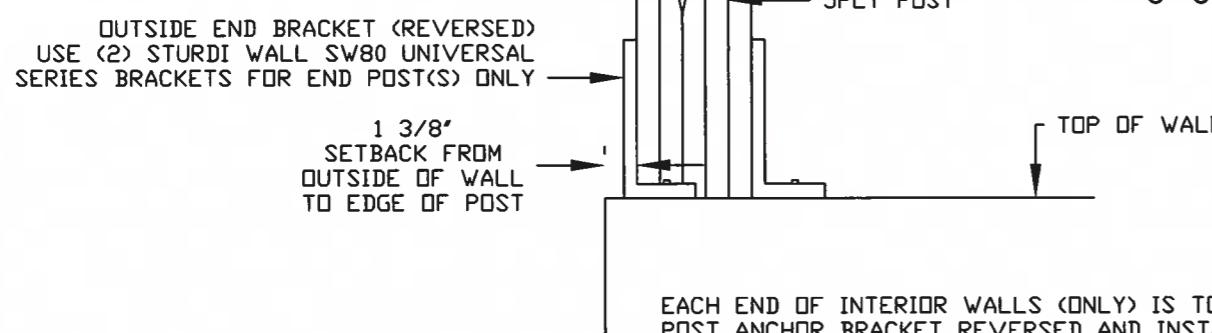


EACH END OF INTERIOR WALLS (ONLY) IS TO HAVE THE OUTSIDE POST ANCHOR BRACKET REVERSED AND INSTALLED WITH THE FOOT OF THE BRACKET UNDER THE POST. POST TO BE PRE-NOTCHED AND DRILLED TO ALLOW FOR POST TO SIT EVENLY ON A PORTION OF THE BRACKET AND CONCRETE WALL. NOTE: ALL OTHER POST ANCHOR BRACKETS FOR INTERIOR WALLS ARE TO BE STURDI WALL SW85GL SERIES. THE SW80 UNIVERSAL SERIES ARE ONLY USED ON THE END POSTS.

DESIGNED	DRAWN	WAYNE COUNTY, PA
DRAWN	CHECKED	APPROVED
DATE		
CASSILYN SCHWEIGHOFER		
PROFILE C-C		
United States Department of Agriculture		
Natural Resources Conservation Service		
FILE NO.		
DRAWING NO.		
SHEET 10 OF 39		

DATE \_\_\_\_\_  
 DESIGNED \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 CHECKED \_\_\_\_\_  
 APPROVED \_\_\_\_\_

WAYNE COUNTY, PA  
 CASSILYN SCHWEIGHOFER  
 PROFILE D-D

1990

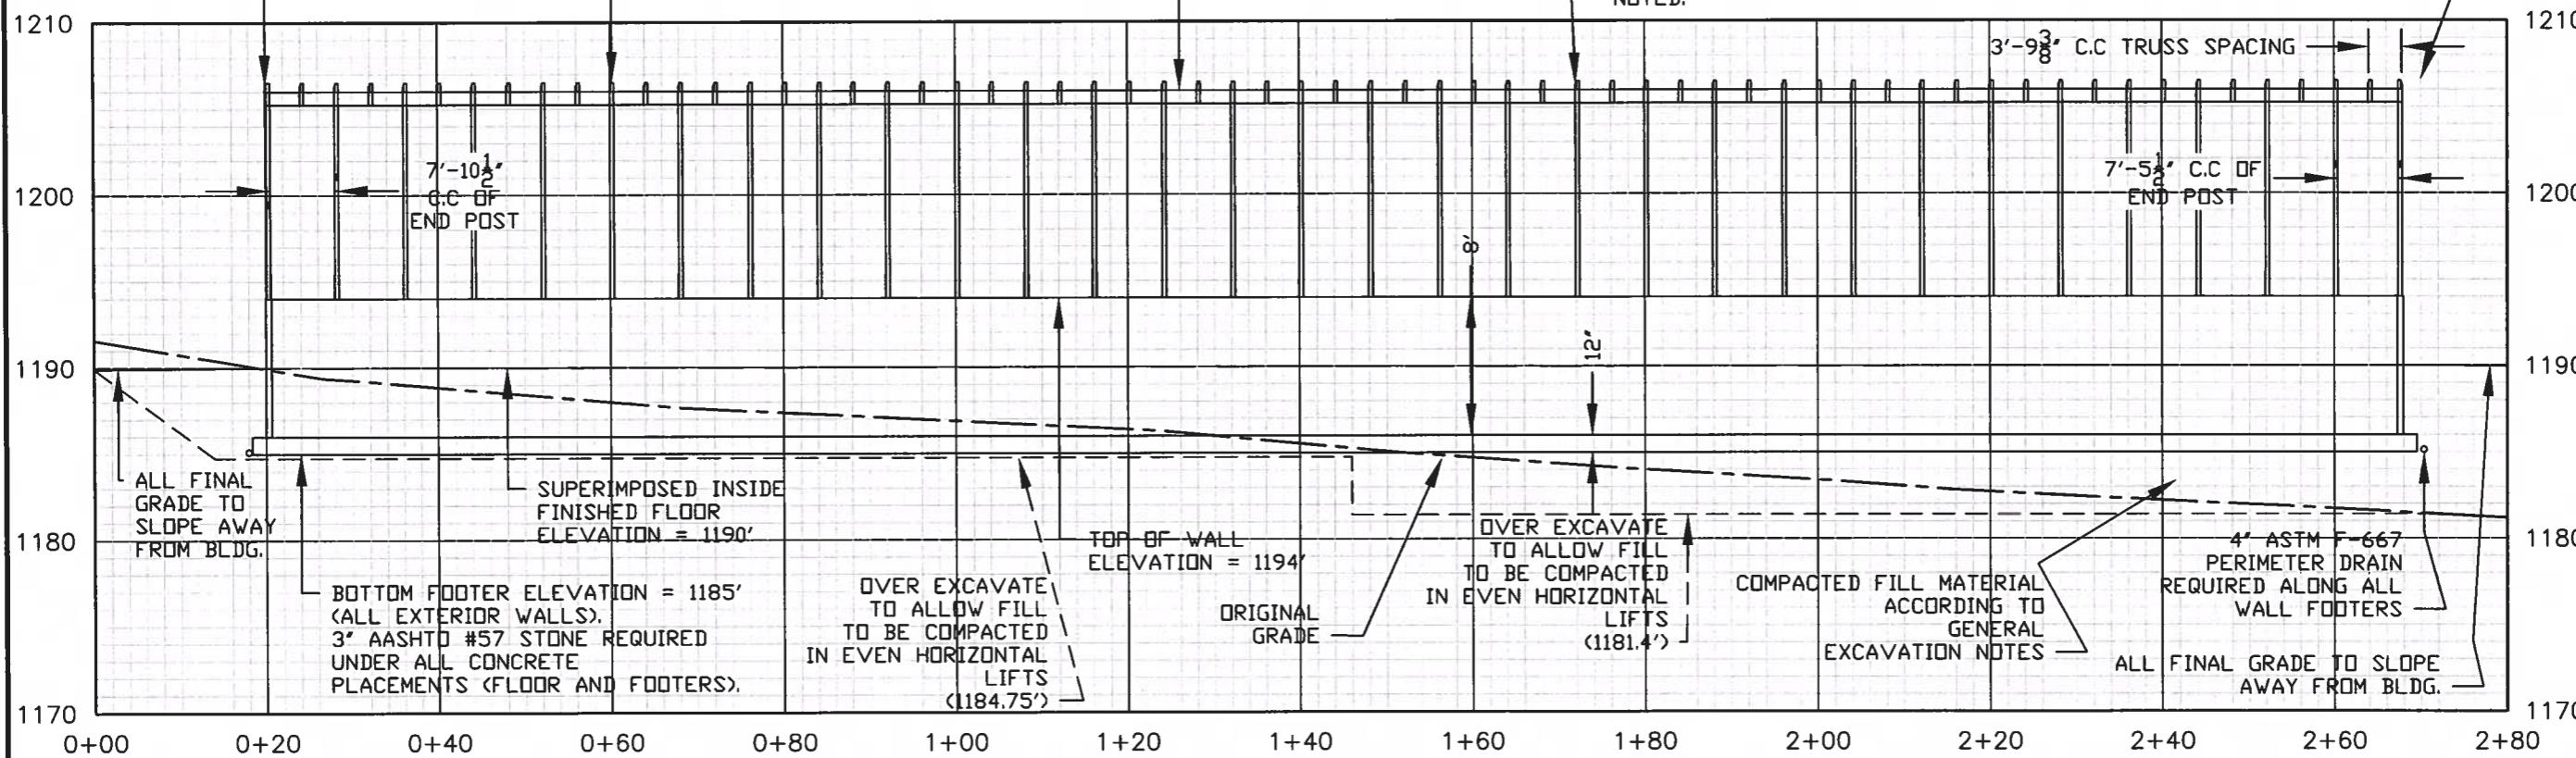



D-D PROFILE


United States  
 Department of  
 Agriculture  
 Natural Resources  
 Conservation Service


USDA

FILE NO. \_\_\_\_\_  
 DRAWING NO. \_\_\_\_\_

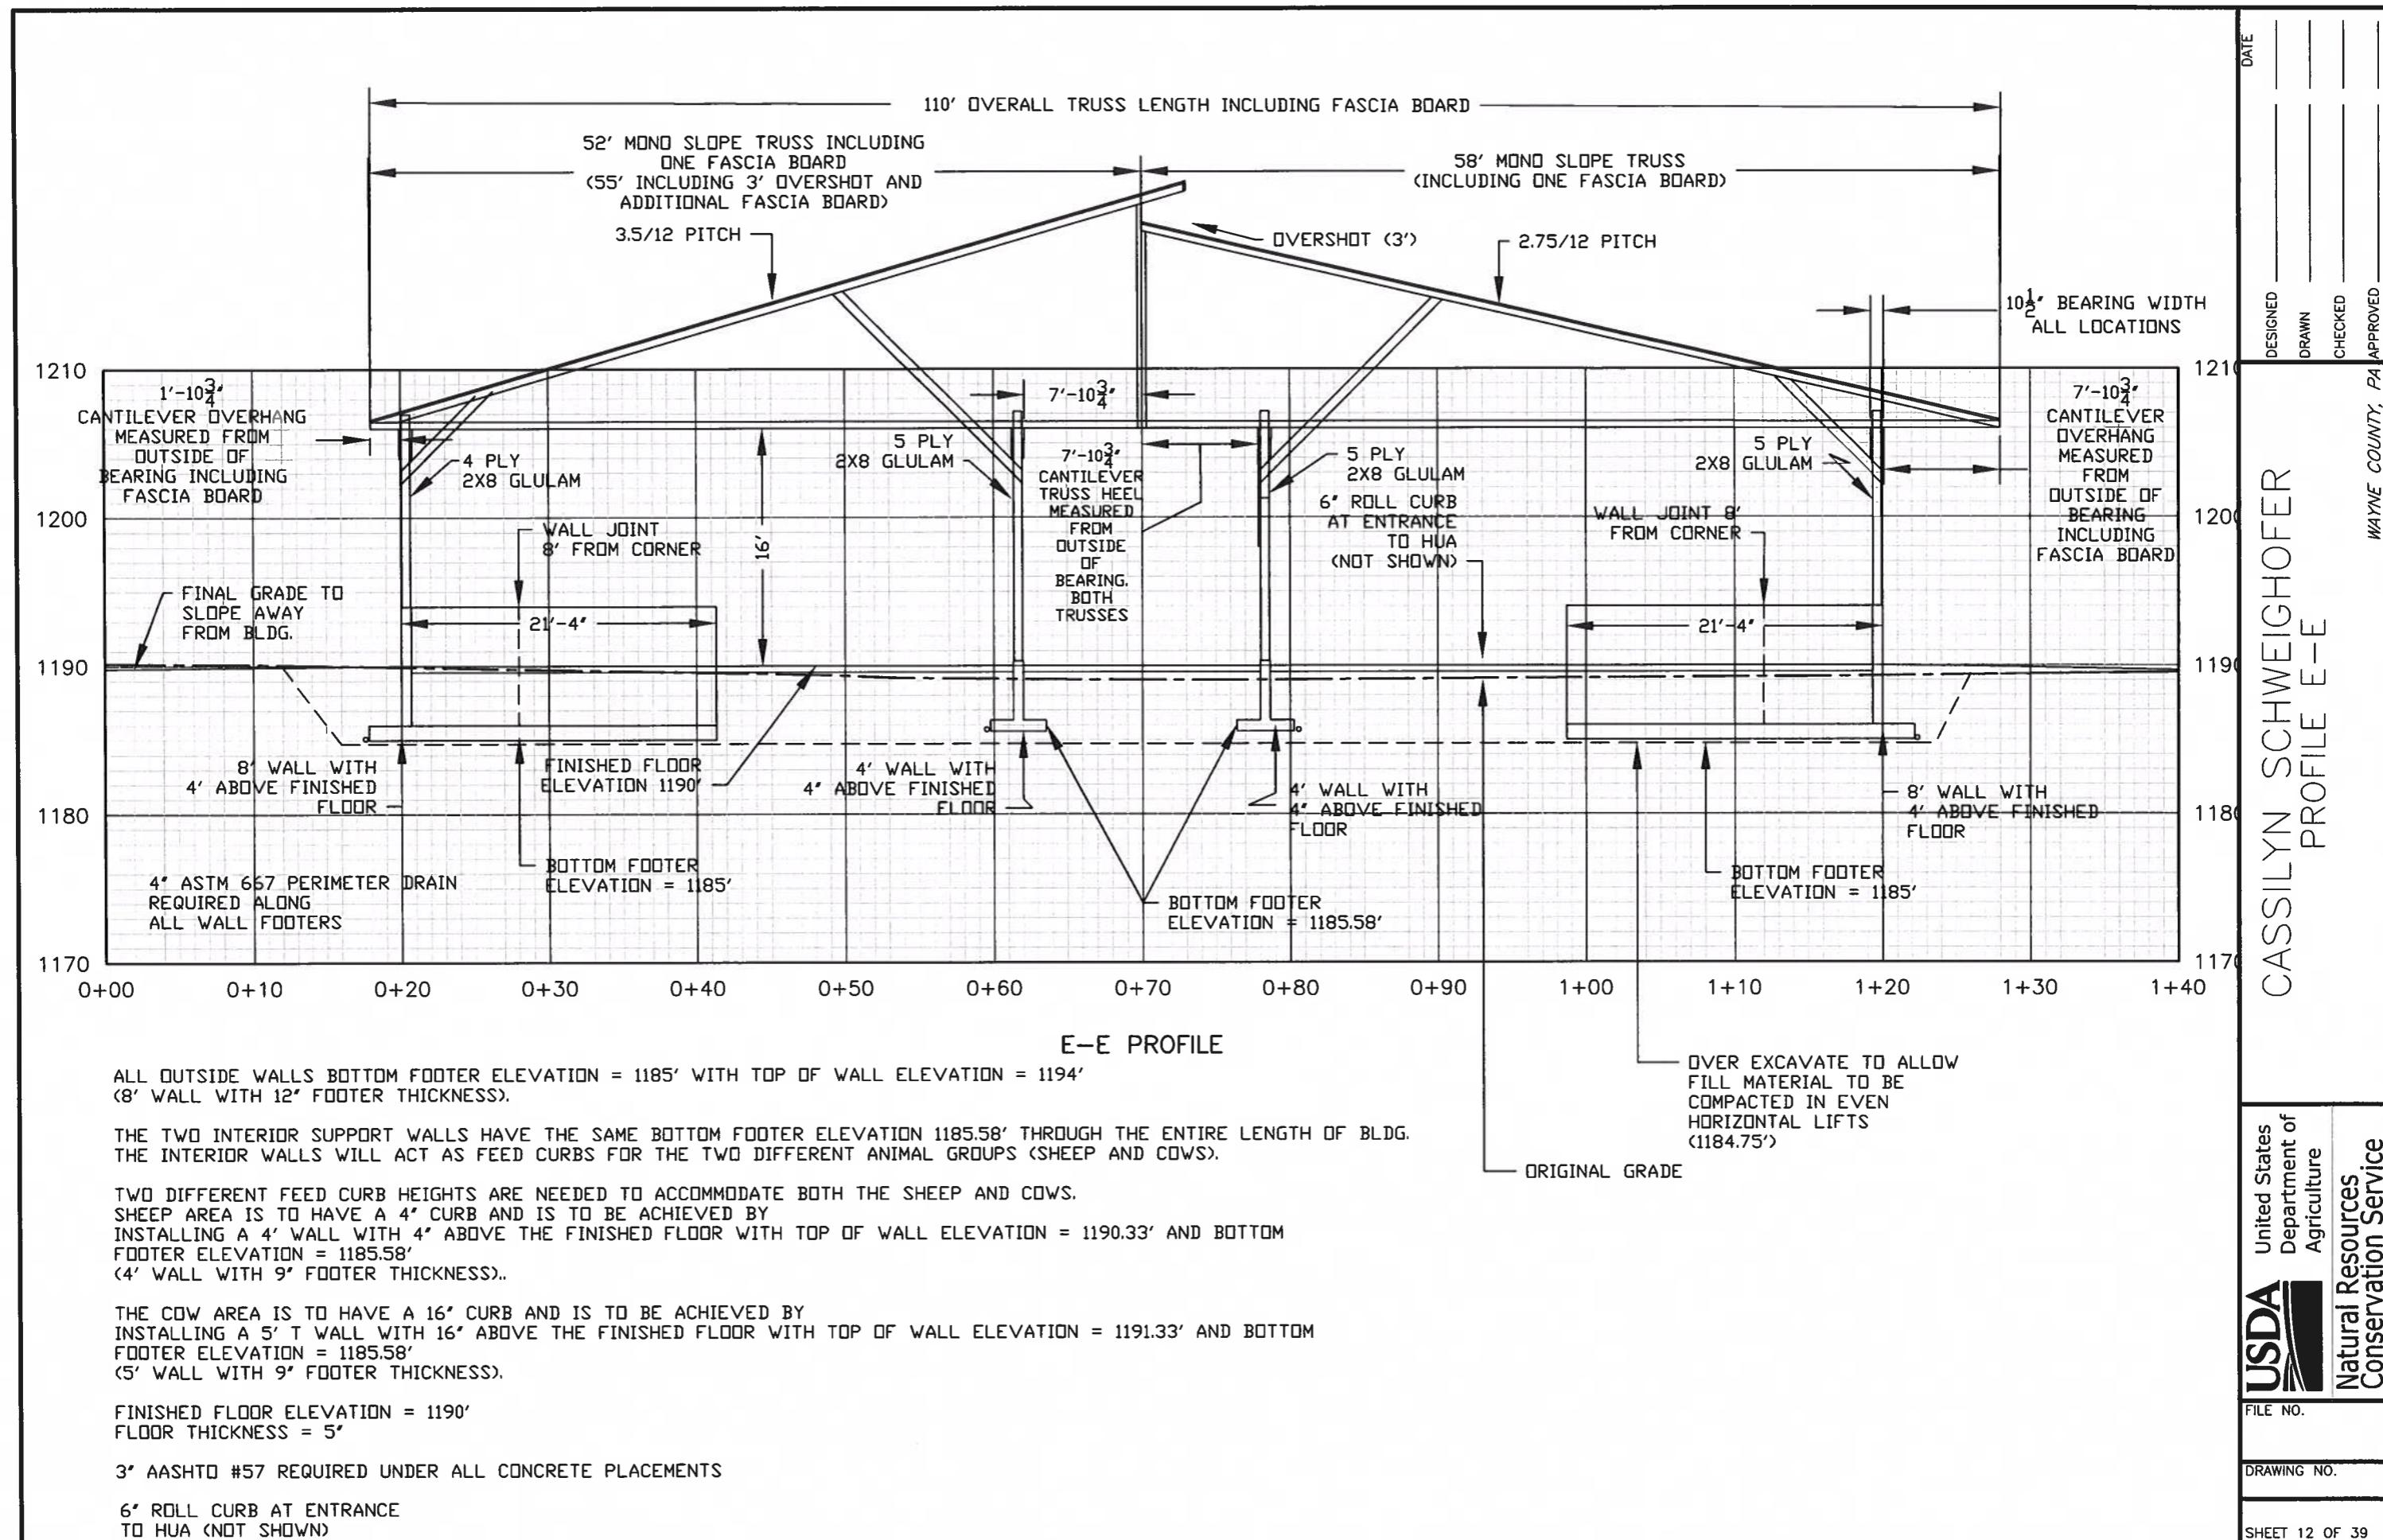

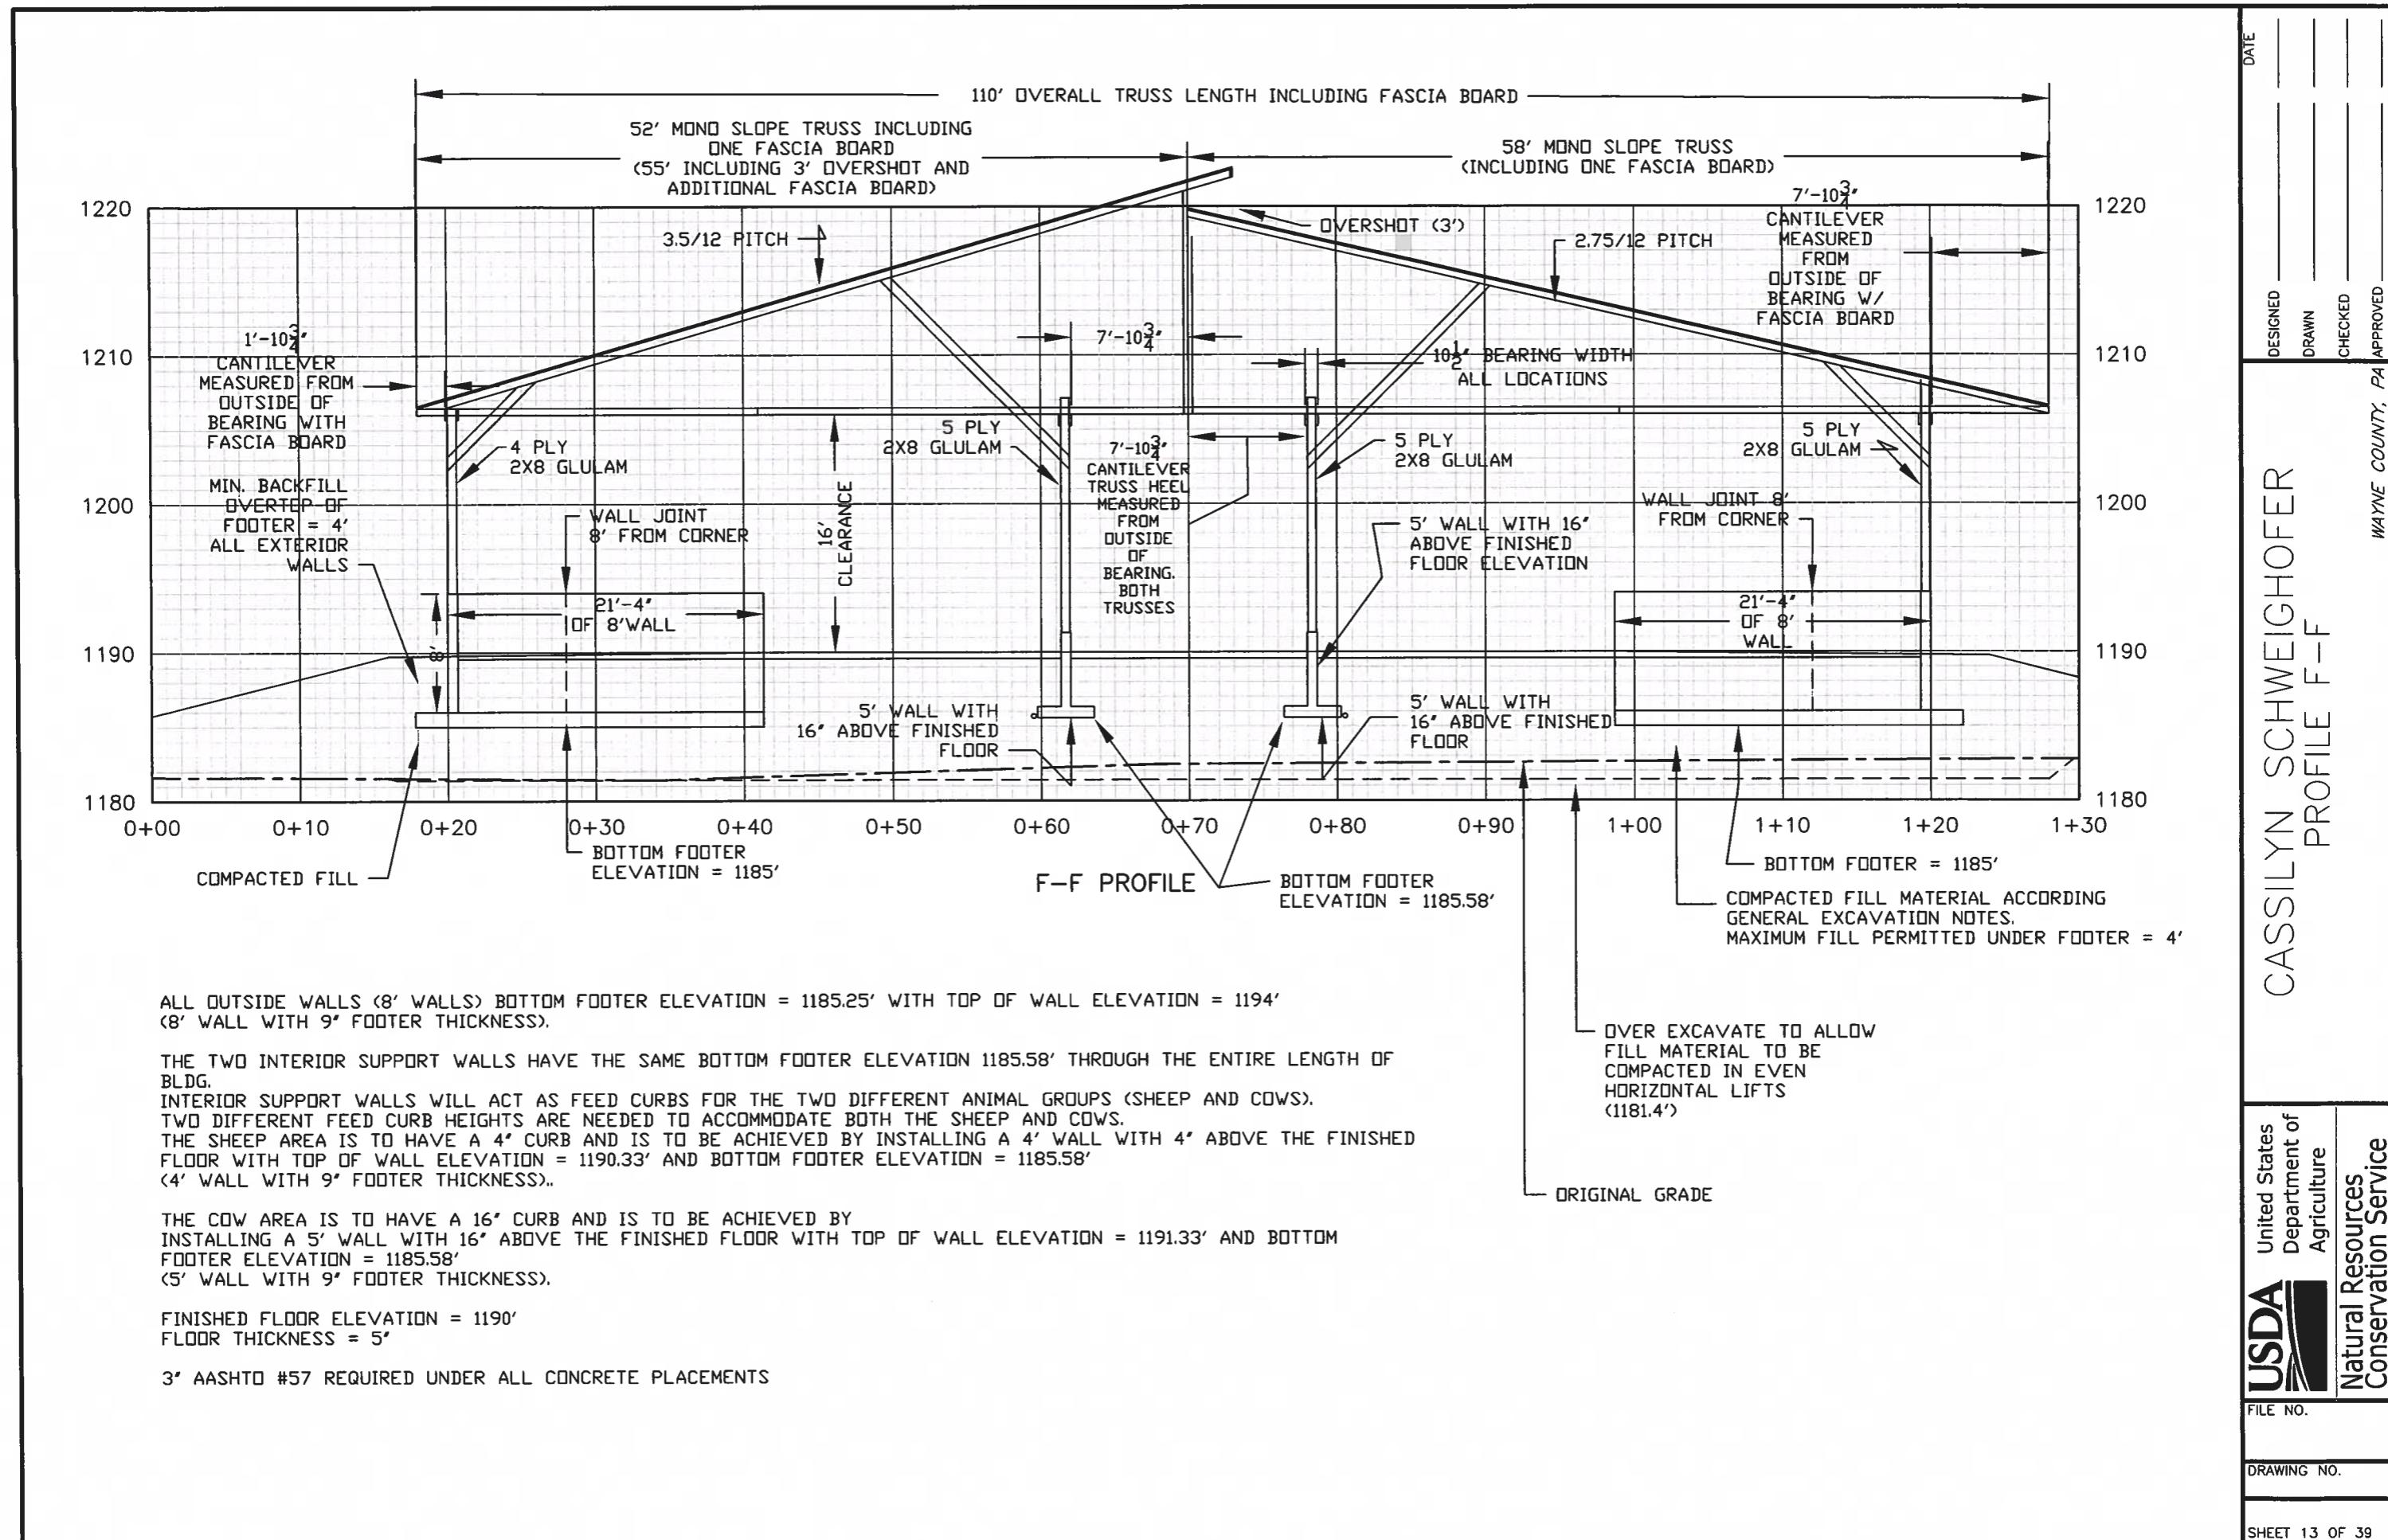

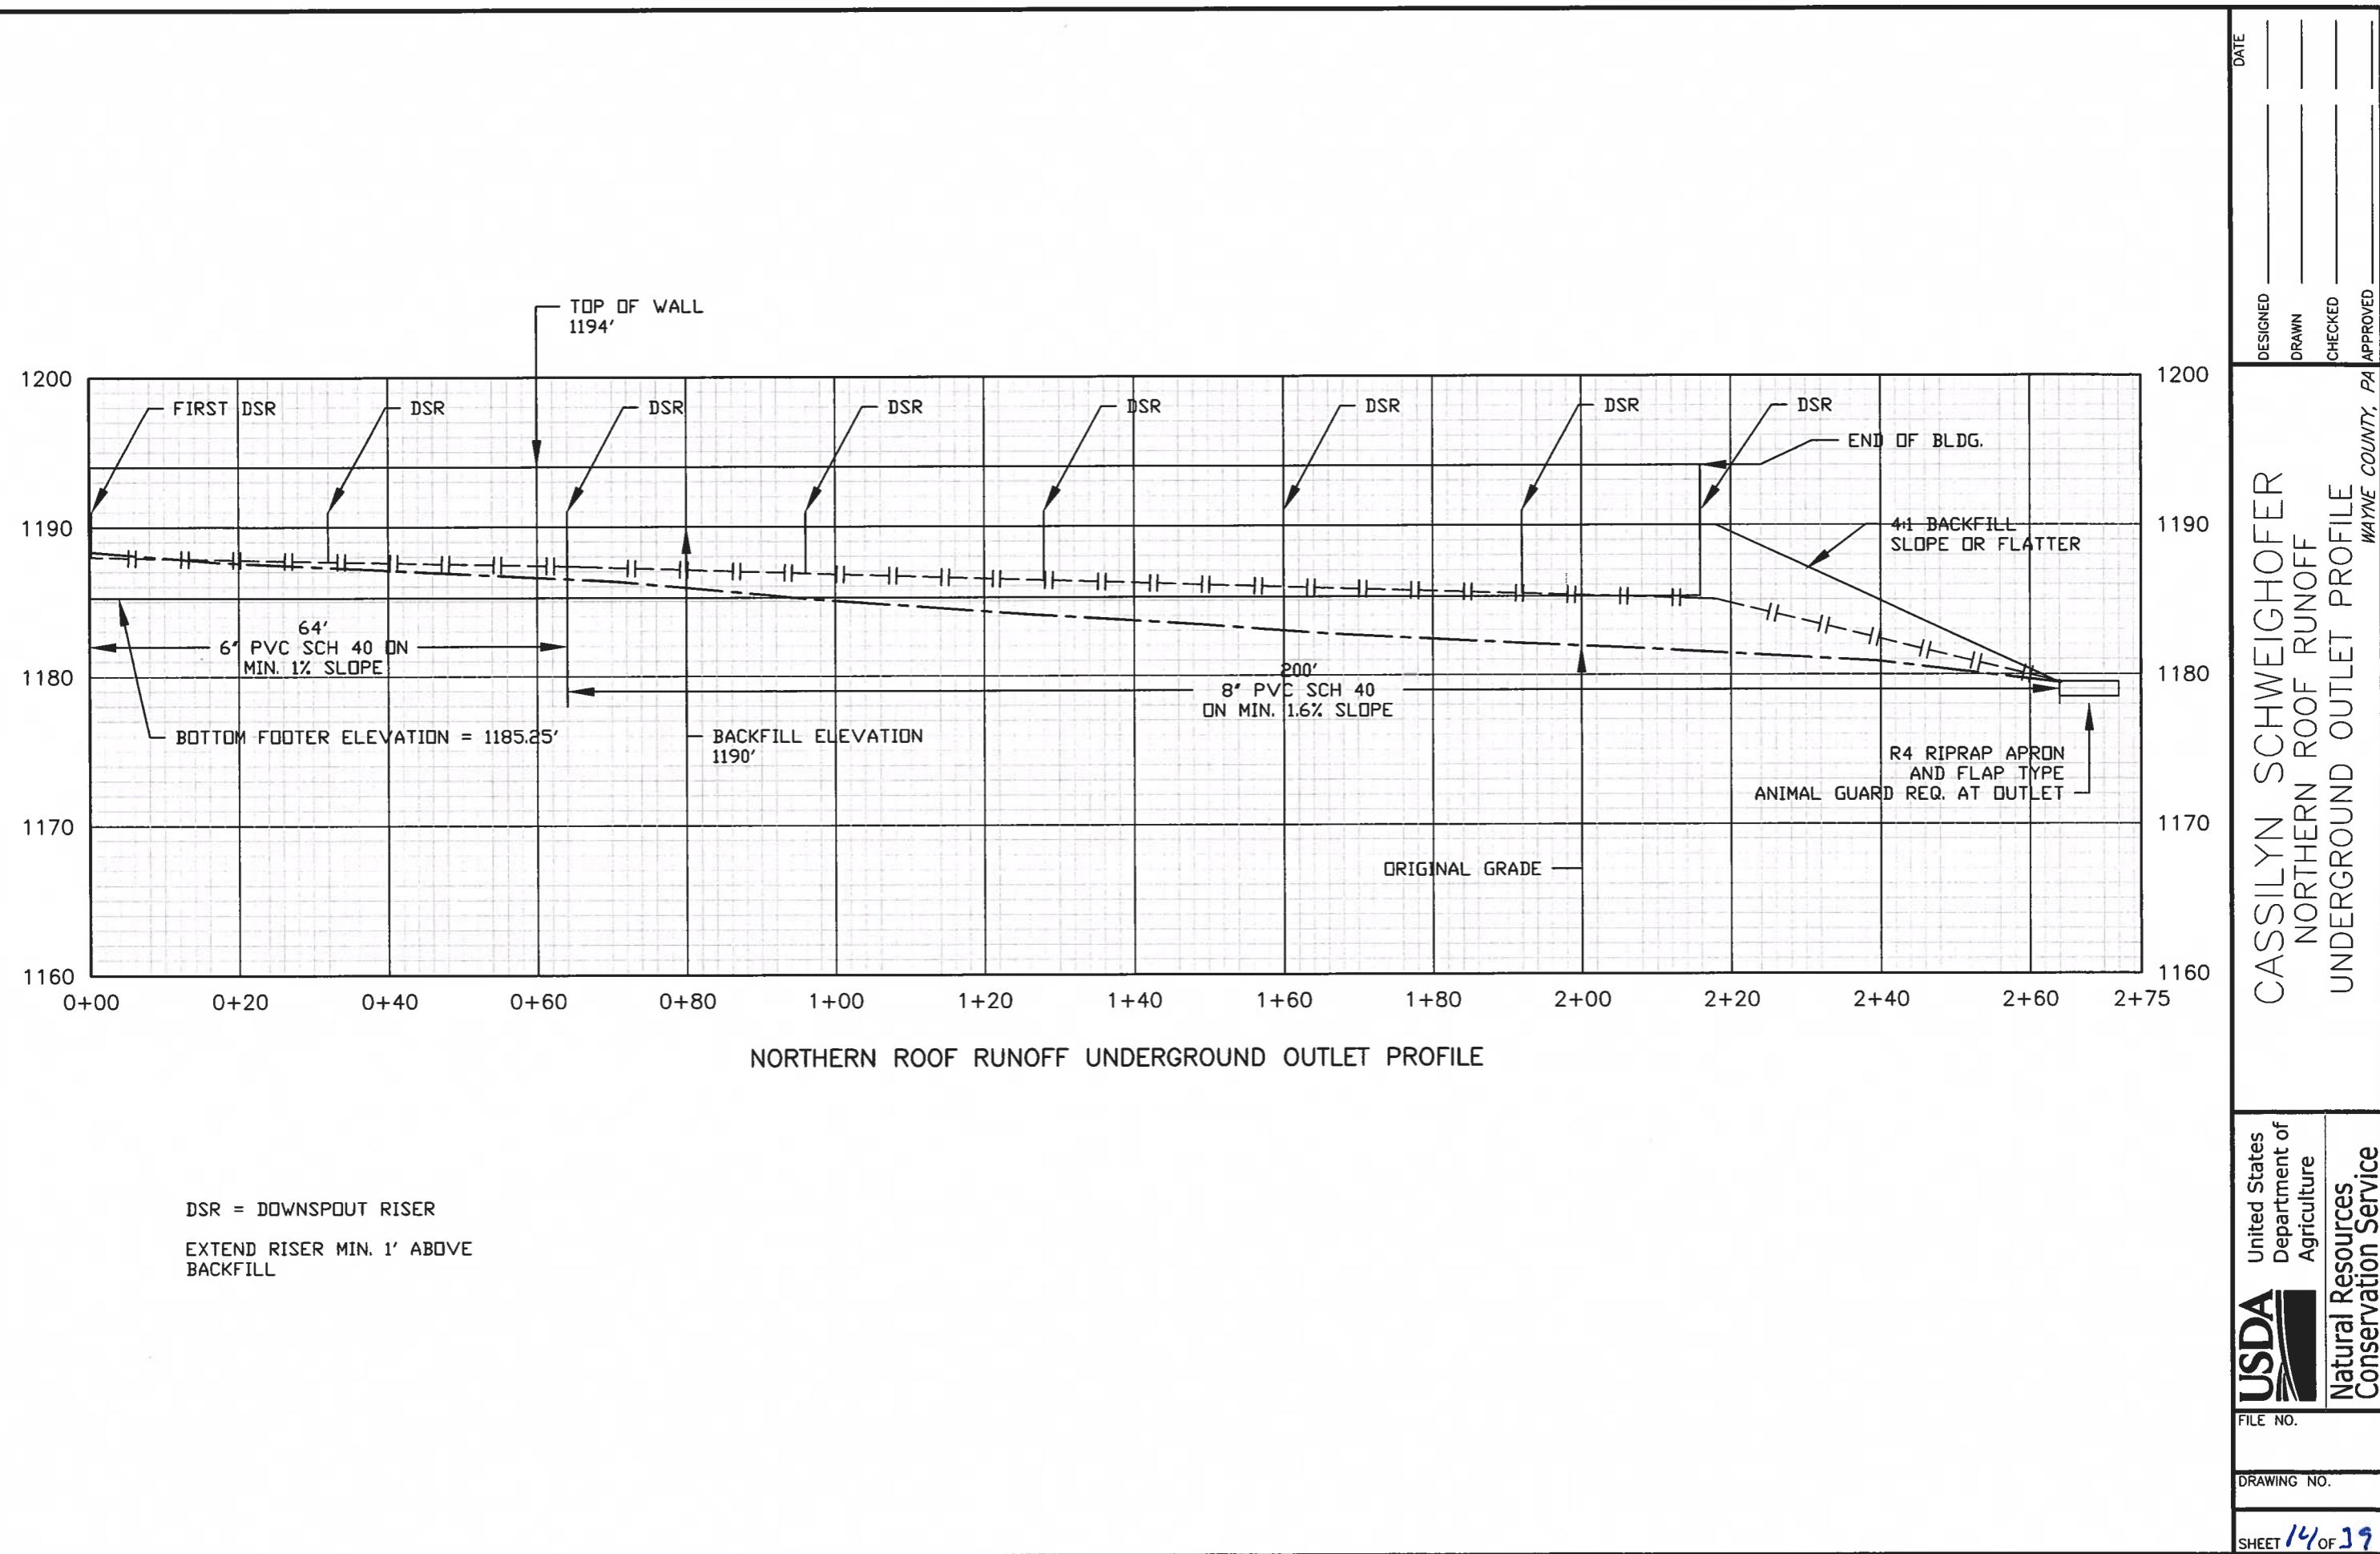

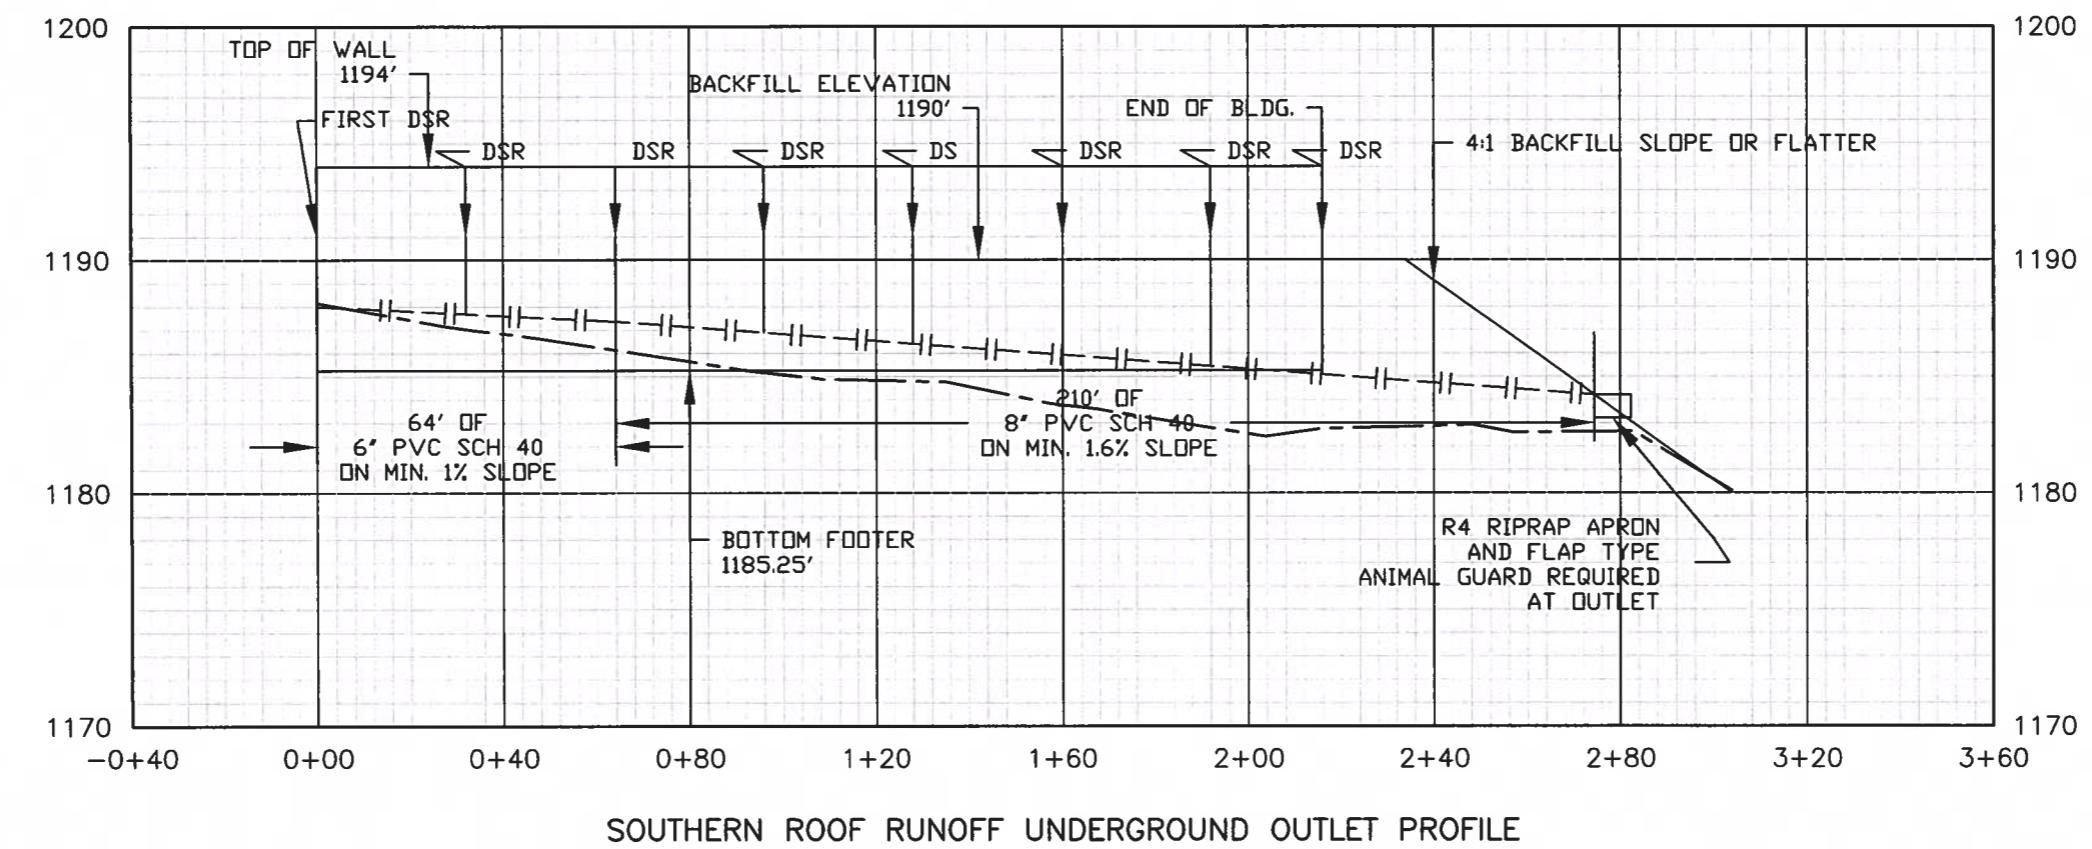

DATE \_\_\_\_\_  
 DESIGNED \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 CHECKED \_\_\_\_\_  
 APPROVED \_\_\_\_\_


CASSILYN SCHWEIGHOFER  
 SOUTHERN ROOF RUNOFF  
 UNDERGROUND OUTLET PROFILE  
 WAYNE COUNTY, PA

United States Department of Agriculture  
 Natural Resources Conservation Service

FILE NO. \_\_\_\_\_



DRAWING NO. \_\_\_\_\_

SHEET 15 OF 19

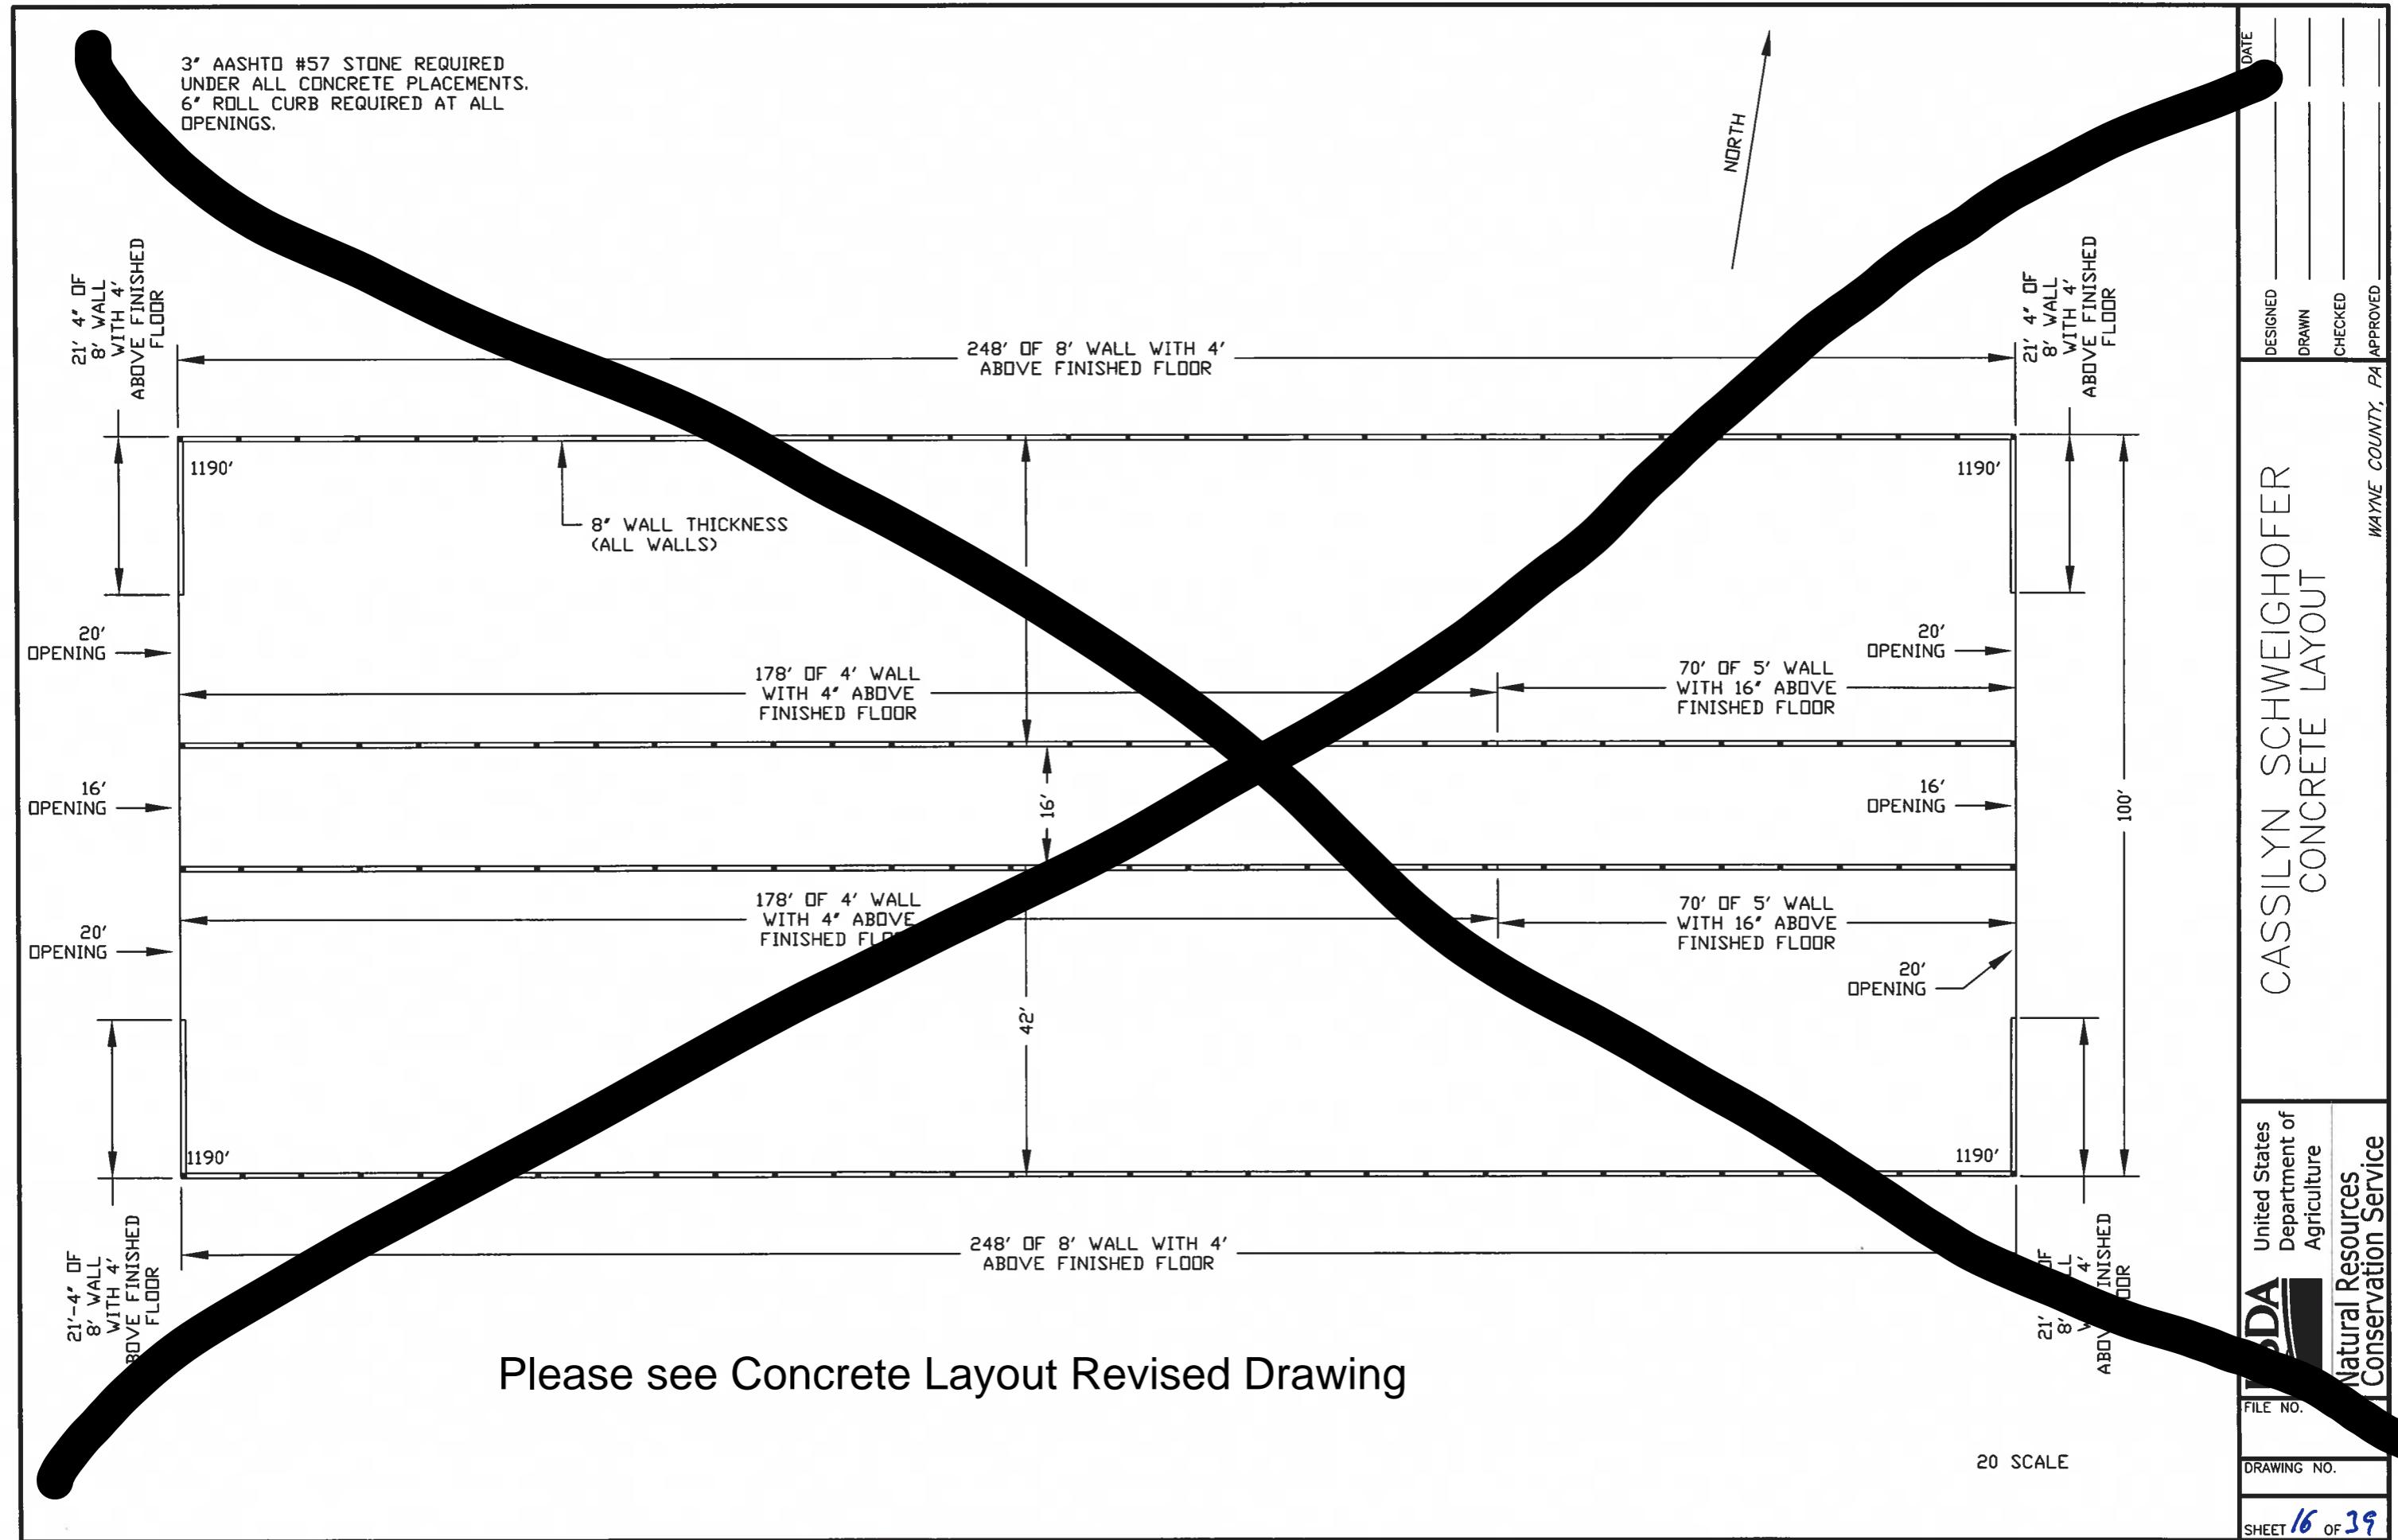

- - - = FLOOR JOINT  
 ▽ = WALL JOINT.  
 ALL CONCRETE JOINTS INTERSECTING WITH A WALL ARE TO EXTEND OVER  
 TOP THE WALL

FOOTER AND WALLS TO BE PLACED BEFORE  
 FLOOR PLACEMENT. WHERE FLOOR MEETS  
 WALLS AN ISOLATION JOINT IS REQUIRED.

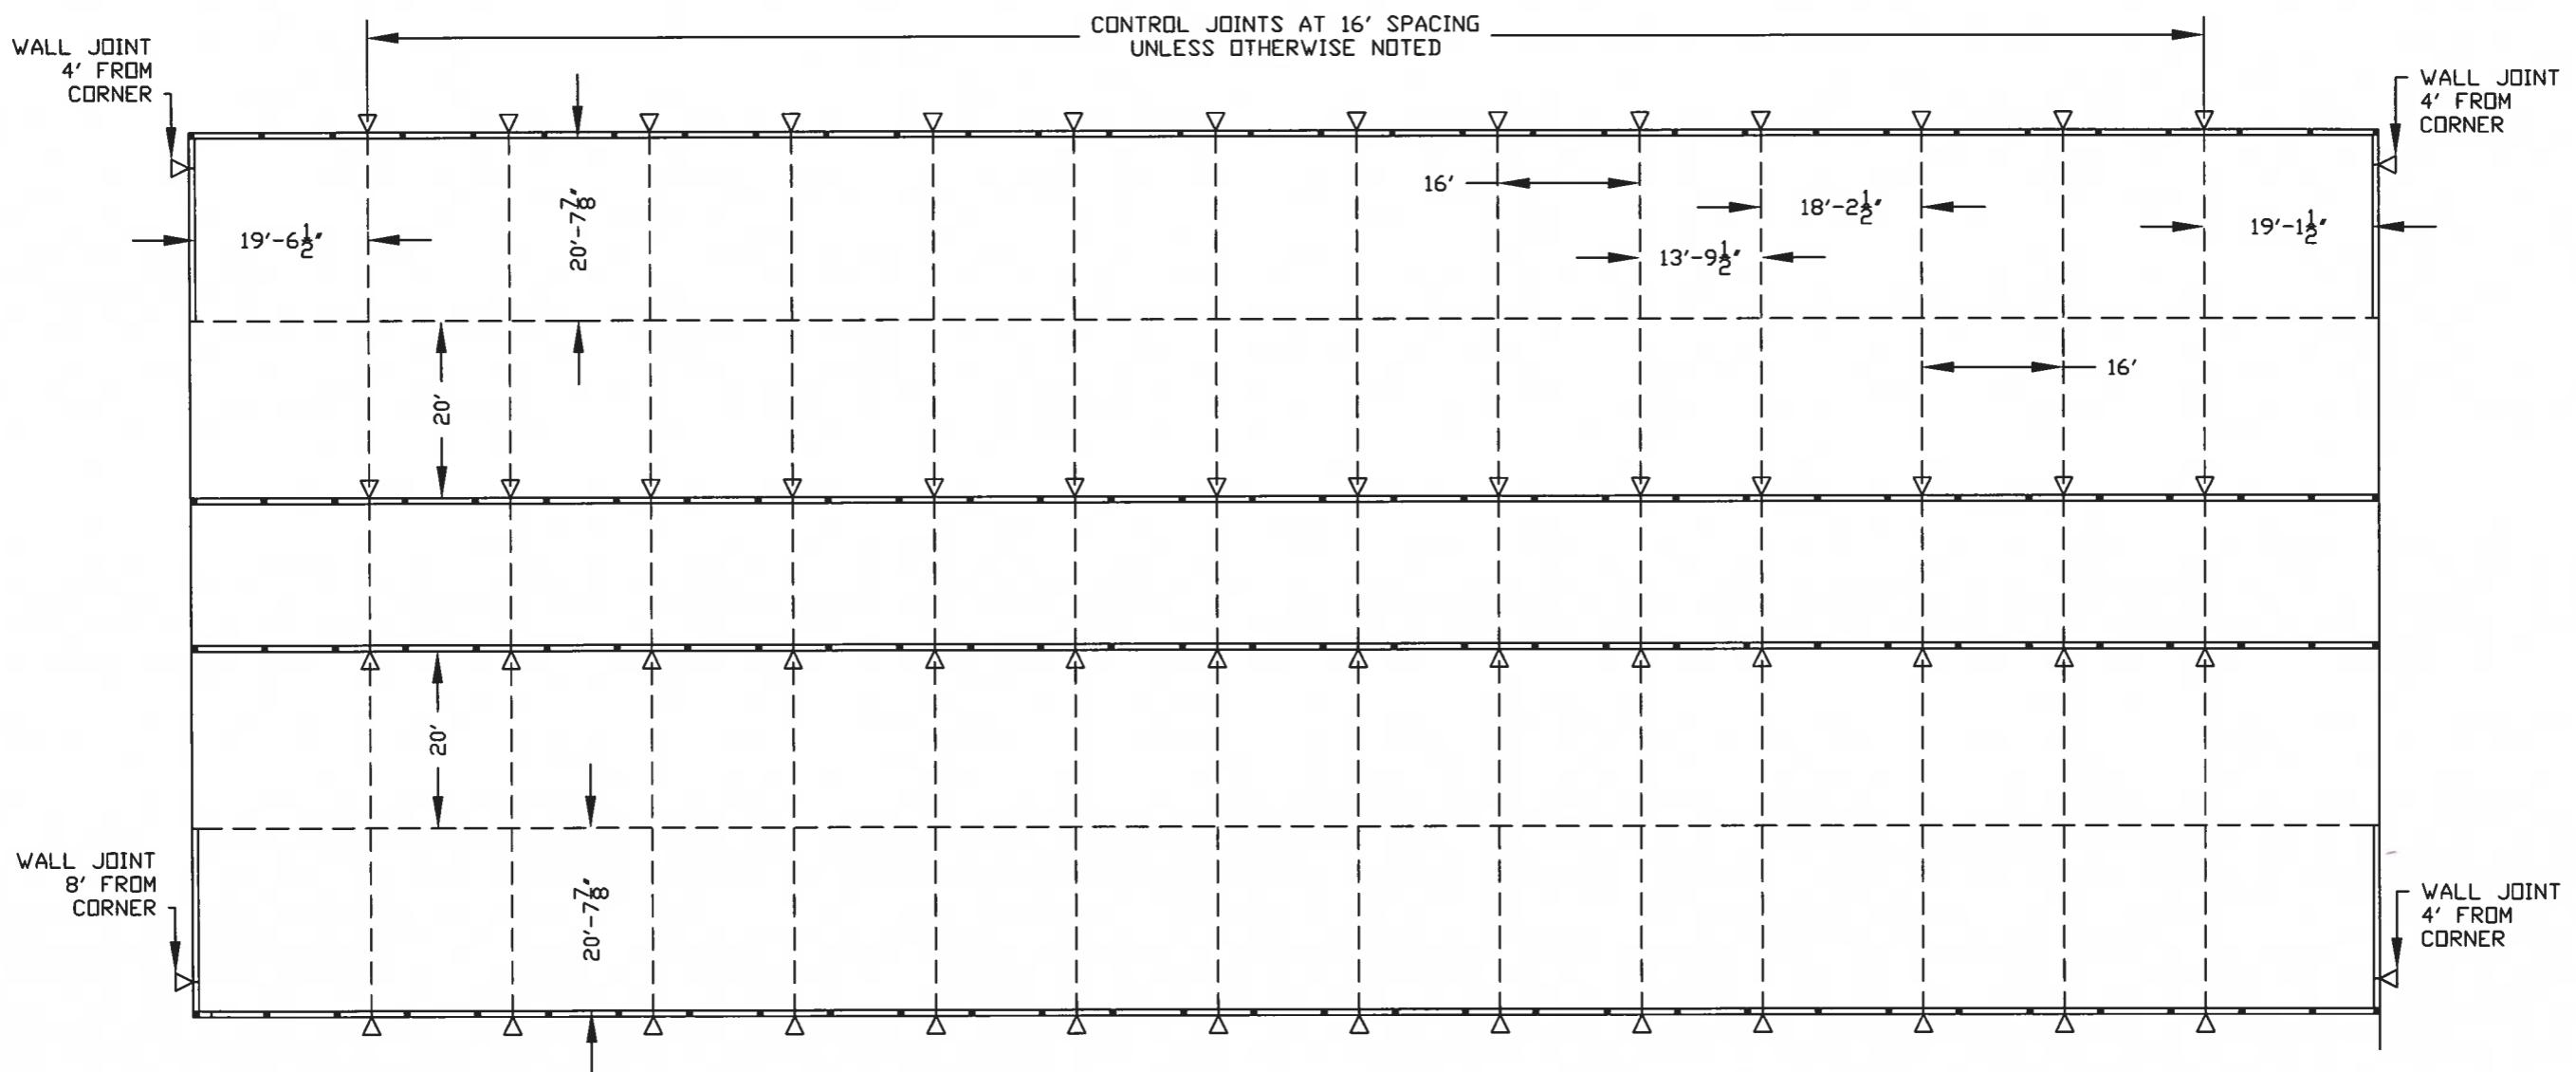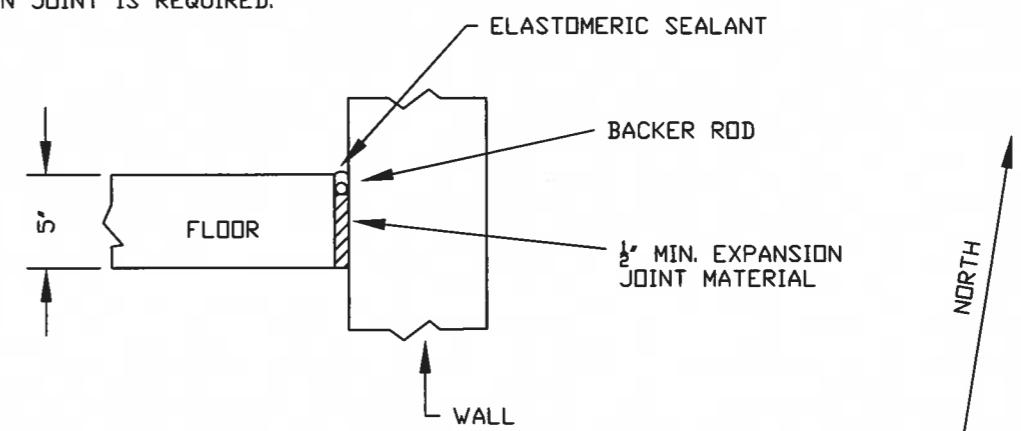

20 SCALE

USDA	United States Department of Agriculture	CASSILYN SCHWEIGHOFER	DESIGNED _____
	Natural Resources Conservation Service	CONCRETE CONTROL JOINT LAYOUT	DRAWN _____
			CHECKED _____
			APPROVED _____
		WAYNE COUNTY, PA	


FILE NO. \_\_\_\_\_

DRAWING NO. \_\_\_\_\_

SHEET 17 OF 39


SPLY AND 4PLY 2X8 GLULAM POST ARE REQUIRED AS SHOWN BELOW.  
 ALL POSTS ARE 8' O.C. UNLESS OTHERWISE SHOWN.  
 5PLY POST ARE TO BE ATTACHED TO TOP OF WALL USING STURDI WALL SW85GL SERIES BRACKETS.  
 4PLY POST ARE TO BE ATTACHED TO TOP OF WALL USING STURDI WALL SW84GL SERIES BRACKETS.  
 CORNER POSTS TO BE ATTACHED TO TOP OF WALL USING A COMBINATION OF (1) SW80 UNIVERSAL  
 AND (1) SW64 CORNER SERIES BRACKETS.  
 ONLY SIDES LABELED AS ENCLOSED ARE PERMITTED TO BE ENCLOSED. ALL OTHER SIDES ARE REMAIN  
 OPEN.  
4PLY 2X6 GLULAM POSTS ARE PERMITTED FOR USE ON THE ENCLOSED GABLE END ONLY. GABLE END  
 POSTS EXTEND TO TOP CORD OF TRUSS.

ENCLOSED (STEEL) SIDE.  
 INSTALL SPF #1/#2 GIRTS @ 18" SPACING.  
 DUE TO GIRTS WYE AND K BRACING IS NOT REQUIRED.

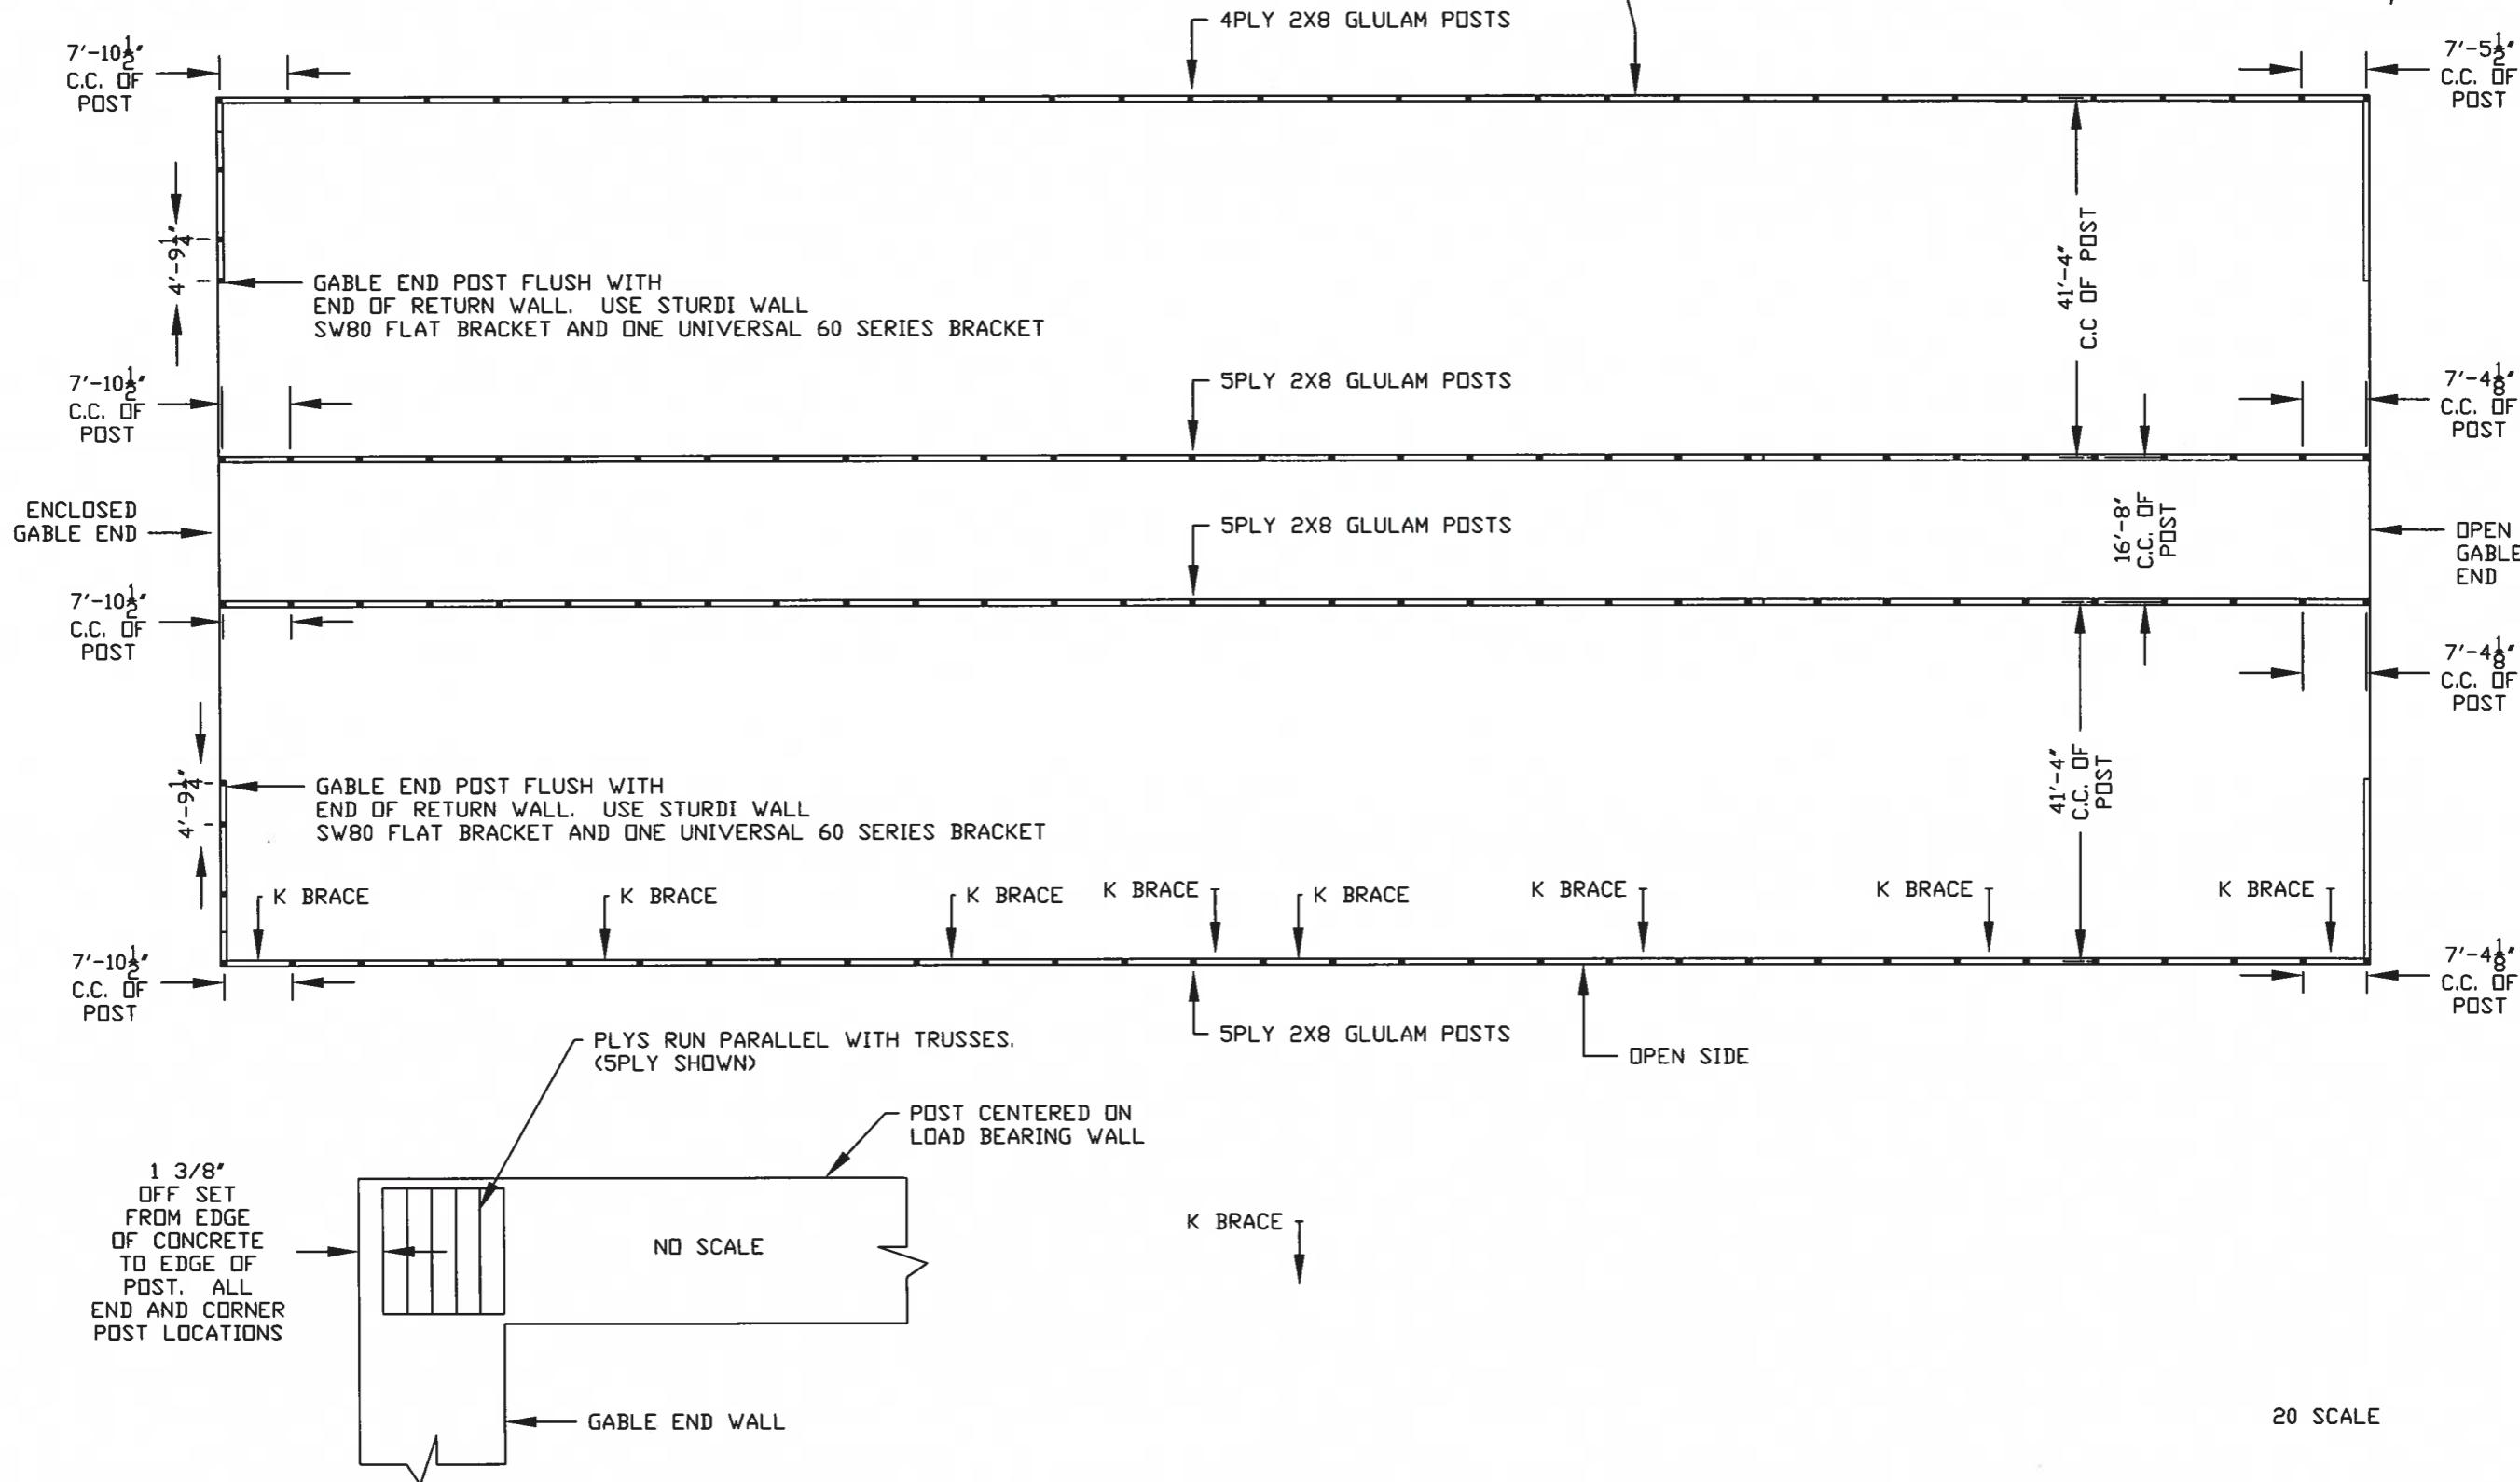

DESIGNED	DRAWN	CHECKED	APPROVED
WAYNE COUNTY, PA			
CASSILYN SCHWEIGHOFER POST LAYOUT			
United States Department of Agriculture			
Natural Resources Conservation Service			
USDA			
FILE NO. _____			
DRAWING NO. _____			
SHEET 18 OF 39			

OVERALL ROOF WIDTH TO BE ACHIEVED BY INSTALLING BACK TO BACK MONO SLOPE TRUSSES.  
ALL TRUSSES 4' O.C. UNLESS OTHERWISE NOTED.  
ALL GIRDERS = 1  $\frac{3}{4}$ " X 9  $\frac{1}{2}$ " 2.0E LVL'S ATTACHED TO EACH SIDE OF POST AND SUPPORTED  
WITH BEARING BLOCKS. LVL'S REQUIRE LATERAL SUPPORT BLOCKING EVERY 2'.

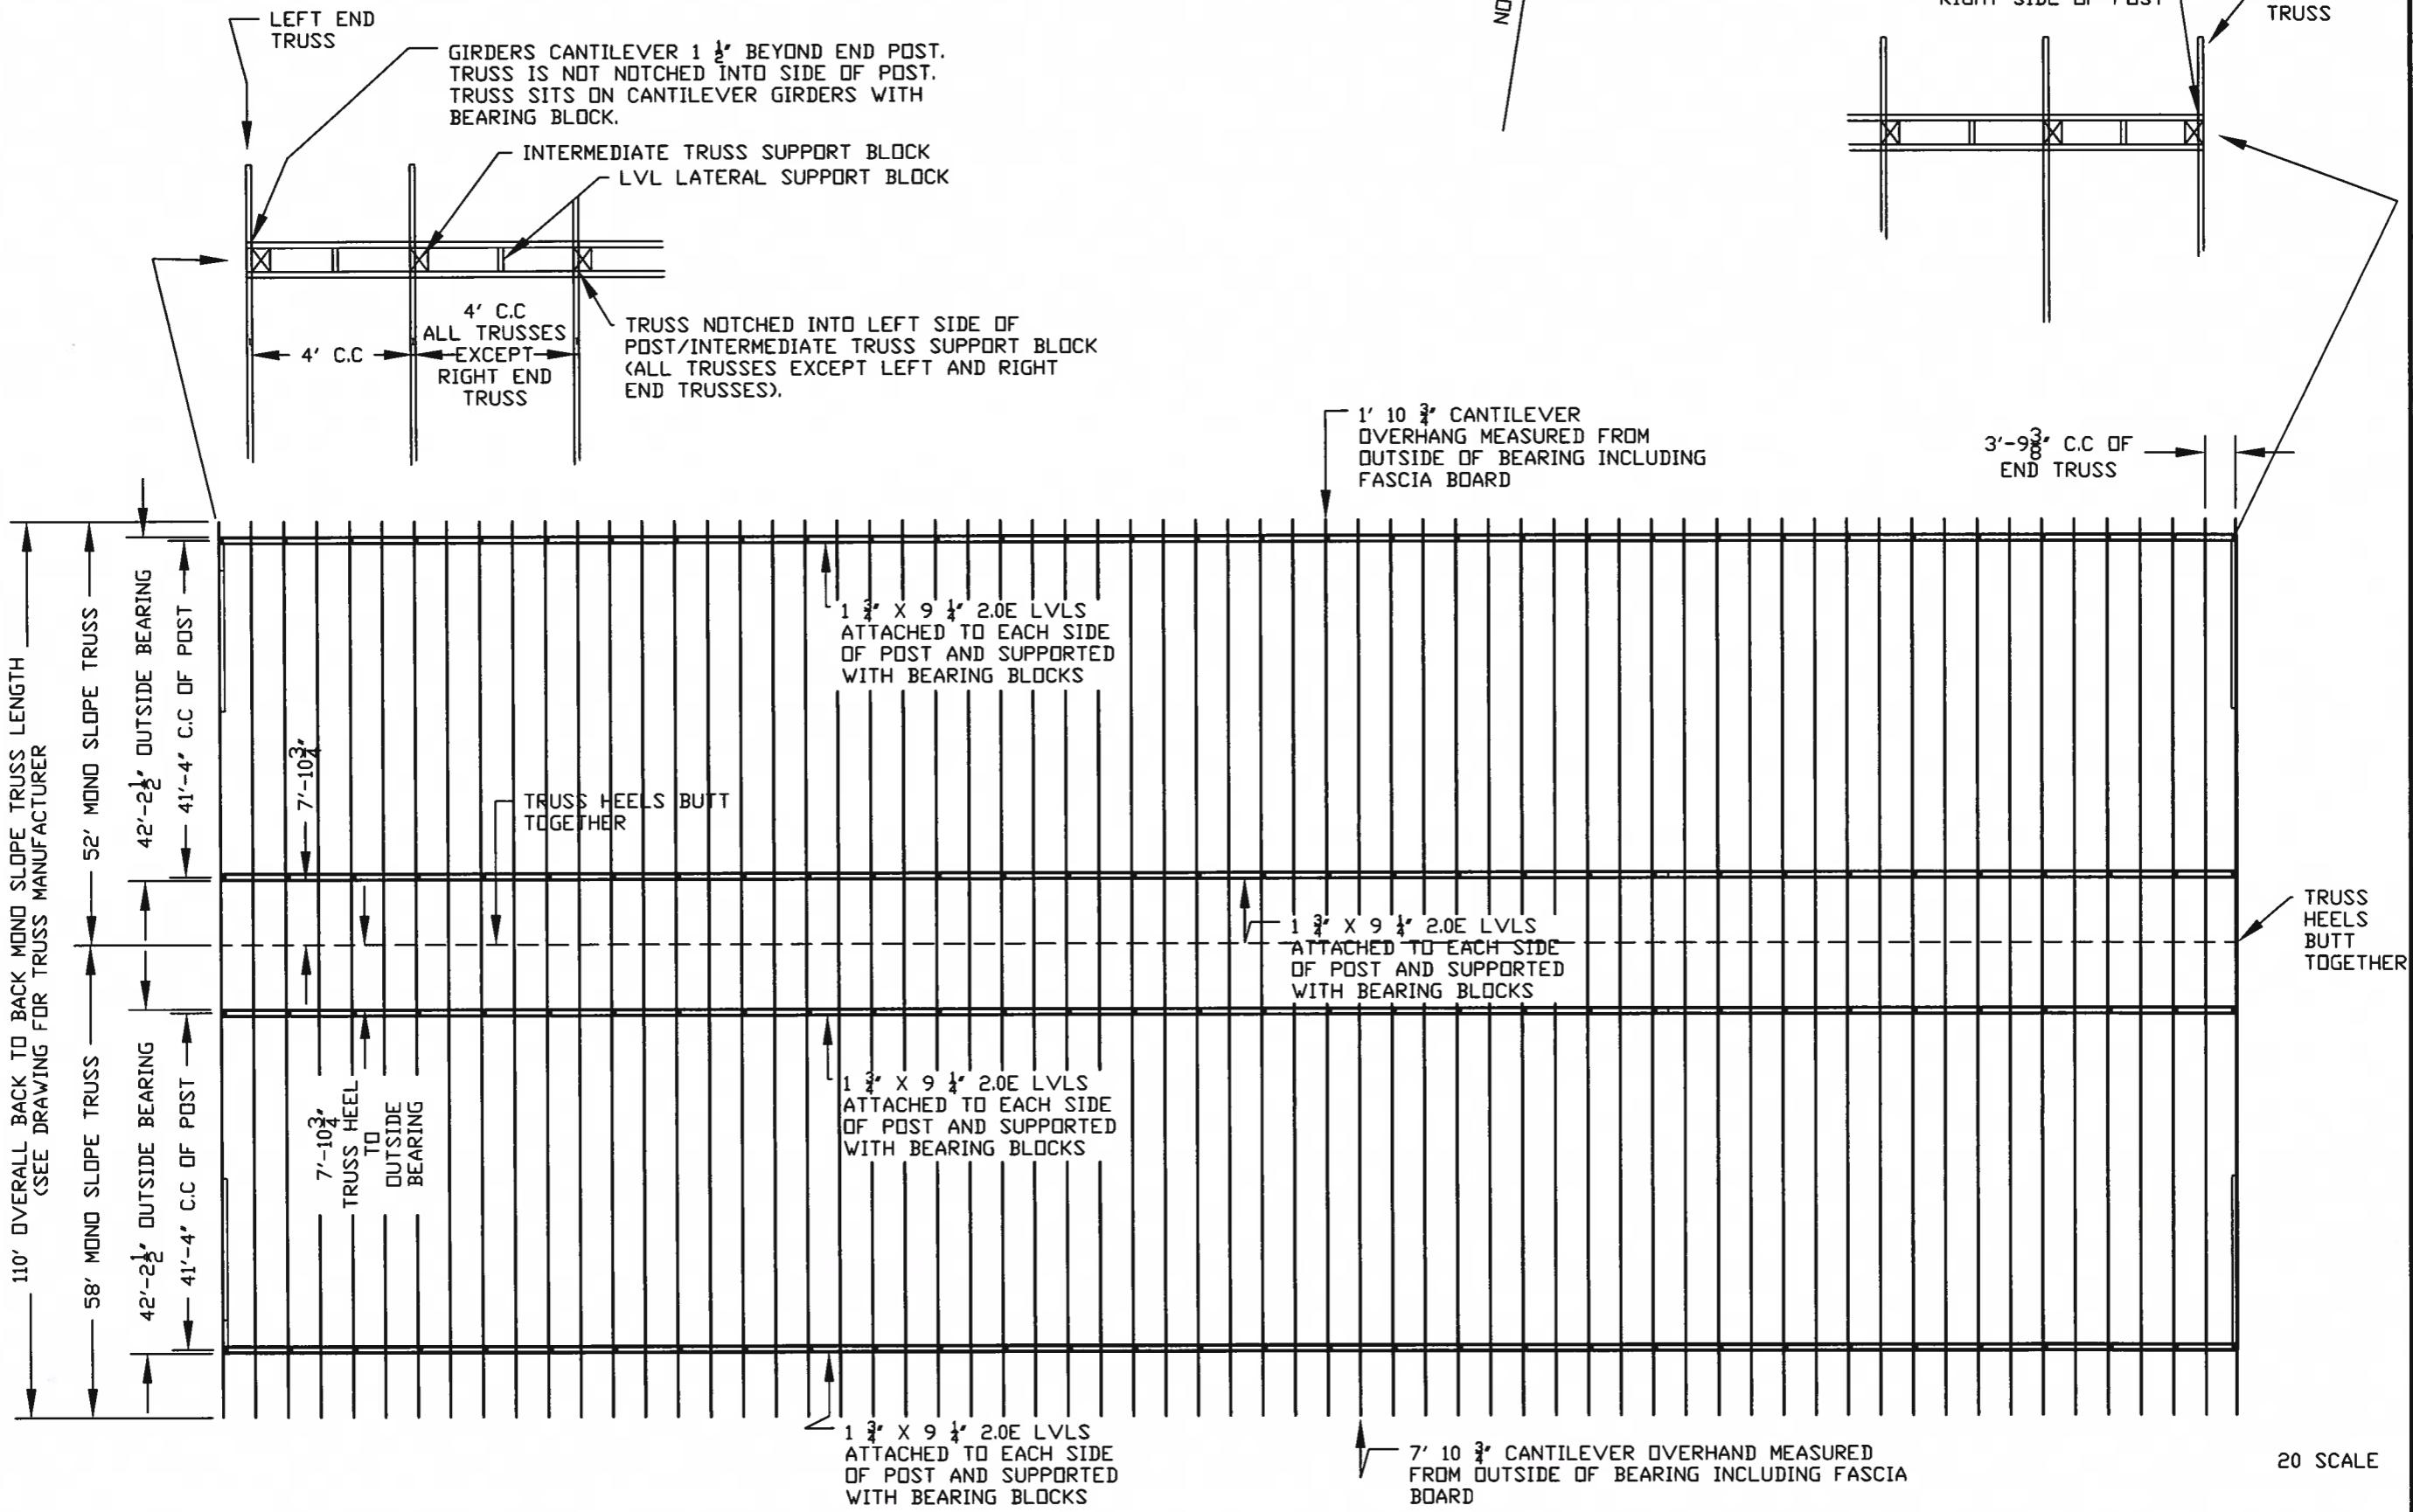

CHECKED


## Natural Resources

1

1

10


DF 39

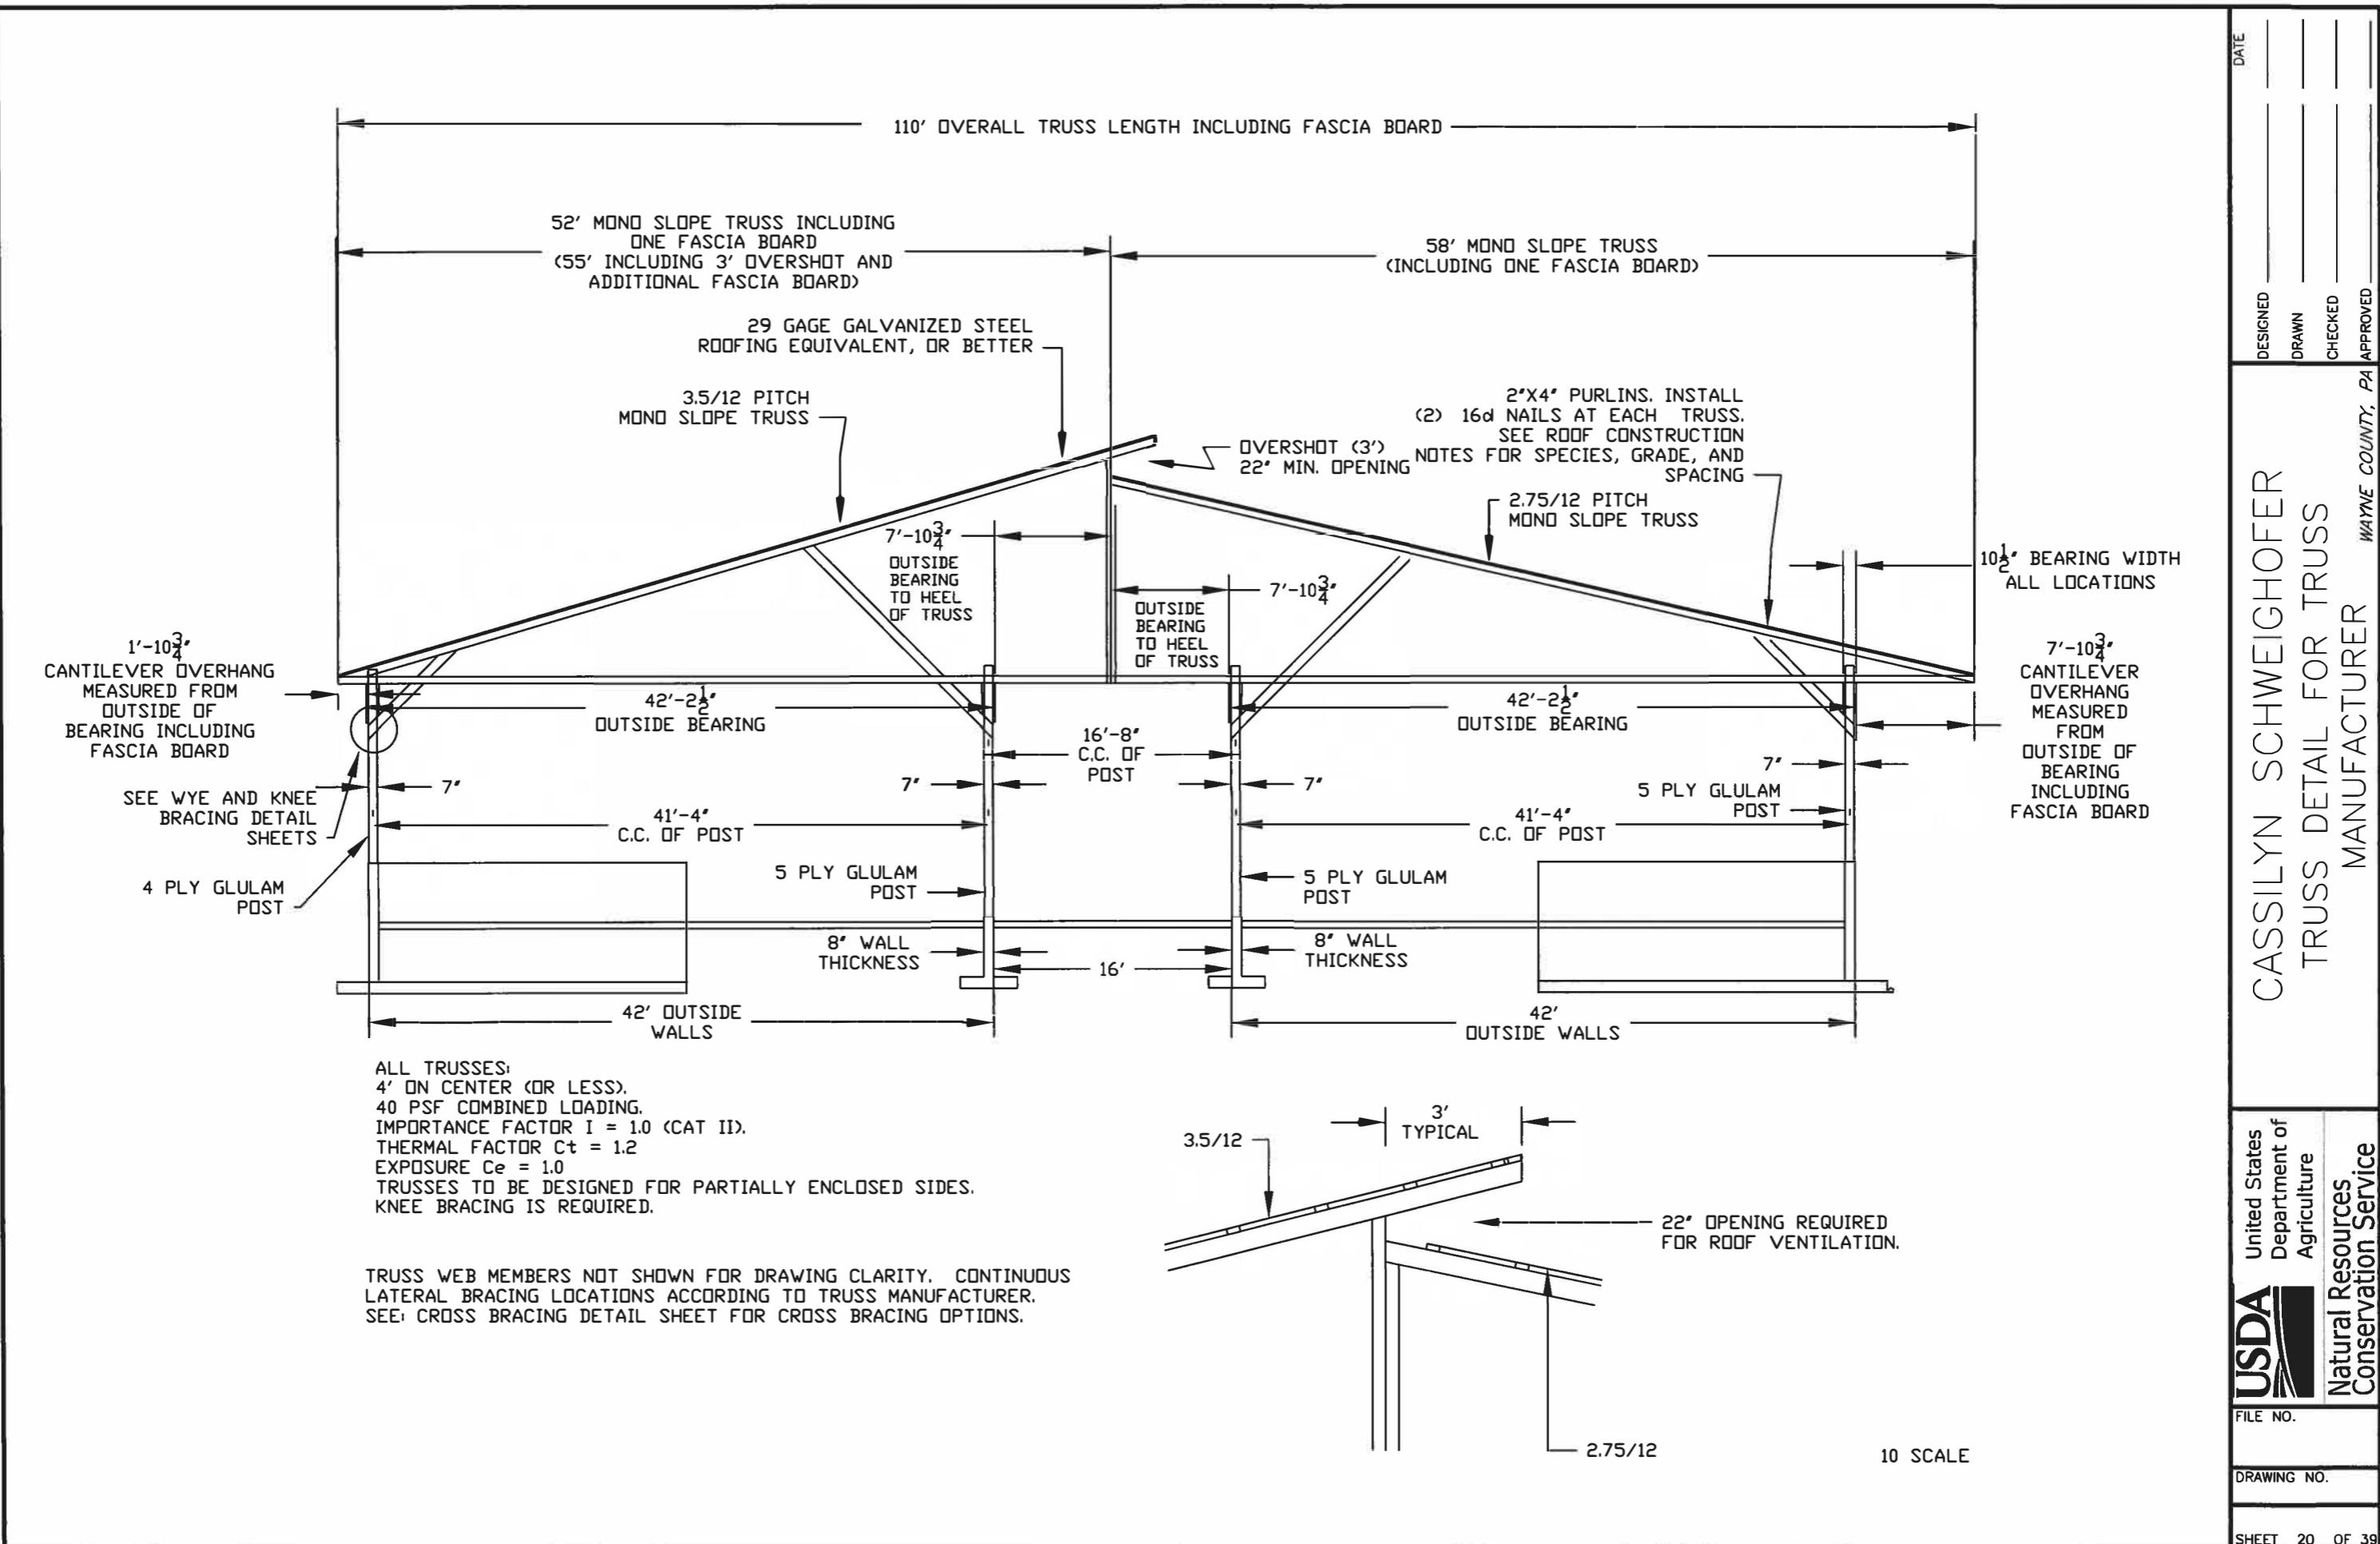

# FASTENER REQUIREMENTS AT GIRDER & POST CONNECTIONS



DATE \_\_\_\_\_  
 DESIGNED \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 CHECKED \_\_\_\_\_

CASSILYN SCHWEIGHOFER  
 FASTENER REQUIREMENTS AT  
 GIRDER TO POST CONNECTION

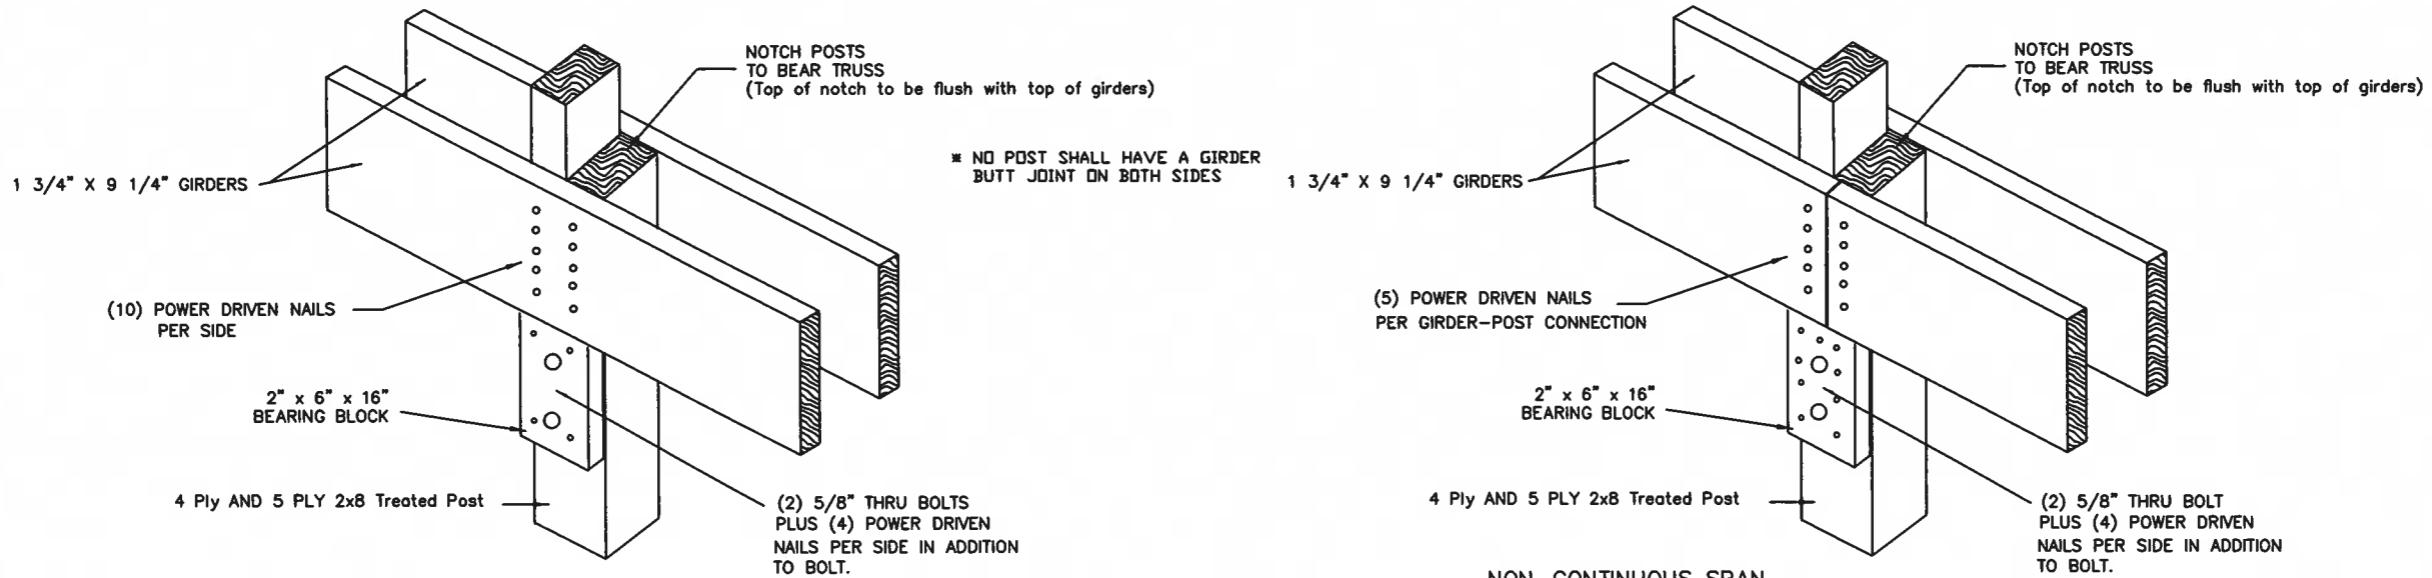


## CONTINUOUS SPAN

## OPTIONS FOR TRUSS CONNECTION BETWEEN POSTS

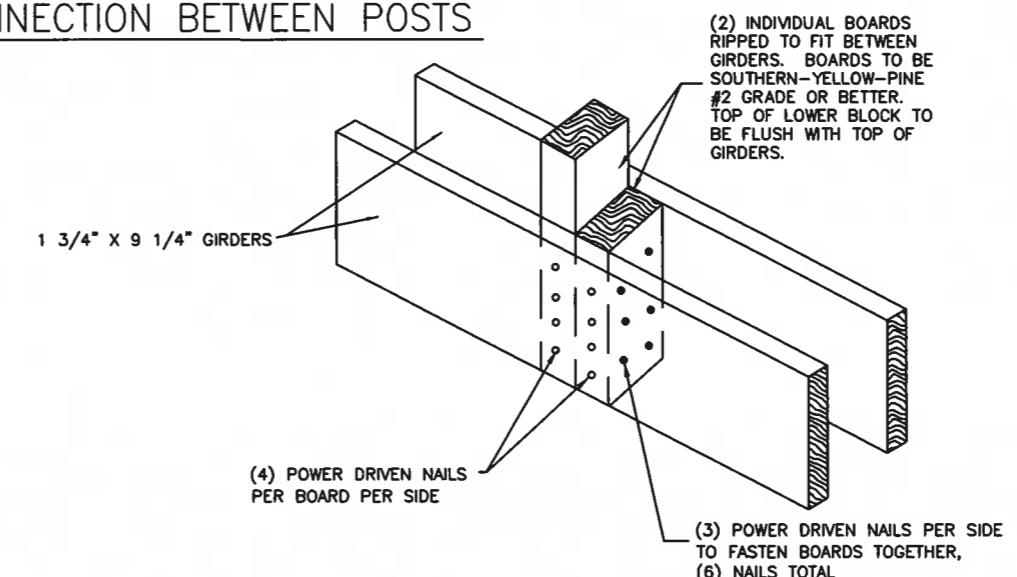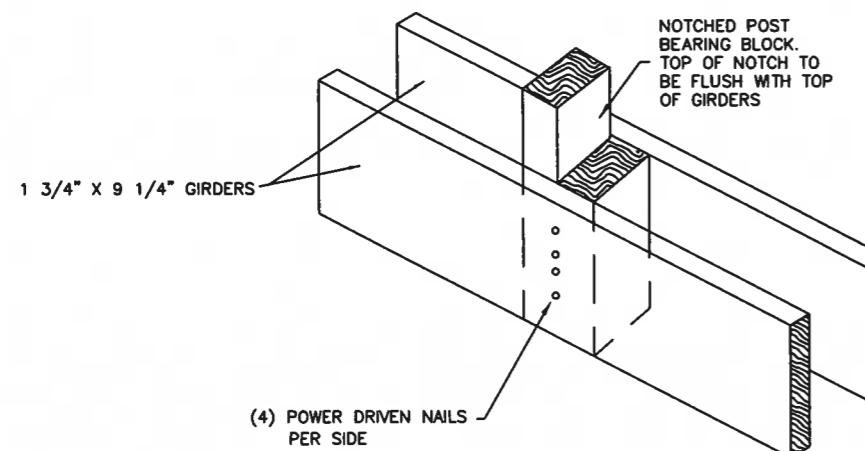

## CONSTRUCTION NOTES

1. Bolts shall be installed in the middle of the girder and support block.
2. All nails shall be galvanized, ring shank .131" Diameter x 3.25" Long (Min.).
3. LVL's need to be supported every 2' as per the LVL Manufacturer; A single block, ripped to fit, between the LVL's will suffice. Install (4) power driven nails per side from LVL into the blocking.

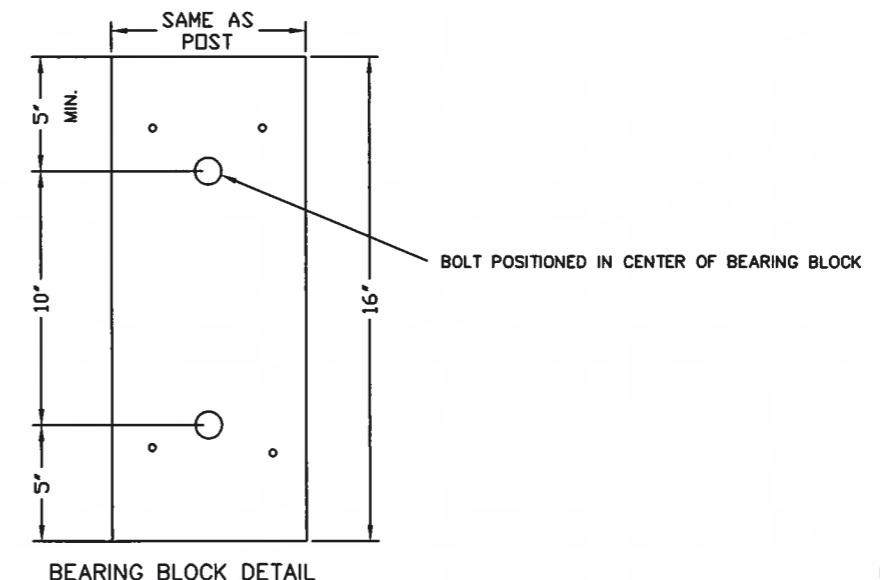

NO SCALE

United States  
 Department of  
 Agriculture  
 USDA


Natural Resources  
 FILE NO. \_\_\_\_\_  
 DRAWING NO. \_\_\_\_\_

SHEET 210F 39

# FASTENER REQUIREMENTS

WAYNE COUNTY, PENNSYLVANIA

Designed	B70 STD DRAWING	Date	4/2022
Drawn	RGD	Drawn	4/2022
Checked	RGD	Checked	4/2022
Approved	RGD	Approved	4/2022

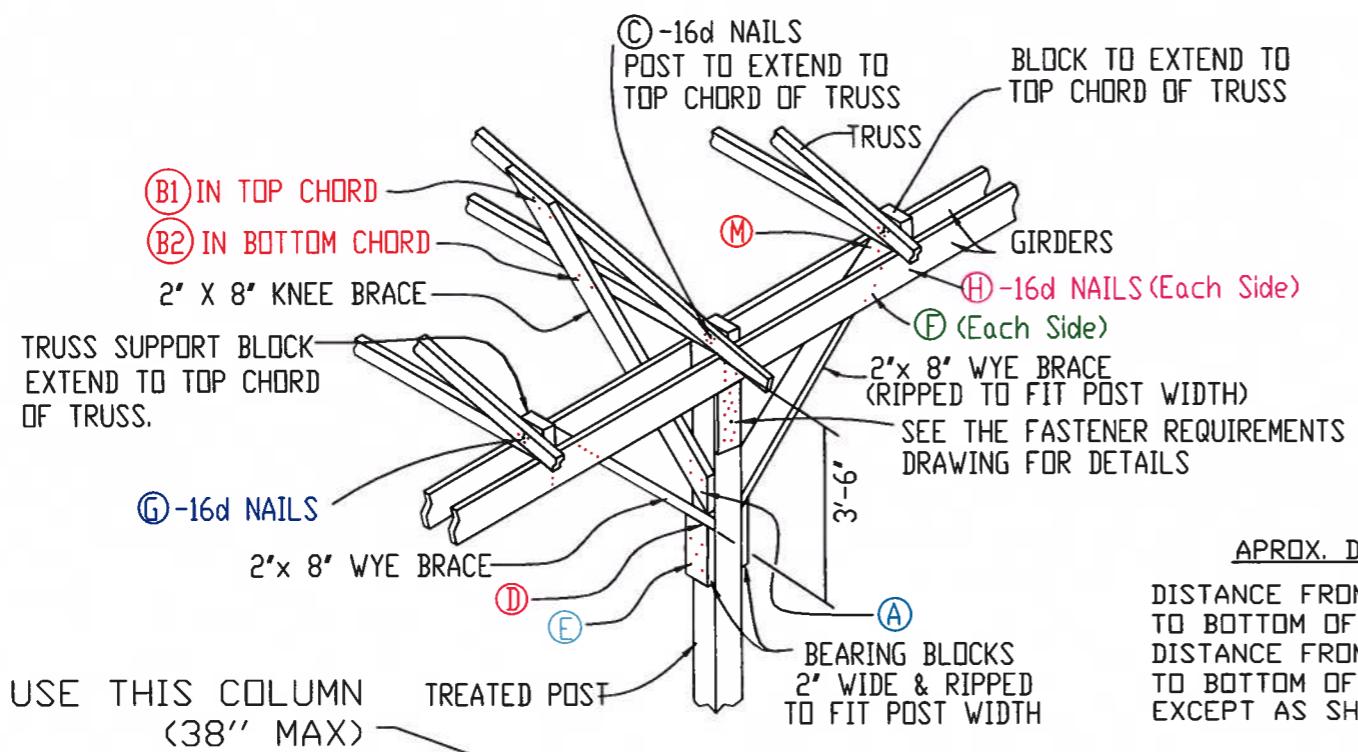


USE THIS COLUMN  
(38" MAX)

TREATED POST

TABLE 1

*NUMBER OF NAILS REQUIRED			
BASED ON THE 'LENGTH' OF ROOF CONTRIBUTING TO THAT CONNECTION			
JOINT	22.5' MAX (TRIBUTARY LENGTH)	27.5' MAX (TRIBUTARY LENGTH)	38' MAX (TRIBUTARY LENGTH)
SCREWS	A	SEE KNEE BRACE DETAILS DRAWING	
SCREWS	B1 & B2	SEE KNEE BRACE DETAILS DRAWING	
Power Driven 16d *See Note #5*	C	7	8
SCREWS	D	SEE WYE BRACE DETAILS DRAWING	
SCREWS	E	SEE WYE BRACE DETAILS DRAWING	
SCREWS	F	SEE WYE BRACE DETAILS DRAWING	
Power Driven 16d *See Note #5*	G	7	8
Power Driven 16d *See Note #3*	H	4	4
SCREWS	I	SEE KNEE BRACE DETAILS DRAWING	
SCREWS	J	SEE KNEE BRACE DETAILS DRAWING	
SCREWS	K1 & K2	SEE KNEE BRACE DETAILS DRAWING	
Power Driven 16d	L	6	7
SCREWS	M	SEE WYE BRACE DETAILS DRAWING	

GIRDER SUPPORT BLOCK IS REQUIRED  
BUT NOT SHOWN, FOR DRAWING CLARITY.

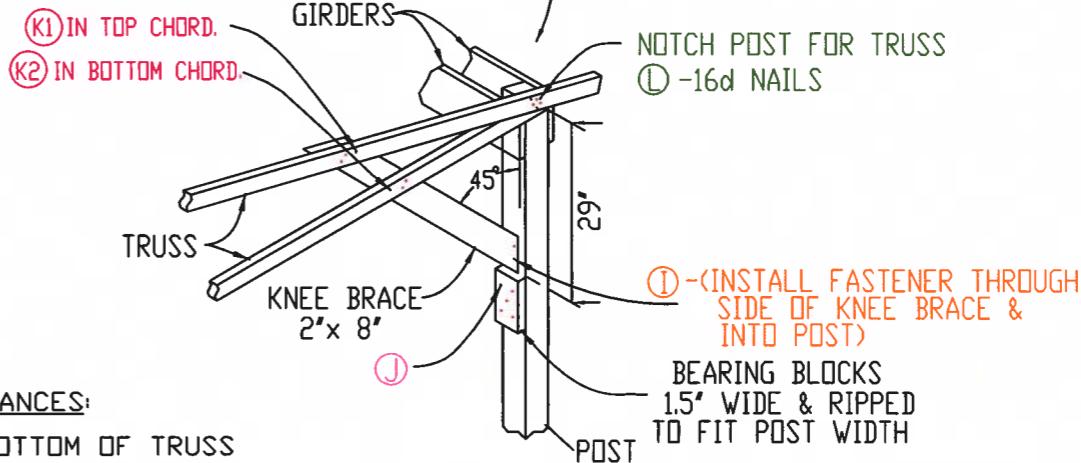

## APROX. DISTANCES:

DISTANCE FROM BOTTOM OF TRUSS  
TO BOTTOM OF WYE BRACE = 42"  
DISTANCE FROM BOTTOM OF TRUSS  
TO BOTTOM OF KNEE BRACE = 36",  
EXCEPT AS SHOWN ON END POSTS.

## BRACING DETAIL

- \* KNEE BRACE SHALL BE ATTACHED TO SIDE OF POST BUT CAN BE ATTACHED AS SHOWN ON END POST ONLY.


## NOTES:

1. POSTS SHALL BE NOTCHED TO ACCOMMODATE TRUSSES. THE NOTCH SHALL BE CUT FLUSH WITH THE TOP OF THE GIRDER SO THE TRUSSES SIT ON THE NOTCH AND ON TOP OF BOTH GIRDERS EQUALLY. ONLY NOTCH THE POST 1.5" FOR THE TRUSS.  
NOTCH THE SIDE OF THE POST, NOT THE CENTER.
2. THE TRUSS SUPPORT BLOCKS AT LOCATIONS BETWEEN POSTS CAN BE NOTCHED SECTIONS OF POSTS OR 2X BOARDS. NOTCHES SHALL BE CUT AND THE BLOCK POSITIONED IN THE SAME FASHION AS THE NOTCHES IN THE POSTS (DESCRIBED ABOVE).
3. JOINT H; IF TWO BOARDS ARE USED INSTEAD OF A POST SECTION THEN EACH BOARD SHALL HAVE (4) NAILS PER SIDE. THE BOARDS SHALL ALSO BE NAILED TOGETHER WITH (6) NAILS.  
ALL NAILS FOR THIS CONNECTION CAN BE POWER DRIVEN 16D.  
ALL BLOCKS SHALL BE SOUTHERN YELLOW PINE #2.
4. HURRICANE (TIE DOWN) STRAPS CAN ALSO BE USED TO ANCHOR TRUSSES TO GIRDERS. THERE SHALL BE A STRAP(S) INSTALLED TO ANCHOR THE TRUSSES TO EACH GIRDER. IF THIS OPTION IS CHOSEN, DISCUSS WITH THE DESIGN ENGINEER IN ADVANCE.
5. JOINT C & G: THE AMOUNT OF NAILS LISTED CAN BE DISTRIBUTED BETWEEN BOTH TRUSS CHORDS.
6. THE WYE AND KNEE BRACES SHALL BE INSTALLED AT A 45 DEGREE ANGLE FROM THE TREATED POST.  
INSTALL THE WYE BRACES AFTER THE TRUSSES ARE SET.
7. DRILL PILOT HOLES AS NEEDED TO PREVENT SPLITTING. SCREWS IN SPLIT HOLES DO NOT COUNT TOWARD CONNECTION.
8. NAILS IN CONTACT WITH PRESSURE-TREATED WOOD SHALL BE GALVANIZED.
- THE 16d POWER DRIVEN NAILS ARE BASED ON 0.131 DIAMETER X 3.25" LONG (GALVANIZED OR STAINLESS STEEL & RING SHANK)
- THE SCREWS SHALL BE LEDGER-LOK LL358 WITH HEX WASHER STYLE HEAD (BY FASTEN-MASTER). OTHER SCREW TYPES CAN BE CONSIDERED IF THE DESIGN TABLES, SUPPLIED BY THE SCREW MFG, ARE SUBMITTED TO THE DESIGN ENGINEER FOR CONSIDERATION PRIOR TO CONSTRUCTION.

Designed	B70 STD DRAWING	Date	4/2022
Drawn	RGD	Drawn	4/2022
Checked		Checked	4/2022
Approved	RGD	Approved	


## WYE BRACE DETAILS

WAYNE COUNTY, PENNSYLVANIA

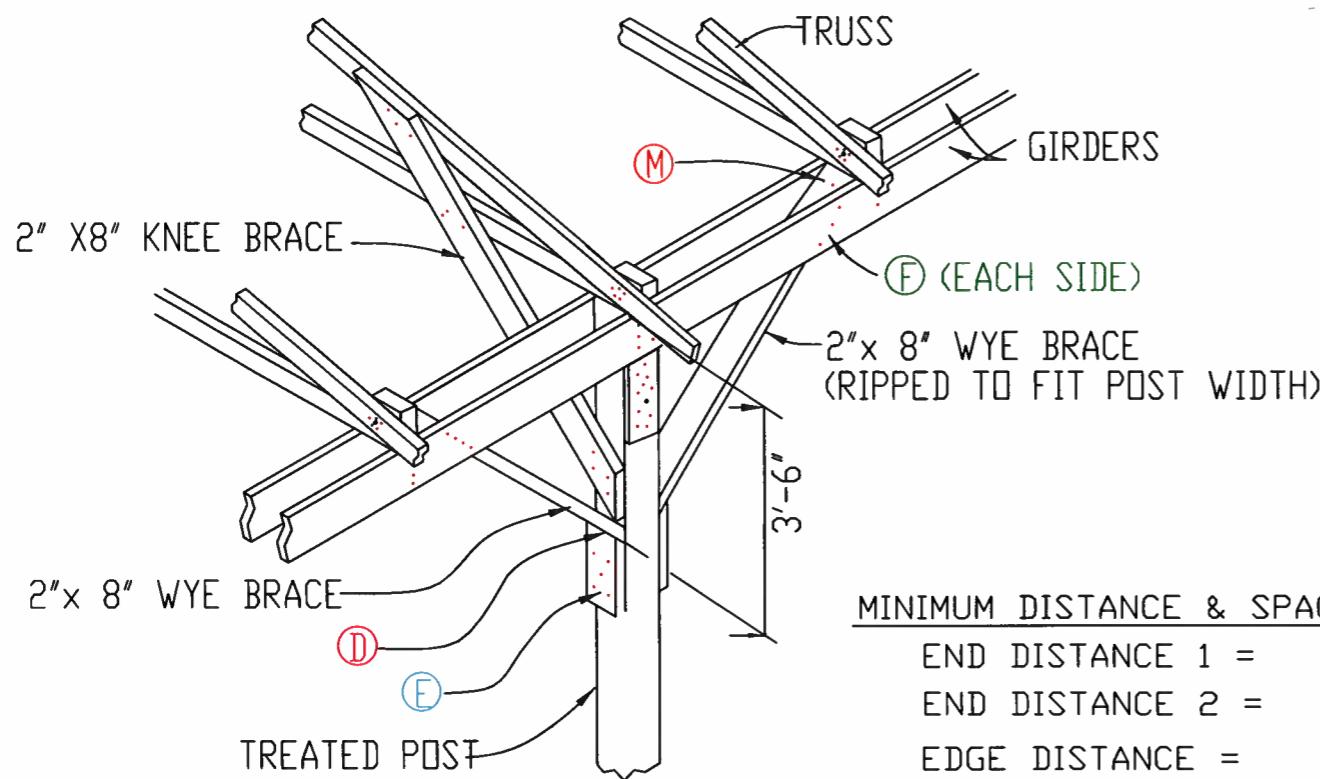

### MINIMUM DISTANCE & SPACING (INCHES)

END DISTANCE 1 =	3 <sup>3</sup> / <sub>4</sub>
END DISTANCE 2 =	2 <sup>3</sup> / <sub>8</sub>
EDGE DISTANCE =	1 <sup>3</sup> / <sub>4</sub>
SPACING BETWEEN SCREWS IN A ROW =	3 <sup>1</sup> / <sub>2</sub>
SPACING BETWEEN ROWS (STAGGER ROWS) =	1 <sup>1</sup> / <sub>4</sub>
BEARING BLOCK LENGTH =	14

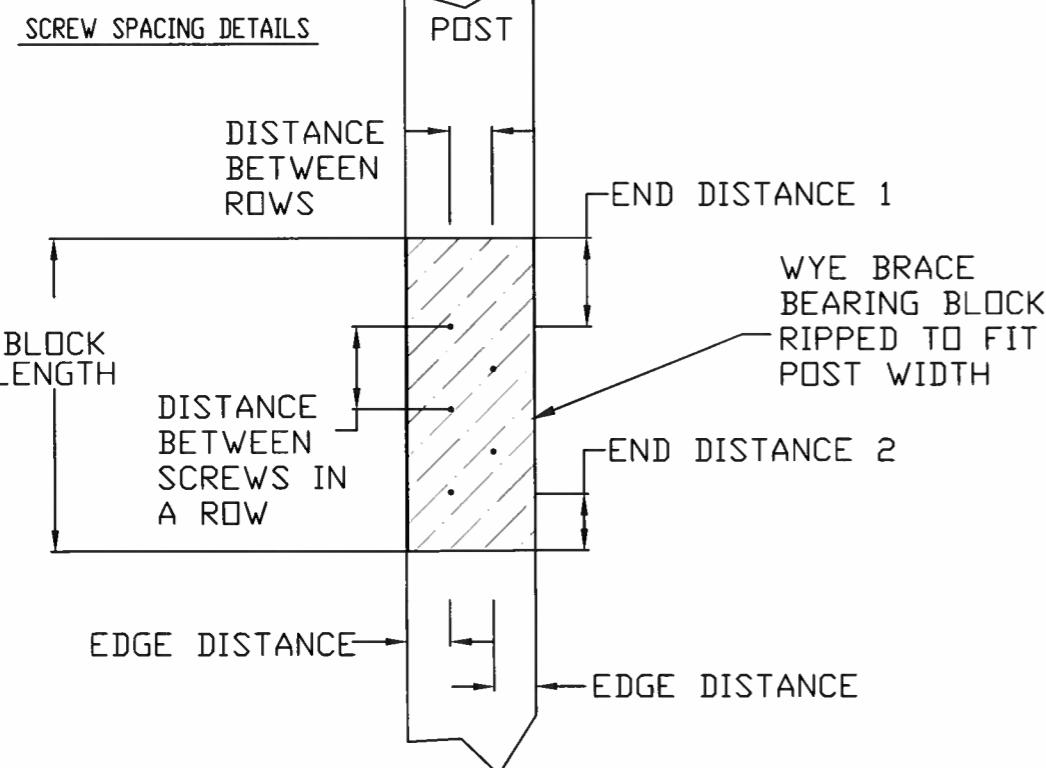

TABLES BELOW ARE SHOWING THE NUMBER OF LEDGERLOK LL358 SERIES SCREWS REQUIRED. LEDGERLOK IS A PRODUCT OF FASTEN-MASTER.

SCREWS SHALL HAVE A HEX WASHER HEAD, NOT A FLAT HEAD. OTHER SCREW TYPES MAY BE CONSIDERED FOR USE: SCREW MFG DESIGN TABLES SHALL BE SUBMITTED TO THE DESIGN ENGINEER FOR CONSIDERATION. PILOT HOLES ARE REQUIRED IN JOINT D, F, AND M. PILOT HOLES MAY BE REQUIRED IN JOINT E IF SPLITTING OCCURS. SCREWS IN JOINT M SHALL BE INSTALLED PERPENDICULAR TO THE SURFACE OF THE WYE BRACE; SO THAT THE SCREWS ARE NOT INSTALLED TOO CLOSE TO THE TOP OF THE BLOCK UNDER THE TRUSS.

"NO WYE" IS ONLY FOR SIDES ENCLOSED WITH STEEL SIDING. IF A SIDE IS ENCLOSED WITH CURTAINS; WYE BRACES ARE NEEDED.

JOINT	MINIMUM SCREW LENGTH	40' SPAN 8' OVERHANG (OPEN SIDE)	40' SPAN 2' OVERHANG (CLOSED SIDE)	40' SPAN 2' OVERHANG (OPEN SIDE)
D	3 <sup>5</sup> / <sub>8</sub> "	2	NO WYE	2
E	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	2
F	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	2
M	3 <sup>5</sup> / <sub>8</sub> "	0	NO WYE	0

JOINT	MINIMUM SCREW LENGTH	50' SPAN 8' OVERHANG (OPEN SIDE)	50' SPAN 2' OVERHANG (CLOSED SIDE)	50' SPAN 2' OVERHANG (OPEN SIDE)
D	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	2
E	3 <sup>5</sup> / <sub>8</sub> "	4	NO WYE	3
F	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	3
M	3 <sup>5</sup> / <sub>8</sub> "	2	NO WYE	0

JOINT	MINIMUM SCREW LENGTH	60' SPAN 8' OVERHANG (OPEN SIDE)	60' SPAN 2' OVERHANG (CLOSED SIDE)	60' SPAN 2' OVERHANG (OPEN SIDE)
D	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	3
E	3 <sup>5</sup> / <sub>8</sub> "	5	NO WYE	4
F	3 <sup>5</sup> / <sub>8</sub> "	3	NO WYE	3
M	3 <sup>5</sup> / <sub>8</sub> "	2	NO WYE	2

## KNEE BRACE DETAILS


WAYNE COUNTY, PENNSYLVANIA

FASTEN KNEE BRACE TO TOP AND BOTTOM CHORDS OF TRUSS USING

- (B1) IN TOP CHORD
- (B2) IN BOTTOM CHORD


KNEE BRACE, 2' x 8'

### KNEE BRACE AT MIDSPAN POSTS

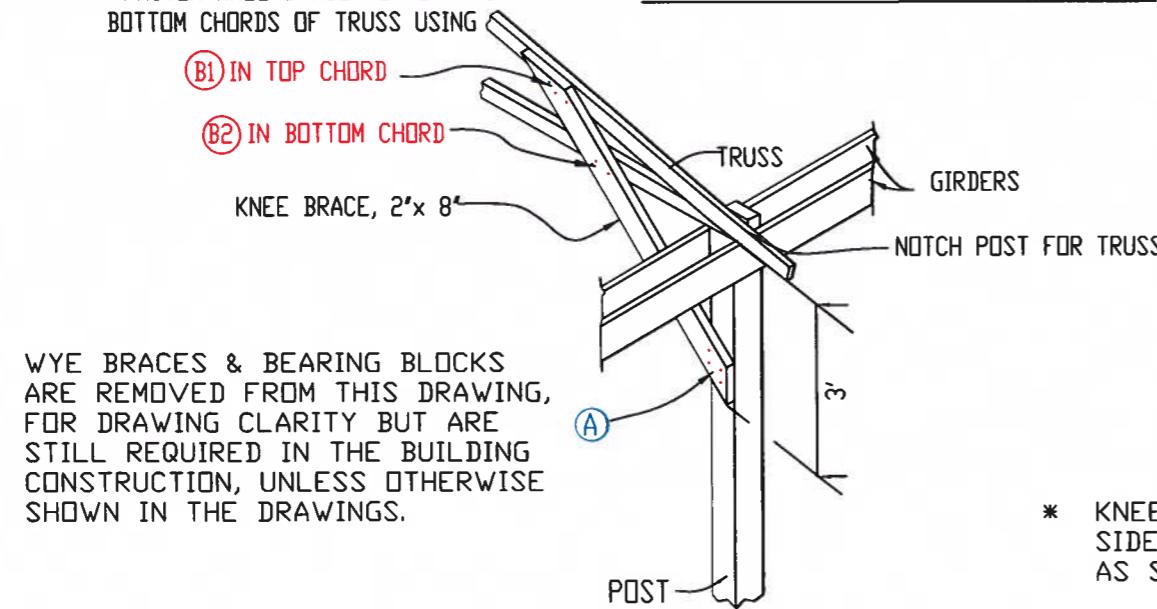


WYE BRACES & BEARING BLOCKS ARE REMOVED FROM THIS DRAWING, FOR DRAWING CLARITY BUT ARE STILL REQUIRED IN THE BUILDING CONSTRUCTION, UNLESS OTHERWISE SHOWN IN THE DRAWINGS.

### KNEE BRACE AT END POSTS

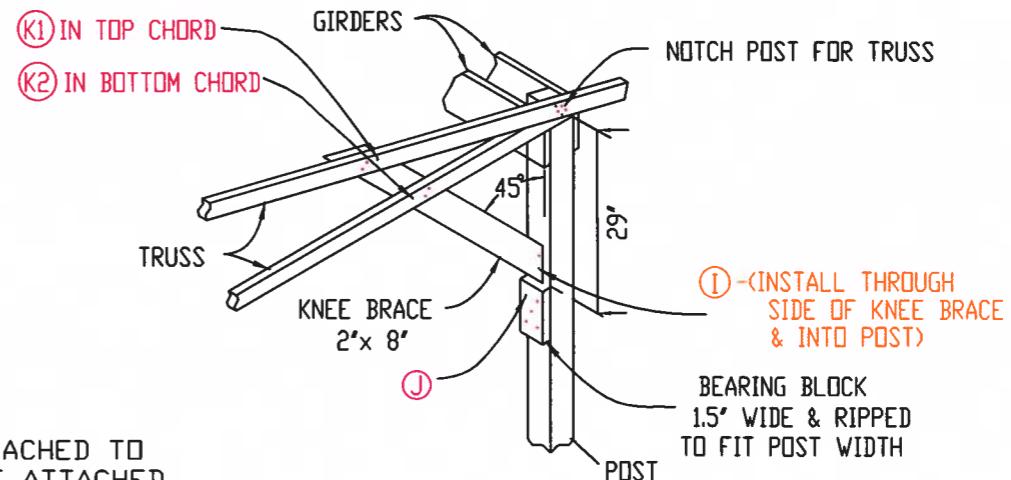

\* KNEE BRACE SHALL BE ATTACHED TO SIDE OF POST, BUT CAN BE ATTACHED AS SHOWN AT THE END POSTS ONLY.

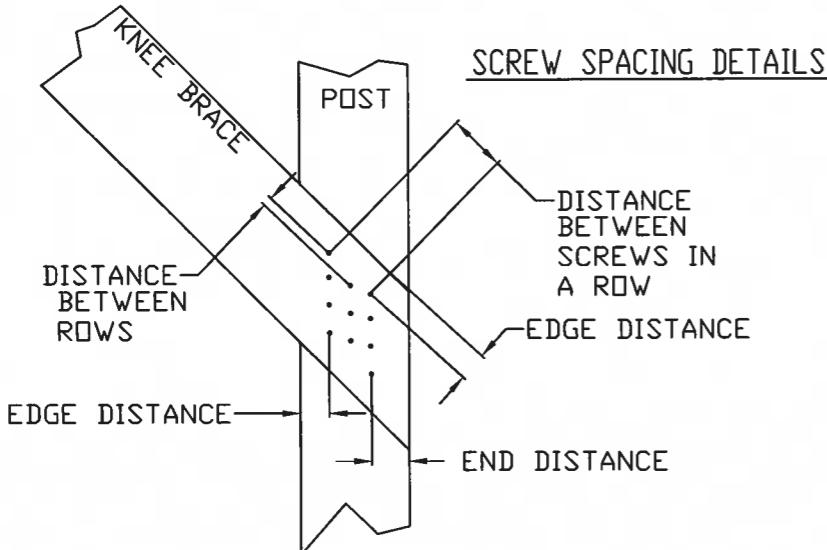

SPACING REQUIREMENTS APPLY TO ALL KNEE BRACE & BEARING BLOCK LOCATIONS WHERE SCREWS ARE SPECIFIED FOR.

#### MINIMUM DISTANCE & SPACING (INCHES)

END DISTANCE =  $2\frac{3}{8}$

EDGE DISTANCE =  $1\frac{3}{4}$

SPACING BETWEEN SCREWS IN A ROW =  $3\frac{1}{2}$

SPACING BETWEEN ROWS (STAGGER ROWS) =  $5\frac{5}{8}$

TABLES ARE SHOWING THE NUMBER OF LEDGERLOK LL358 SERIES SCREWS REQUIRED. LEDGERLOK IS A PRODUCT OF FASTEN-MASTER. SCREWS SHALL HAVE A HEX WASHER HEAD, NOT A FLAT HEAD.

OTHER SCREW TYPES CAN BE CONSIDERED IF THE DESIGN TABLES, FROM THE SCREW MFG, ARE SUBMITTED TO THE DESIGN ENGINEER FOR CONSIDERATION PRIOR TO CONSTRUCTION. PILOT HOLES ARE NOT REQUIRED IN MOST CONNECTIONS UNLESS SPLITTING OCCURS.

PILOT HOLES ARE REQUIRED IN JOINT J.


\* TABLES ARE BASED ON USING DRILL SET TYPE POST TO WALL BRACKETS. WET SET BRACKETS SHALL NOT BE USED.

JOINT	MINIMUM SCREW LENGTH	40' SPAN 8' OVERHANG (OPEN SIDE)	40' SPAN 2' OVERHANG (CLOSED SIDE)	40' SPAN 2' OVERHANG (OPEN SIDE)
A	$3\frac{5}{8}$	8	6	7
B1/K1	$3\frac{5}{8}$	5	4	4
B2/K2	$3\frac{5}{8}$	5	4	4
I	$3\frac{5}{8}$	3	3	3
J	$3\frac{5}{8}$	4	4	4


JOINT	MINIMUM SCREW LENGTH	50' SPAN 8' OVERHANG (OPEN SIDE)	50' SPAN 2' OVERHANG (CLOSED SIDE)	50' SPAN 2' OVERHANG (OPEN SIDE)
A	$3\frac{5}{8}$	10	7	8
B1/K1	$3\frac{5}{8}$	6	4	5
B2/K2	$3\frac{5}{8}$	6	4	5
I	$3\frac{5}{8}$	3	3	3
J	$3\frac{5}{8}$	5	4	4

JOINT	MINIMUM SCREW LENGTH	60' SPAN 8' OVERHANG (OPEN SIDE)	60' SPAN 2' OVERHANG (CLOSED SIDE)	60' SPAN 2' OVERHANG (OPEN SIDE)
A	$3\frac{5}{8}$	11	7	10
B1/K1	$3\frac{5}{8}$	7	4	6
B2/K2	$3\frac{5}{8}$	7	4	6
I	$3\frac{5}{8}$	3	3	3
J	$3\frac{5}{8}$	6	4	5


# CHORD AND DIAGONAL BRACING

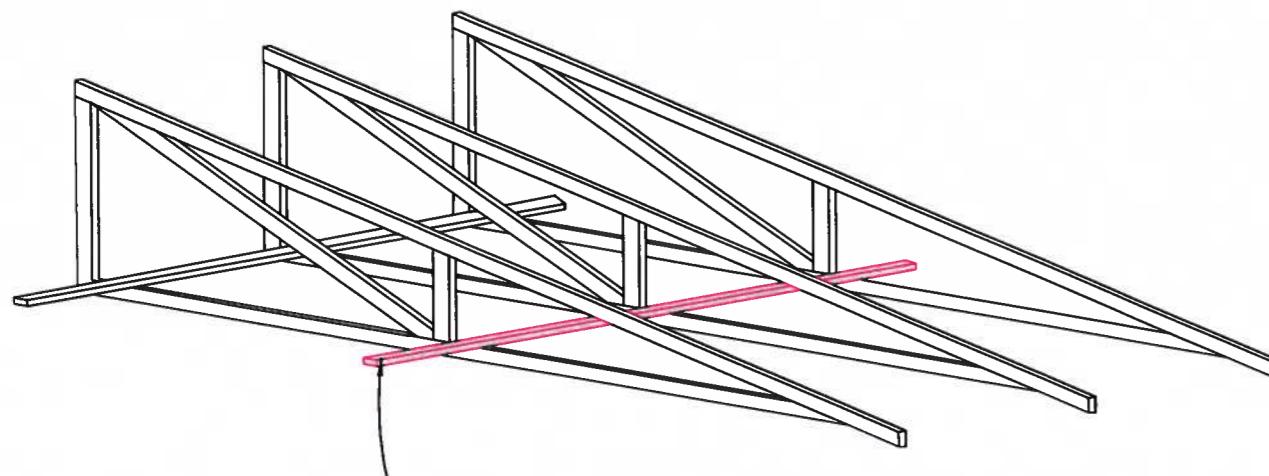


CONTINUOUS LATERAL BRACING ("RAT RUNS")  
(2-16d NAILS @ EACH BRACE / TRUSS CONNECTION)

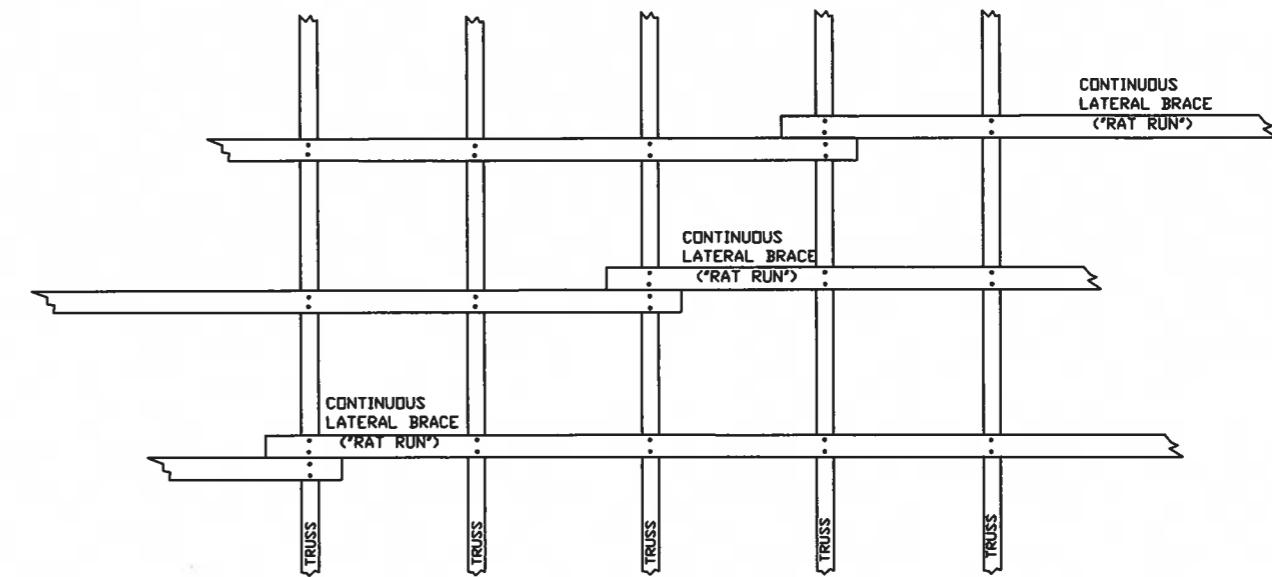

JOINTS IN CONTINUOUS LATERAL BRACES SHALL BE STAGGERED,  
SO THEY DO NOT LINE UP WITH THE NEXT TRUSS.  
AT A JOINT, EACH BOARD SHALL EXTEND FULLY PAST THE TRUSS,  
TO ALLOW FOR A TWO NAIL CONNECTION.  
THESE BRACES ARE AS PER TRUSS MFG. REQUIREMENTS,  
SHOWN ON THE TRUSS DESIGN.

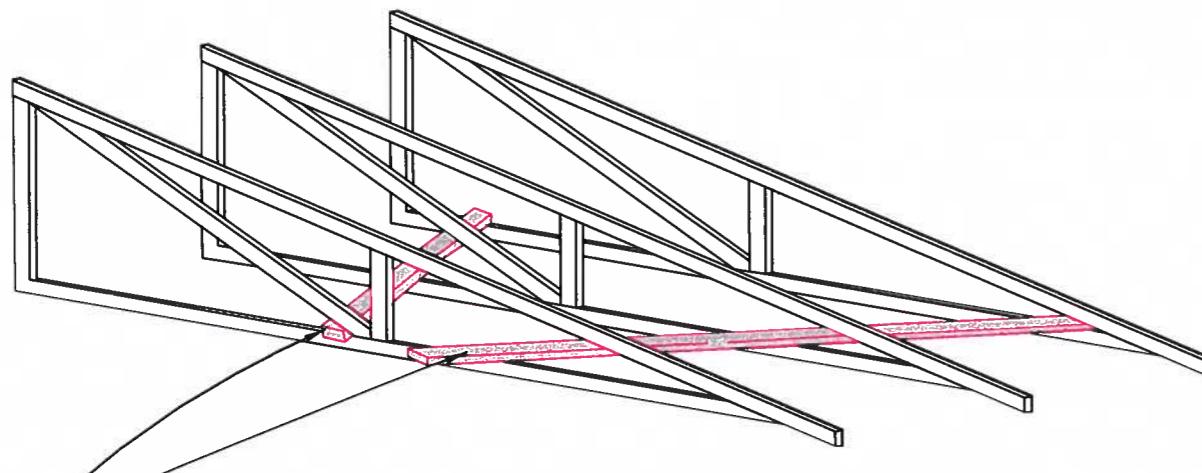

DIAGONAL BRACING ON TOP SIDE OF BOTTOM CHORD  
AT LOCATIONS SHOWN IN DRAWINGS  
(2-16d NAILS @ EACH BRACE TRUSS CONNECTION)

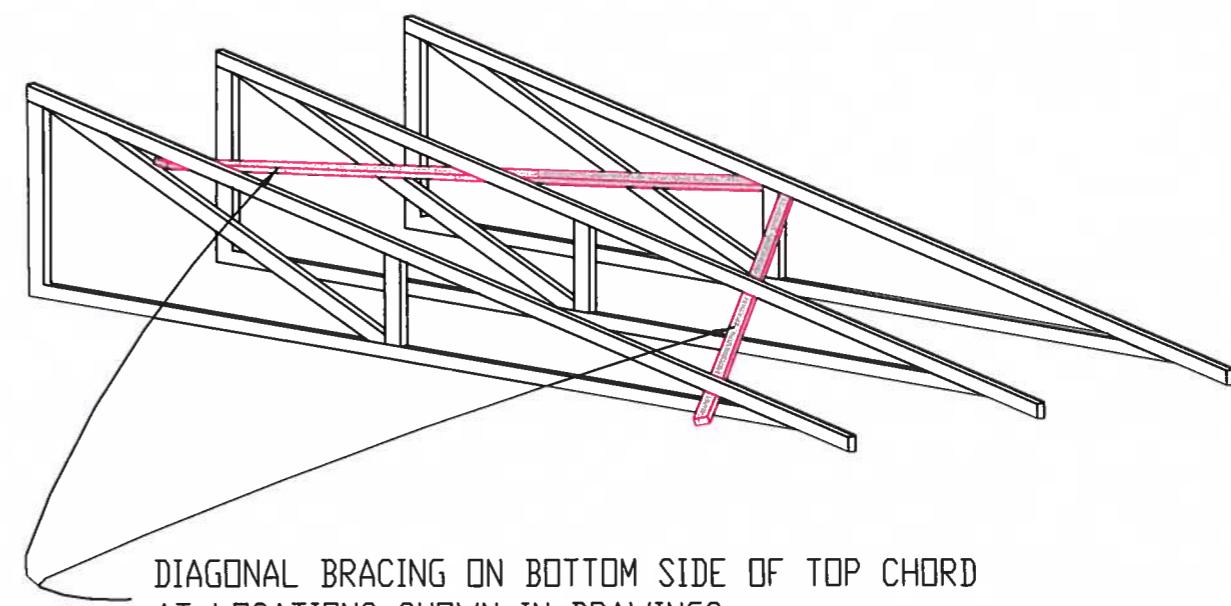

DIAGONAL BRACING ON BOTTOM SIDE OF TOP CHORD  
AT LOCATIONS SHOWN IN DRAWINGS  
(2-16d NAILS @ EACH BRACE TRUSS CONNECTION)

Designed	By	STD DRAWING	Date
Drawn	Drawn	RGD	1/2020
Checked	Checked	RGD	1/2020

## CHORD & DIAGONAL BRACING DETAILS



File No.

Drawing No.

Sheet 25 of 39

## CROSS BRACING DETAILS


Designed	B70 STD DRAWING	1/2020
Drawn	RGD	1/2020
Checked	RGD	1/2020

### CROSS BRACING

TO BE INSTALLED AT INTERVALS NOT TO EXCEED 20'  
ALONG CONTINUOUS LATERAL BRACING

CROSS BRACING IS REQUIRED ON TRUSS WEBS  
THAT HAVE A CONTINUOUS LATERAL  
BRACE OPTION #1

2X4 BLOCK OVER ALL BRACES

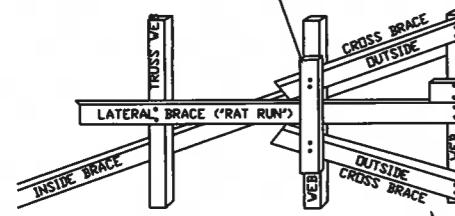


AT JOINT LOCATIONS,  
INSTALL LATERAL BRACE  
SO IT EXTENDS PAST  
TRUSS WEB MEMBER TO  
ENABLE A (2) NAIL CONNECTION  
TO THE WEB MEMBER

THIS BRACE LOCATION IS  
SHOWN ON THE TRUSS DESIGN.

THE INSIDE CROSS BRACE SHALL CONNECT  
(3) OR (4) TRUSSES.  
THE OUTSIDE CROSS BRACE SHALL CONNECT  
(3) TRUSSES MINIMUM. ONLY (2) SHOWN HERE FOR  
DRAWING CLARITY.  
(2-16d NAILS @ EACH MEMBER/BLOCK)

\* ALL CROSS BRACES SHALL BE  
INSTALLED AT LESS THAN OR  
EQUAL TO 45 DEGREE  
ANGLES

CROSS BRACING IS REQUIRED ON TRUSS WEBS  
THAT HAVE A CONTINUOUS LATERAL  
BRACE OPTION #3

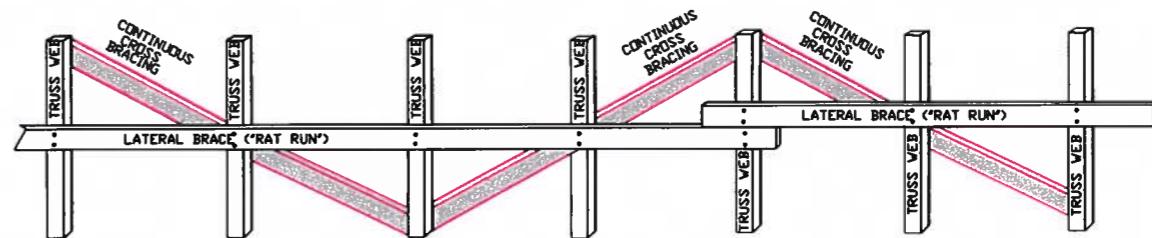


INSTALL 'CONTINUOUS' CROSS BRACING  
ON THE OPPOSITE SIDE OF THE TRUSS  
WEB MEMBER AS THE LATERAL BRACE.  
THE CROSS BRACING MUST RUN THE  
ENTIRE LENGTH OF THE BUILDING  
ON THOSE WEB MEMBERS WITH LATERAL  
BRACING SPECIFIED IN THE TRUSS DESIGN  
AND AT OTHER LOCATIONS DICTATED BY  
THE BUILDING DESIGN ENGINEER.  
(2-16d NAILS @ EACH MEMBER)

\* ALL CROSS BRACES SHALL BE  
INSTALLED AT LESS THAN OR  
EQUAL TO 45 DEGREE  
ANGLES

CROSS BRACING IS REQUIRED ON TRUSS WEBS  
THAT HAVE A CONTINUOUS LATERAL  
BRACE OPTION #2

2X4X12 BLOCK  
UNDER BRACE

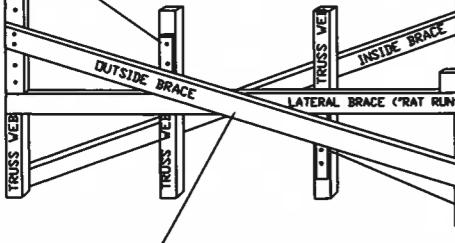

AT JOINT LOCATIONS,  
INSTALL LATERAL BRACE  
SO IT EXTENDS PAST  
TRUSS WEB MEMBER TO  
ENABLE A (2) NAIL CONNECTION  
TO THE WEB MEMBER


THIS BRACE LOCATION IS  
SHOWN ON THE TRUSS DESIGN.

THE CROSS BRACE SHALL CONNECT  
AT LEAST (3) TRUSSES,  
(2-16d NAILS @ EACH MEMBER/BLOCK)

\* ALL CROSS BRACES SHALL BE  
INSTALLED AT LESS THAN OR  
EQUAL TO 45 DEGREE  
ANGLES

CROSS BRACING IS REQUIRED ON TRUSS WEBS  
THAT DO NOT HAVE A CONTINUOUS LATERAL BRACE,  
AT LOCATIONS SHOWN IN THE DRAWINGS.

OPTION #4

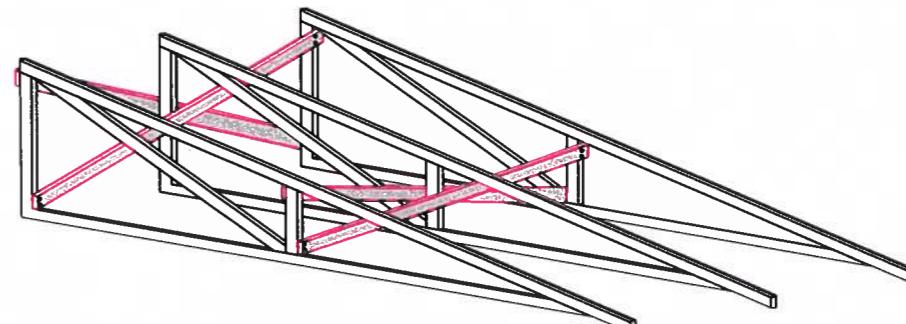

CROSS BRACING ON BOTH SIDES OF TRUSS WEBS  
AT LOCATIONS SHOWN WHERE THERE IS NOT A  
LATERAL BRACE ('RAT RUN') LOCATED ON A TRUSS  
WEB MEMBER, DICTATED BY THE BUILDING DESIGN ENGINEER.

THE CROSS BRACE SHALL CONNECT  
AT LEAST (3) TRUSSES,  
(2-16d NAILS @ EACH MEMBER/BLOCK)


\* ALL CROSS BRACES SHALL BE  
INSTALLED AT LESS THAN OR  
EQUAL TO 45 DEGREE  
ANGLES

**ADDITIONAL BRACING REQUIREMENTS**



Natural Resources Conservation Service  
United States Department of Agriculture

File No.	2110
Drawing No.	1110
Checked	
Approved by	

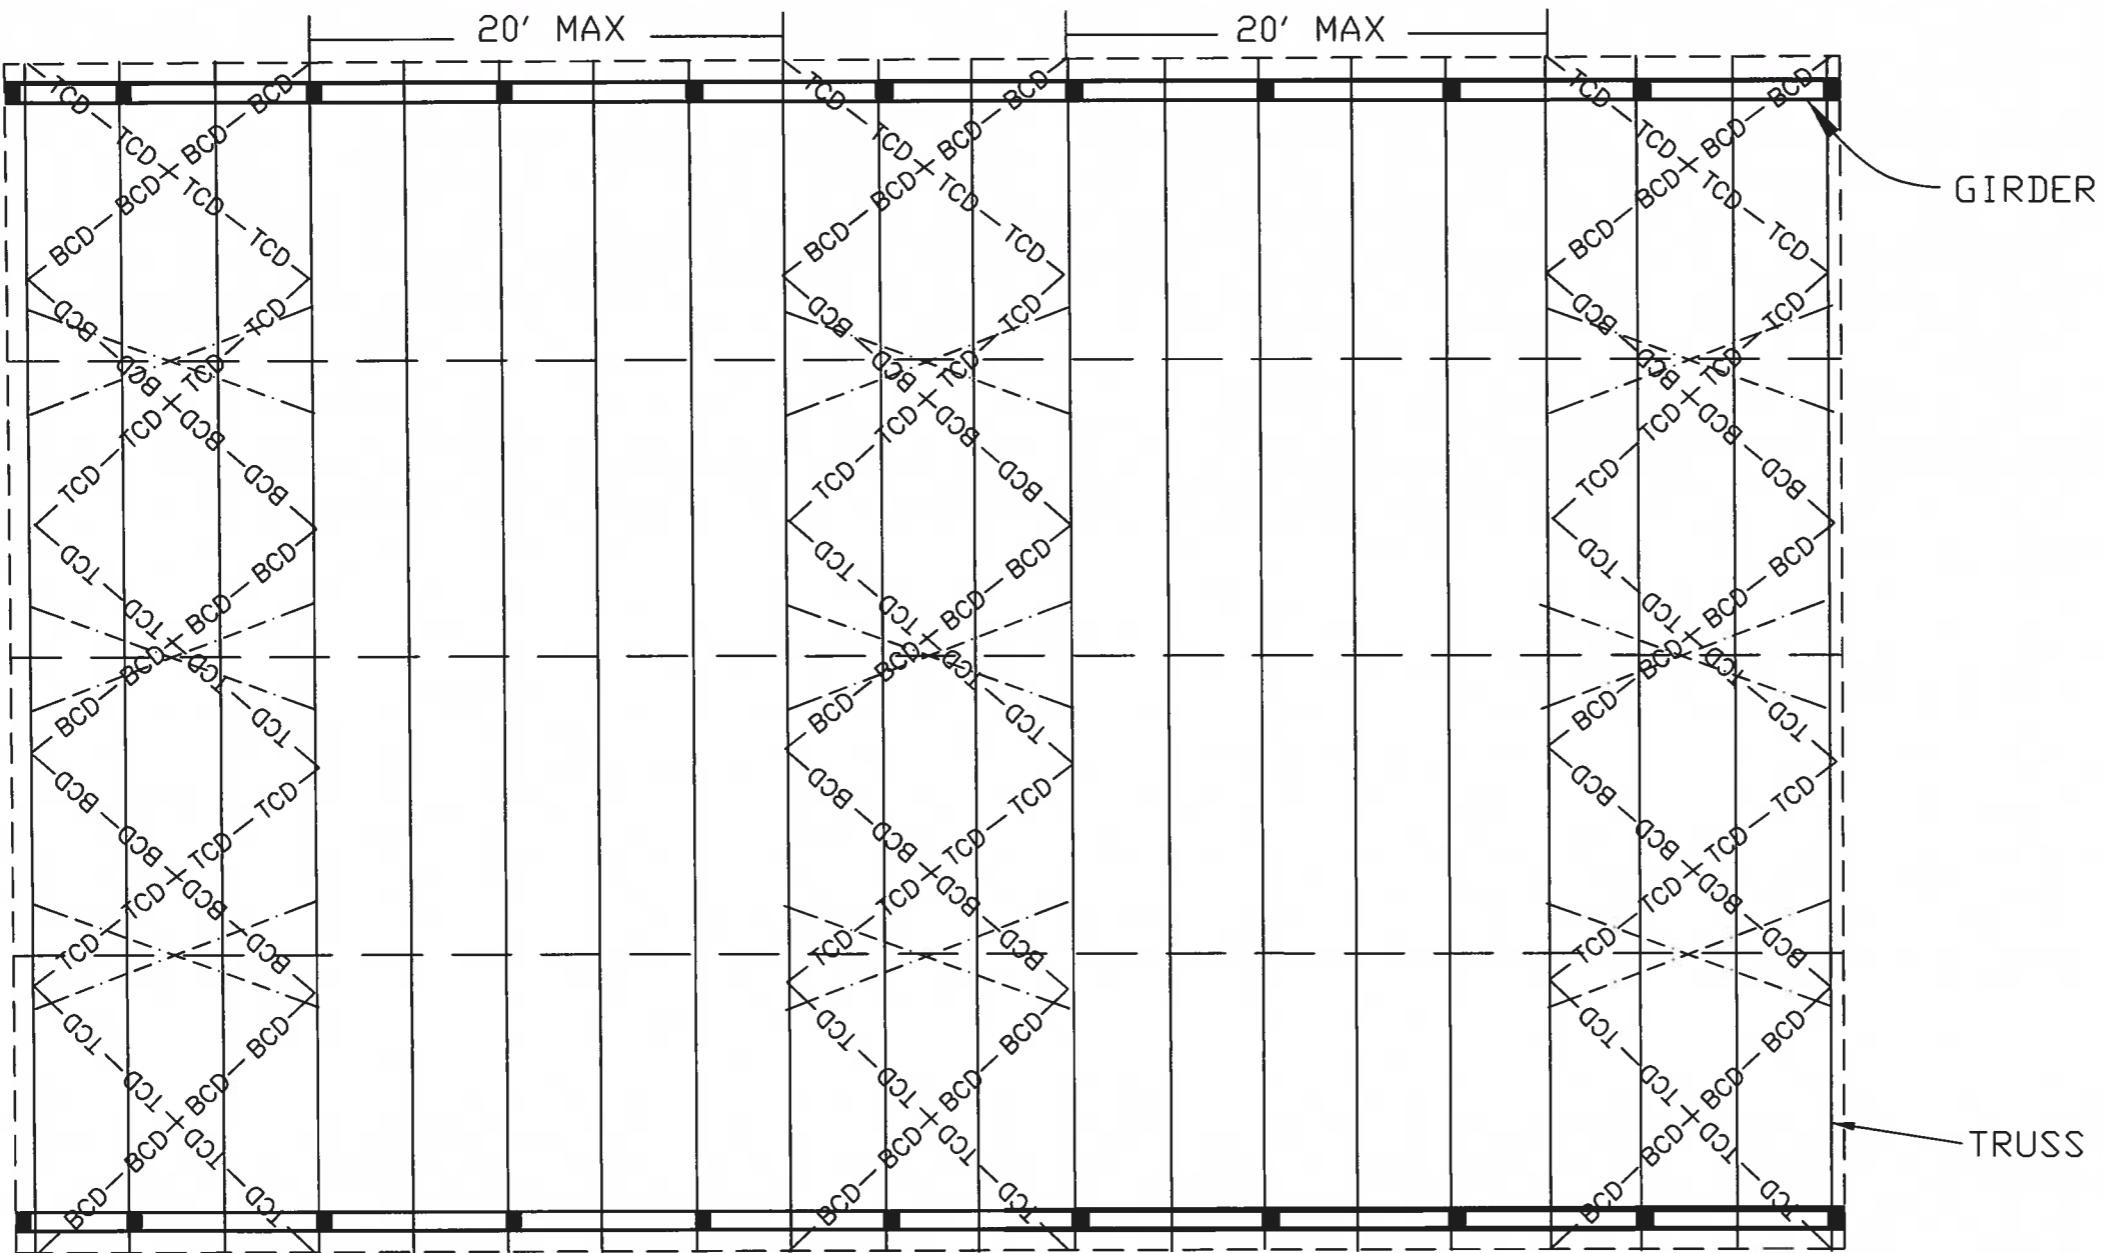

**NOTES:**

— — — — — CONTINUOUS LATERAL BRACING  
AS PER TRUSS MFG. RECOMMENDATIONS

— TCD — TCD — TCD — TOP CHORD DIAGONAL BRACING

— BCD — BCD — BCD — BOTTOM CHORD DIAGONAL BRACING


WEB MEMBER CROSS BRACING

1. CONTINUOUS LATERAL BRACING SHOWN IS FOR A VISUAL REPRESENTATION ONLY; CONTINUOUS LATERAL BRACING LOCATIONS & SPACING ARE REQUIRED BY THE TRUSS MFG & SHOWN ON THE TRUSS DESIGN DRAWING.
2. ALL BRACING IS 2" X 4" GRADE MARKED LUMBER.
3. ALL CONNECTIONS SHOULD BE MADE WITH 2 - 16d NAILS.  
2-16d NAILS. NO BUTT JOINTS.

**"DRAWING IS NOT TO SCALE"**

# "K" BRACING DETAIL

(FOR POSTS ON TOP OF CONCRETE WALL)

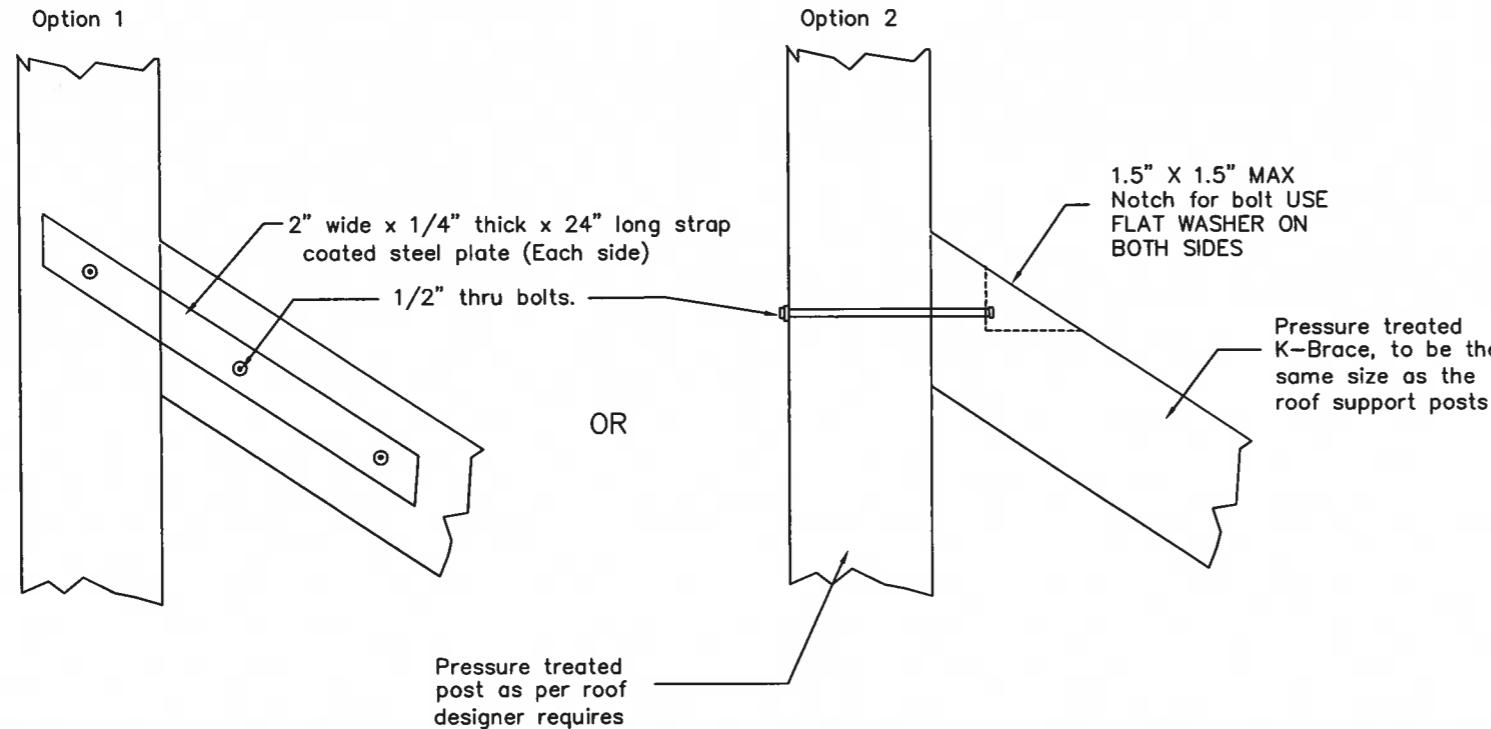

Approved by	
Drawn	REB
Checked	REB (REB/SD)
Date	7/10

K-BRACE DETAIL

**NRCS**  
Natural Resources Conservation Service  
United States Department of Agriculture


## TYPICAL "K" BRACE LOCATION

### NOTES:

- 1). "K" bracing is needed when posts are anchored to top of walls.
- 2). Will need a "K" brace at the corners of the building.
- A "K" brace should also be considered on both sides of openings.
- 3). Other "K" brace configurations may be used if approved by the designer.

\*\* IF THE ENCLOSED SIDES ARE ENCLOSED WITH STEEL PANELS THEN "K" BRACES ARE NOT REQUIRED.  
IF THE ENCLOSED SIDES ARE ENCLOSED WITH CURTAINS THEN "K" BRACES ARE REQUIRED.  
IF ALL SIDES ARE LEFT OPEN THEN "K" BRACES ARE REQUIRED.  
K-BRACE SHALL BE THE SAME SIZE AS THE SUPPORT POSTS. ORDER ENOUGH POSTS FOR K-BRACING.

UPPER END OF BRACE  
CAN BE INSTALLED BETWEEN  
HEADERS AND FASTENED  
WITH 16d NAILS  
IN ADDITION TO BOLTS  
THROUGH THE BRACE  
AND SUPPORT POST

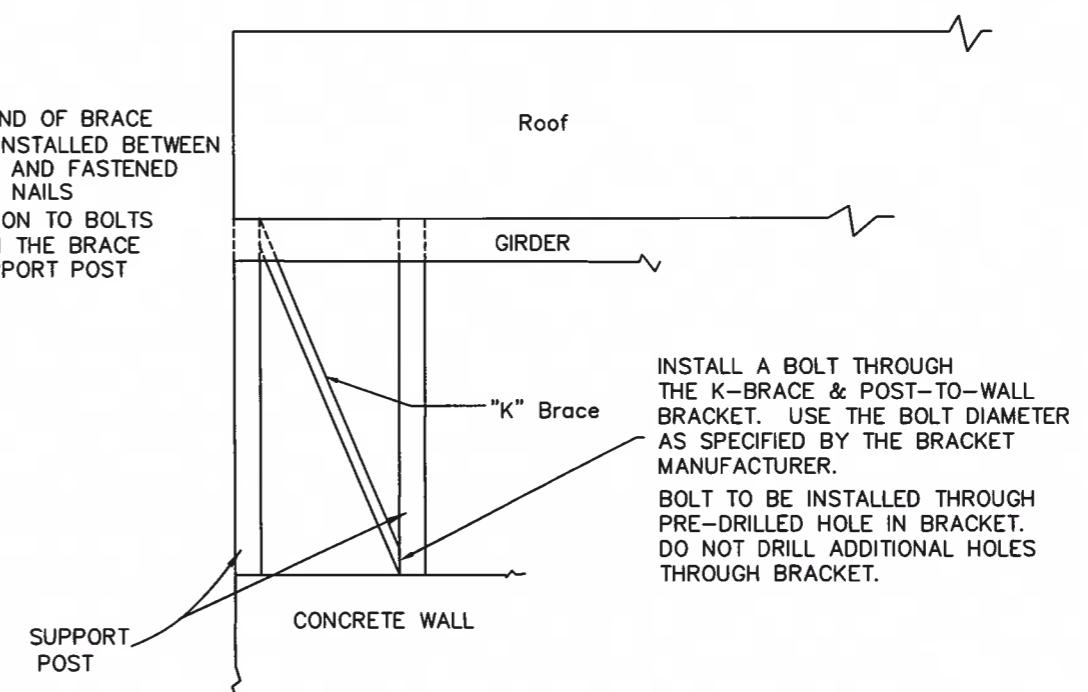


"Not To Scale"

File No.	
Drawing No.	
Sheet	28 of 39



ENCLOSED SIDEWALL DETAILS

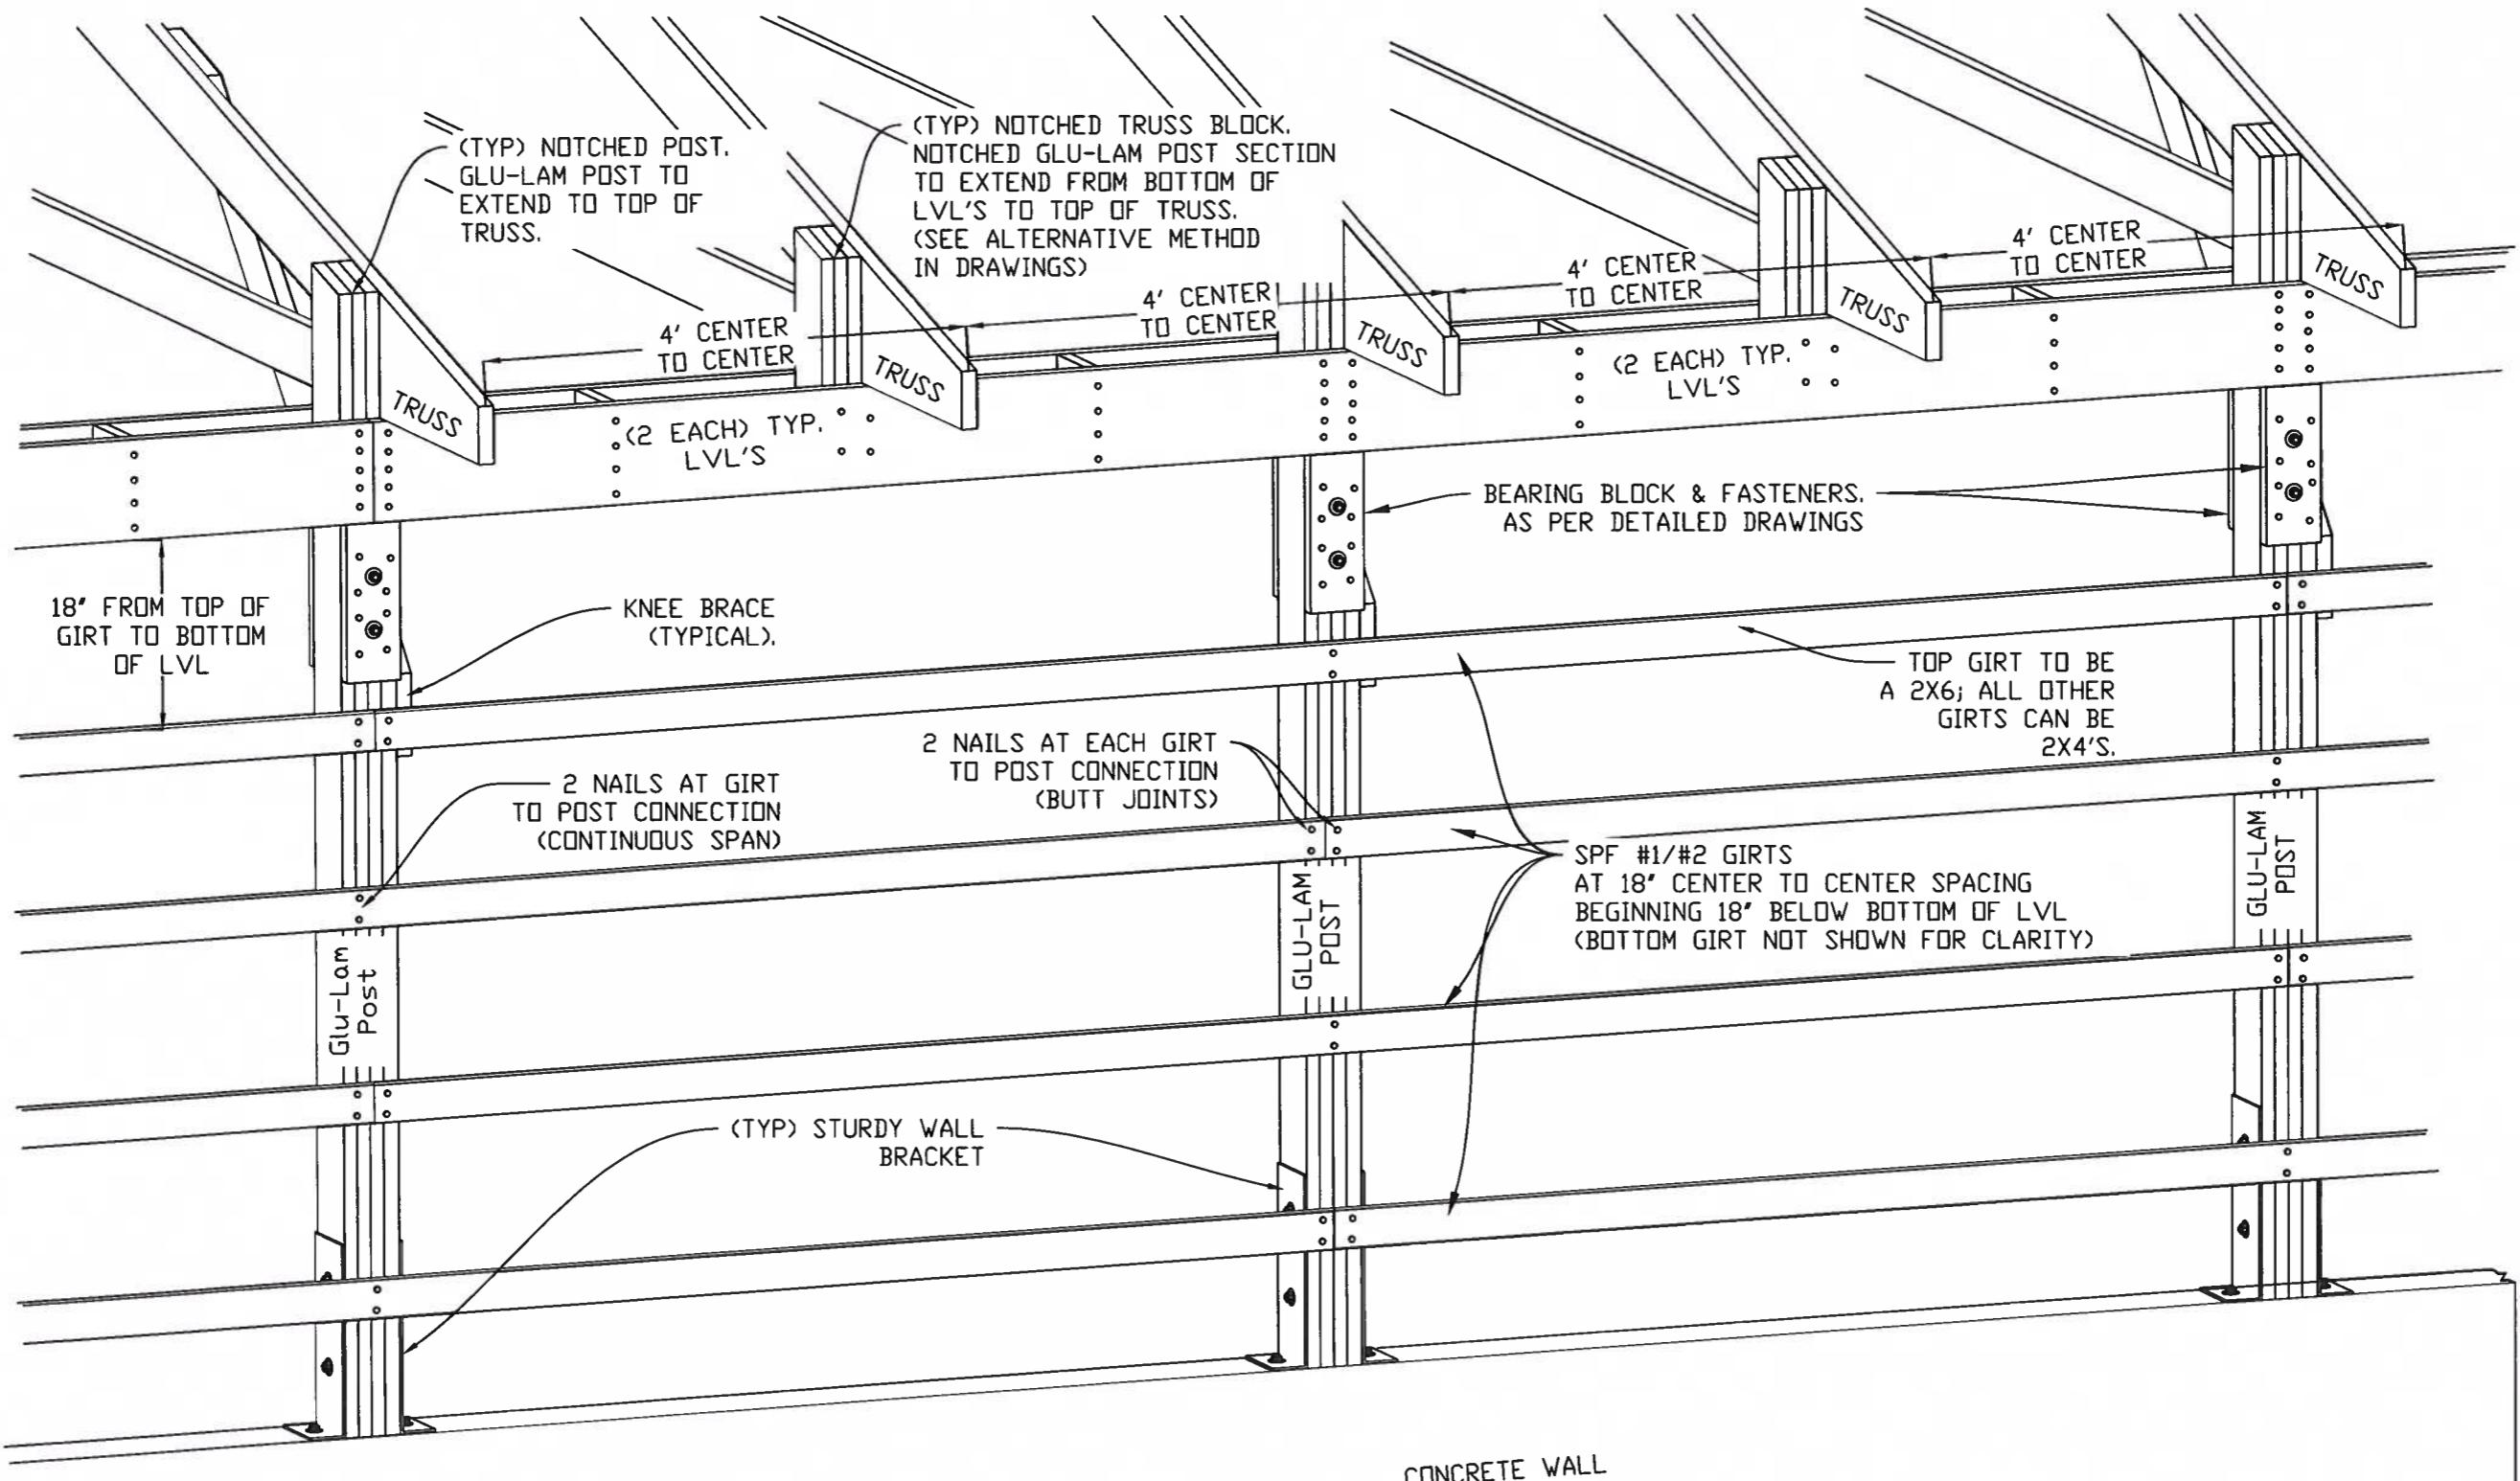

CONSTRUCTION NOTES:

1. ALL NAILS SHALL BE POWER DRIVEN, GALVANIZED, & RING SHANK: 0.131" DIAMETER X 3.25" LONG (MIN.)



Natural Resources Conservation Service

United States Department of Agriculture

FILE NO.


DRAWING NO.

SHEET 30 OF 39

DESIGNED	BTO STANDARD	DWG	DATE
DRAWN	MQF	4/22	4/22
CHECKED	RGD	4/22	4/22
APPROVED	RGD		

ENCLOSED SIDEWALL DETAILS

WAYNE COUNTY, PENNSYLVANIA

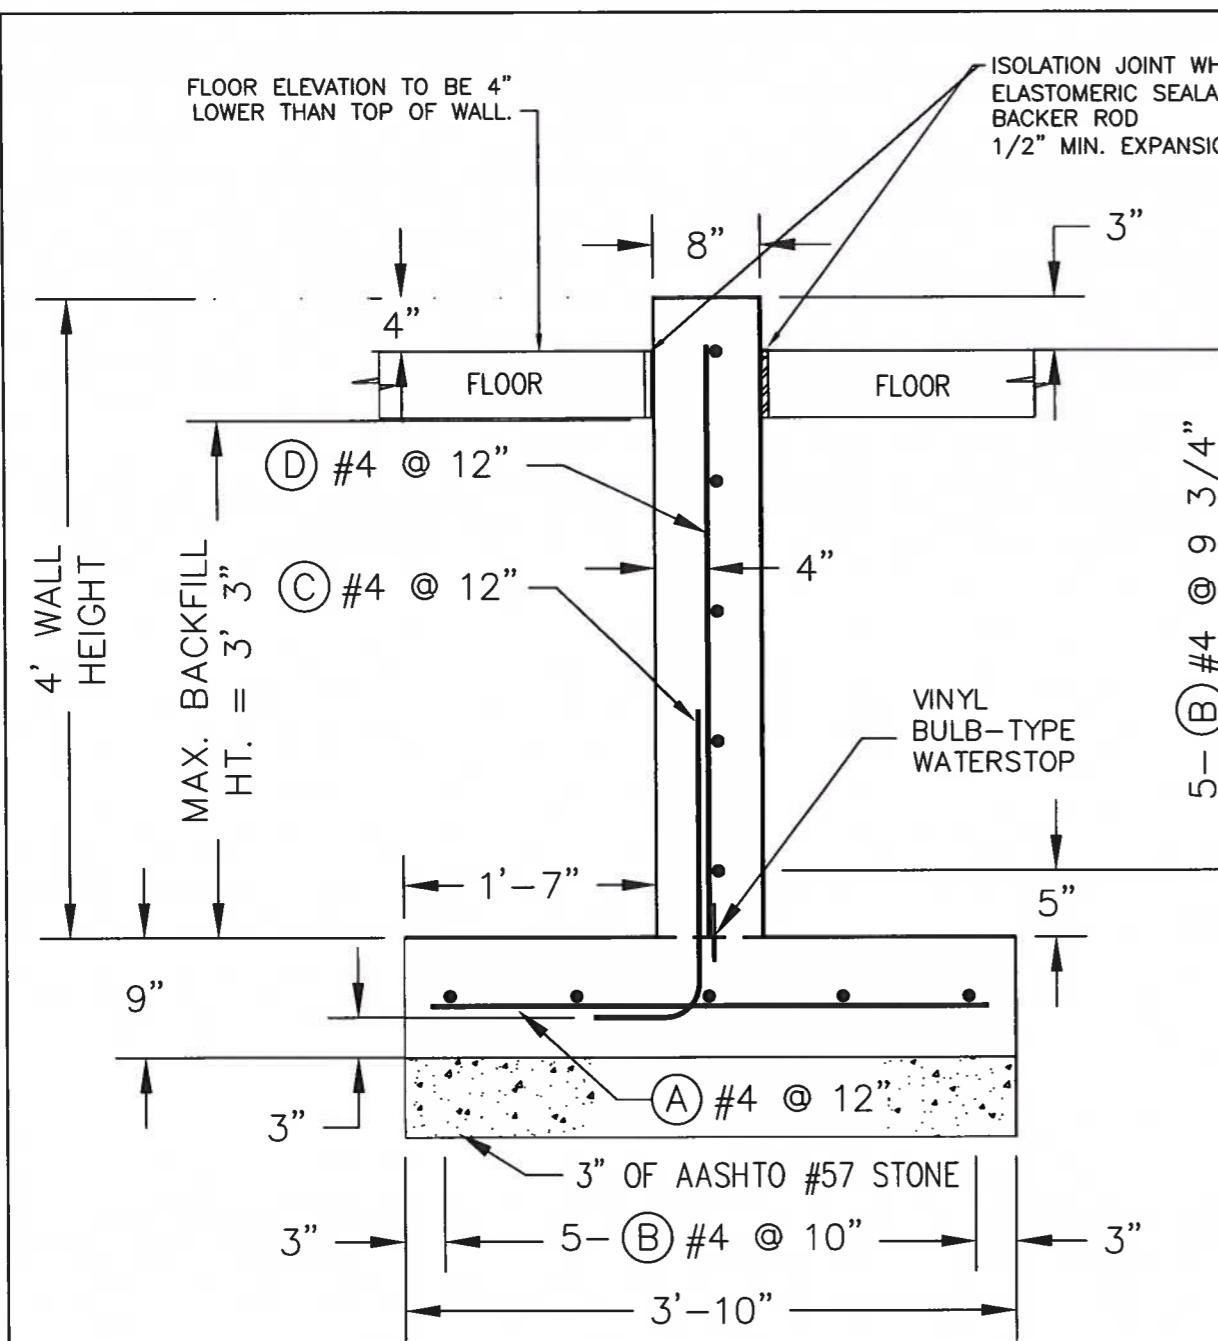

ISOLATION JOINT WHERE FLOOR IS POUR AGAINST WALL.  
ELASTOMERIC SEALANT 1/4" DEPTH  
BACKER ROD  
1/2" MIN. EXPANSION MATERIAL

GENERAL DESIGN NOTES:


- DRAINAGE SHALL BE AWAY FROM THE WALL.
- THE MINIMUM TOP WIDTH OF THE BACKFILL AGAINST THE WALL SHALL BE EQUAL TO OR GREATER THAN THE BACKFILL HEIGHT.
- MAXIMUM FOOTING CONTACT PRESSURE IS 900 psf/ft.

DESIGN STRENGTHS: WORKING STRESS DESIGN

CONCRETE  $f_c = 4,000$  psi STEEL  $f_s = 24,000$  psi (GRADE 60)

WALL DESIGN LOADING: 313 STANDARD – LATERAL EARTH PRESSURE VALUES,  
SEE SECTION IV OF THE FIELD OFFICE TECHNICAL GUIDE.

- MANURE LOAD INSIDE = 65 psf/ft.
- SOIL BACKFILL LOAD OUTSIDE = 60 psf/ft. AND 85 psf/ft.
- NO HORIZONTAL SURCHARGE ADDED.
- SOIL BACKFILL DENSITY = 110pcf.
- WATER TABLE MUST BE BELOW THE FOOTING ELEVATION



TYPE 2 BAR

STEEL SCHEDULE

MARK	SIZE	TYPE	R	S	LENGTH
A	4	STR	---	---	3'-6"
B	4	STR	---	---	
*C	4	2	2'-0"	9"	2'-9"
*D	4	STR	---	---	3'-9"
L	4	2	2'-0"	9"	2'-9"
L1	4	STR	---	---	3'-9"

\* MARK C & D BARS MAY BE COMBINED TO AVOID SPLICING.  
THEN MARK C BAR IS 4'-3" x 9".

NOTES:

1. FOR FROST PROTECTION, A 2-FOOT BACKFILL IS REQUIRED.
2. DIMENSIONS ARE TO THE REINFORCING BAR SURFACE.

ADAPTED AND MODIFIED FROM STANDARD DRAWING # PA-020D


- CONCRETE SHALL MEET PA 313 OR 561 SPECIFICATION REQUIREMENTS.
- MINIMUM SPLICE LENGTH FOR ALL #4 BARS IS 16".
- STEEL QUANTITY DOES NOT INCLUDE SPLICE LENGTHS.
- REBAR SHALL BE GRADE 60.

**NRCS**  
Natural Resources Conservation Service  
United States Department of Agriculture

File No. \_\_\_\_\_  
Drawing No. \_\_\_\_\_  
Sheet 31 of 39

4' HIGH, T-WALL (W/0 SURCHARGE)

Date 11/2018  
Design BTO  
Drawn \_\_\_\_\_  
Checked \_\_\_\_\_  
Approved \_\_\_\_\_

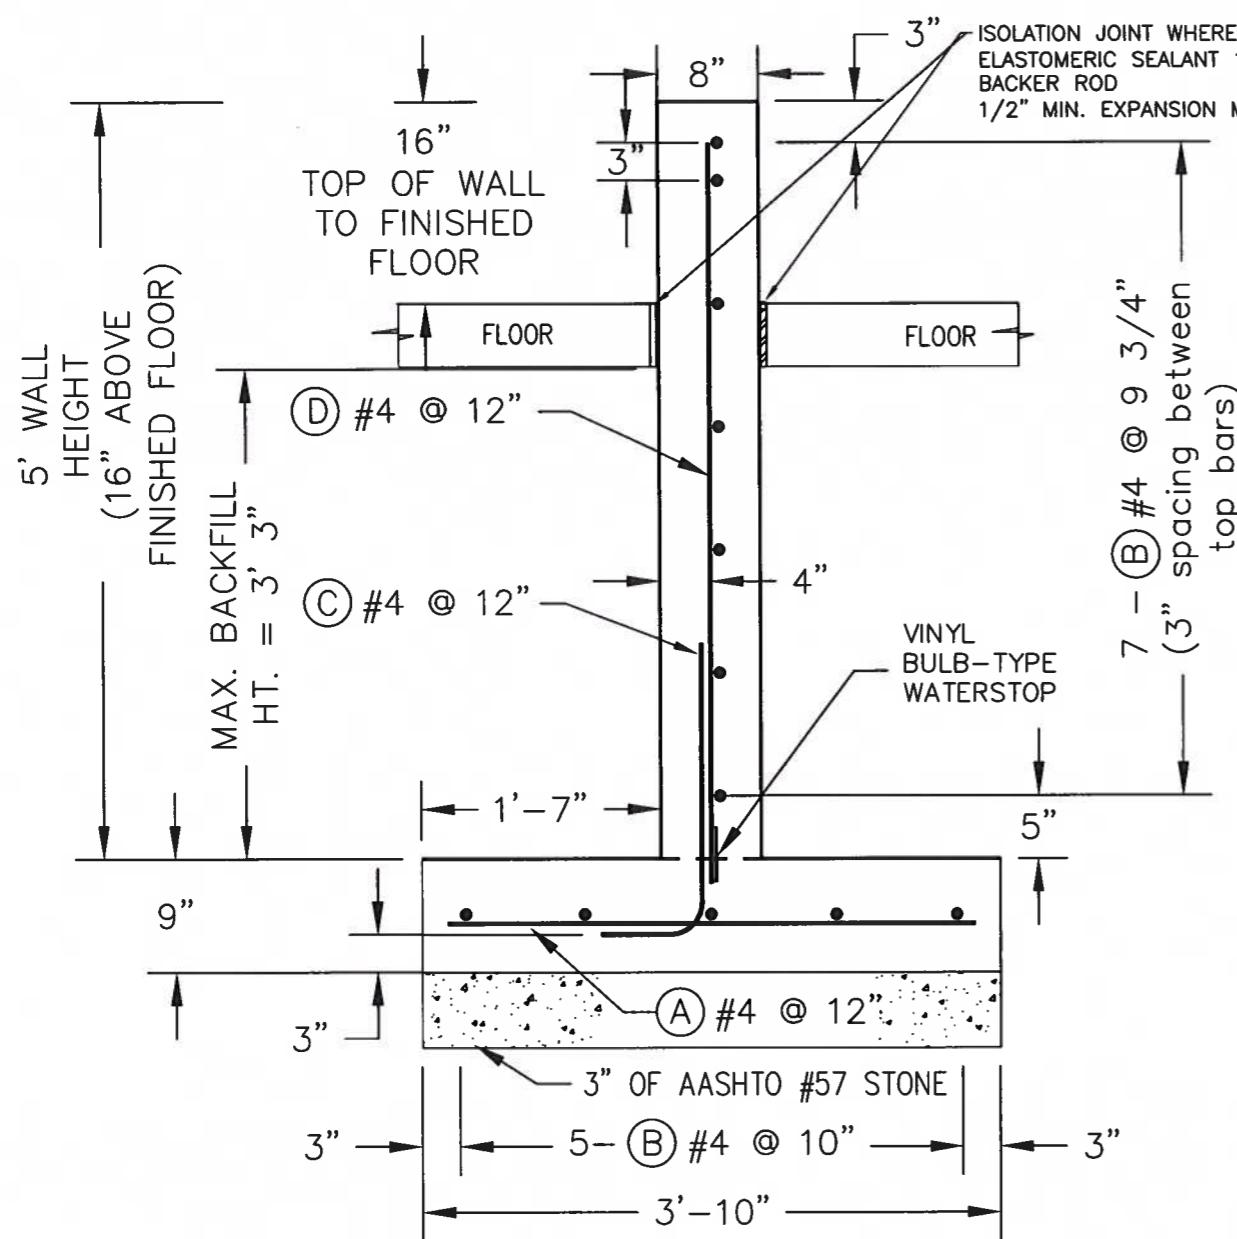

POUR AGAINST WALL

#### GENERAL DESIGN NOTES:


- DRAINAGE SHALL BE AWAY FROM THE WALL.
- THE MINIMUM TOP WIDTH OF THE BACKFILL AGAINST THE WALL SHALL BE EQUAL TO OR GREATER THAN THE BACKFILL HEIGHT.
- MAXIMUM FOOTING CONTACT PRESSURE IS 900 psf/ft.

## DESIGN STRENGTHS: WORKING STRESS DESIGN

CONCRETE  $f_c = 4,000$  psi      STEEL  $f_s = 24,000$  psi (GRADE 60)

WALL DESIGN LOADING: 313 STANDARD – LATERAL EARTH PRESSURE VALUES,  
SEE SECTION IV OF THE FIELD OFFICE TECHNICAL GUIDE.

- MANURE LOAD INSIDE = 65 psf/ft.
- SOIL BACKFILL LOAD OUTSIDE = 60 psf/ft. AND 85 psf/ft.
- NO HORIZONTAL SURCHARGE ADDED.
- SOIL BACKFILL DENSITY = 110pcf.
- WATER TABLE MUST BE BELOW THE FOOTING ELEVATION



## STEEL SCHEDULE

MARK	SIZE	TYPE	R	S	LENGTH
A	4	STR	---	---	3'-6"
B	4	STR	---	---	
*C	4	2	2'-0"	9"	2'-9"
*D	4	STR	---	---	4'-9"
L	4	2	2'-0"	9"	2'-9"
L1	4	STR	---	---	3'-9"

\* MARK C & D BARS MAY BE COMBINED TO AVOID SPLICING.  
THEN MARK C BAR IS 4'-3" x 9".

### NOTES:

1. FOR FROST PROTECTION, A 2-FOOT BACKFILL IS REQUIRED.
2. DIMENSIONS ARE TO THE REINFORCING BAR SURFACE.



ADAPTED AND MODIFIED FROM STANDARD DRAWING # PA-020D

- CONCRETE SHALL MEET PA 313 OR 561 SPECIFICATION REQUIREMENTS.
- MINIMUM SPLICE LENGTH FOR ALL #4 BARS IS 16".
- STEEL QUANTITY DOES NOT INCLUDE SPLICE LENGTHS.
- REBAR SHALL BE GRADE 60.


CRSI Wall 8' height w/o surcharge  
CRSI Design handbook 2014 addition.

NO SCALE


Bend Requirements:  
Bar Size Bend Diameter  
#4 3'  
#5 3 3/4'  
#6 4 1/2"

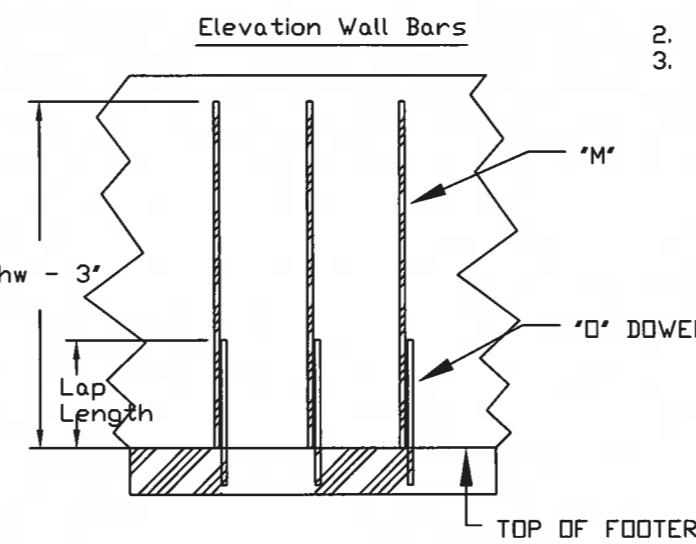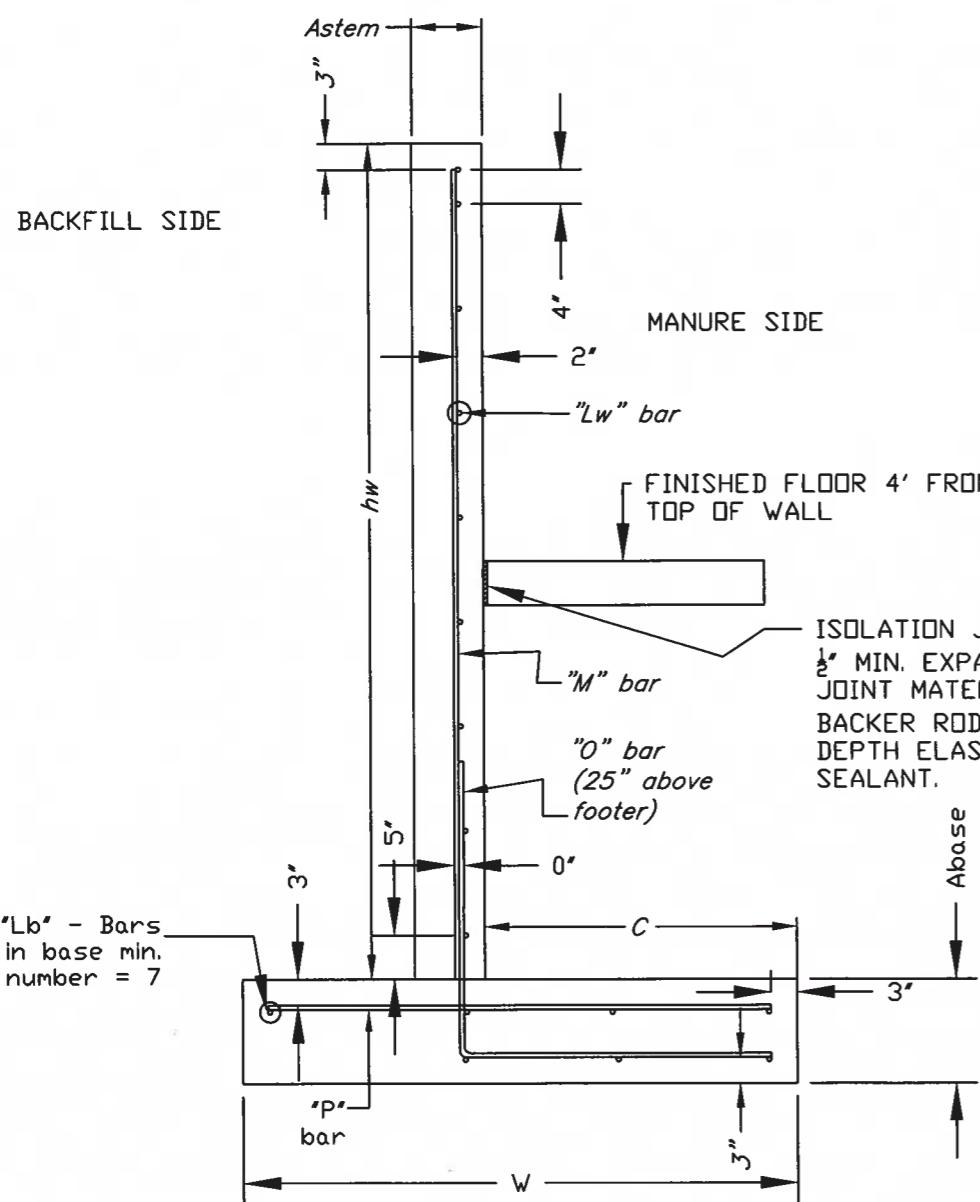

Cast in place vertical wall joint at 16' or less

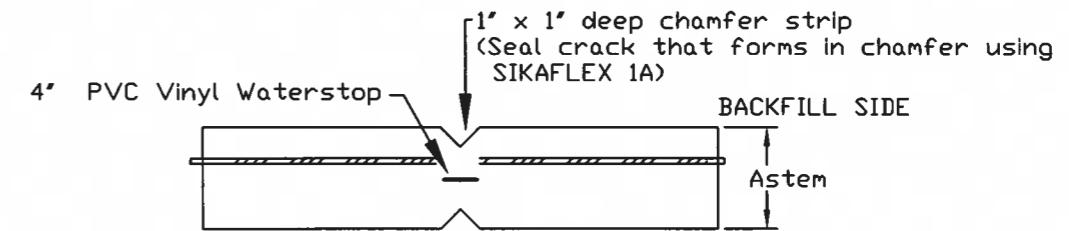

1. On forms attach 1" chamfer strips on both sides and across top, locate between form ties
2. Cut 50% of the horizontal steel
3. Install 4" vinyl waterstop, connect at bottom and support with (2) - #3 bars

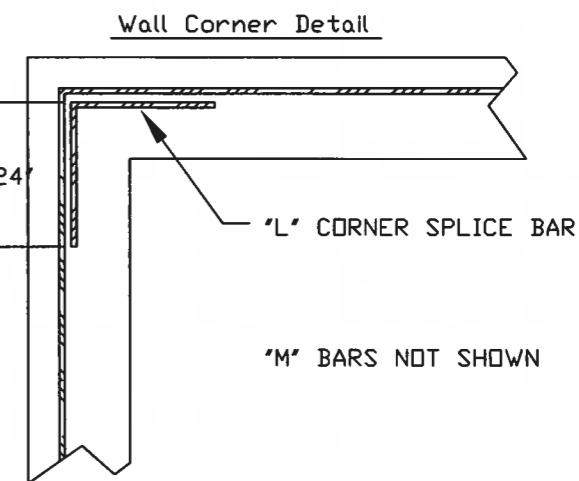

Dimensions	
hw	8'
Astem	8"
C	3'
W	5' 4"
Abase	12"
Lap ('O' bar height above footer)	25"

Stem Reinforcement	
'O'	#4 @ 9"
'M'	#4 @ 9"
'Lw'	#4 @ 12"

Base Reinforcement	
'P'	#4 @ 9"

Soil Properties	
$\mu$	0.45
$\gamma$	130 pcf
$\phi$	30 deg.
Backfill slope	Level

NOTES

1. All work as per NRCS spec. 313.
2. Cover on steel shall 3" unless where shown.
3. Install wall joints every 16' (wall joints shall not line up with post locations).
4. Do not backfill less than 14 days after walls are poured.
5. All concrete is 4,000 psi.
6. All steel is 24,000 psi (GRADE 60).
7. Foundation shall be approved prior to floor installation.
8. Water table must be below the footing elevation. 4" Perimeter drain tile required. 4" drain tile shall go to free outlet with animal guard.
9. Stagger all joint splices.
10. C.J. = Construction Joint. Construction joints (including vertical wall joints) shall be water tight using 4" PVC Vinyl Waterstop.
11. Footing and floor concrete to be placed on min. 3" AASHTO #57 STONE.
12. Minimum splice length for #4 bars = 16' EXCEPT LAP SPLICE OF 'O' DOWEL BAR WHERE LAP = 25' AND 'L' CORNER BAR WHERE LAP = 24'

United States Department of Agriculture  
Natural Resources Conservation Service

FILE NO.

DRAWING NO.

SHEET 33 OF 39

CASSILYN SCHWEIGHOFER  
8FT CRSI WALL

WAYNE COUNTY, PA

DATE

DESIGNED


DRAWN

CHECKED

APPROVED

Date			
Designed		BTM	
Drawn			Checked
Approved			

### WALL CORNER AND WALL FOOTING CORNER DETAILS

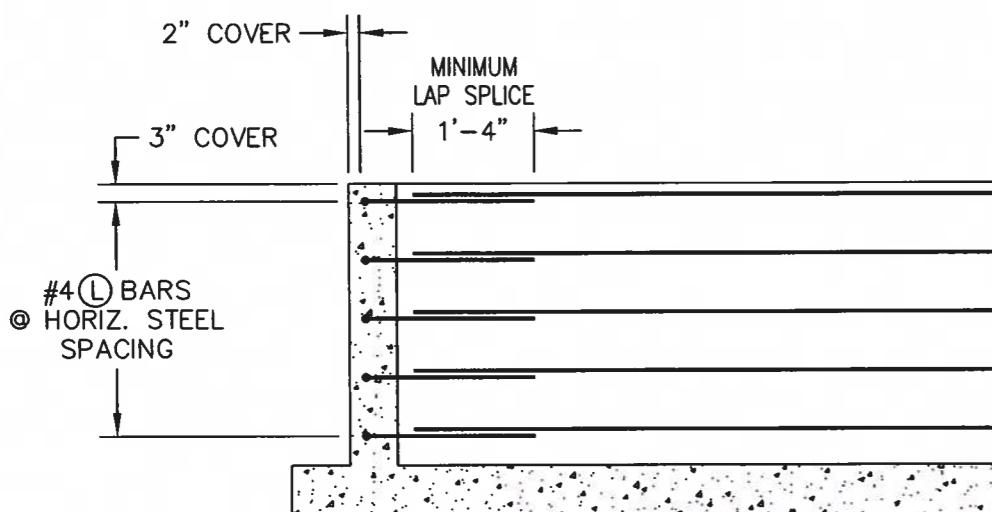

#### NOTES:


1. TIE LONG LEG OF MARK (L) CORNER BAR TO WALL SECTION T&S MARK (B) BAR AS SHOWN.
2. SHORT LEG OF MARK (L) BARS SHALL BE SUPPORTED WITH VERTICAL WALL SUPPORT BAR (L1).
3. 10 MARK (L) BARS PER CORNER. SEE APPROPRIATE WALL DRAWING FOR BAR DIMENSIONS AND QUANTITIES.
4. PLACE FIRST VERTICAL BAR (SEE PLAN VIEW) AT WALL CORNER, OR NO FARTHER THAN ONE-HALF THE VERTICAL BAR SPACING FROM THE CORNER.

ADAPTED AND MODIFIED FROM STANDARD DRAWING # PA-025

ADAPTED AND MODIFIED FROM STANDARD DRAWING # PA-023


#### NOTES FOR FOOTING STEEL PLACEMENT

- 1.) FOOTING TEMPERATURE AND SHRINKAGE STEEL (T&S) TO BE EXTENDED INTO THIS REGION FROM BOTH SIDES OF CORNER. REGION IS OUTSIDE EXTENSION OF WALLS INCLUDING WALL THICKNESS.
- 2.) STRENGTH STEEL IS EXTENDED INTO THIS REGION FROM BOTH SIDES OF CORNER. REGION IS INSIDE EXTENSION OF THE WALLS. FOOTING SLAB T&S STEEL OUTSIDE THE CORNER REGION TO LAP SPLIC WITH THE STRENGTH STEEL 16 INCHES.
- 3.) IN BOTH CORNER REGIONS, STRENGTH STEEL AND T&S STEEL WILL REQUIRE SWITCHING POSITIONS FROM TOP TO BOTTOM AND VICE VERSA.

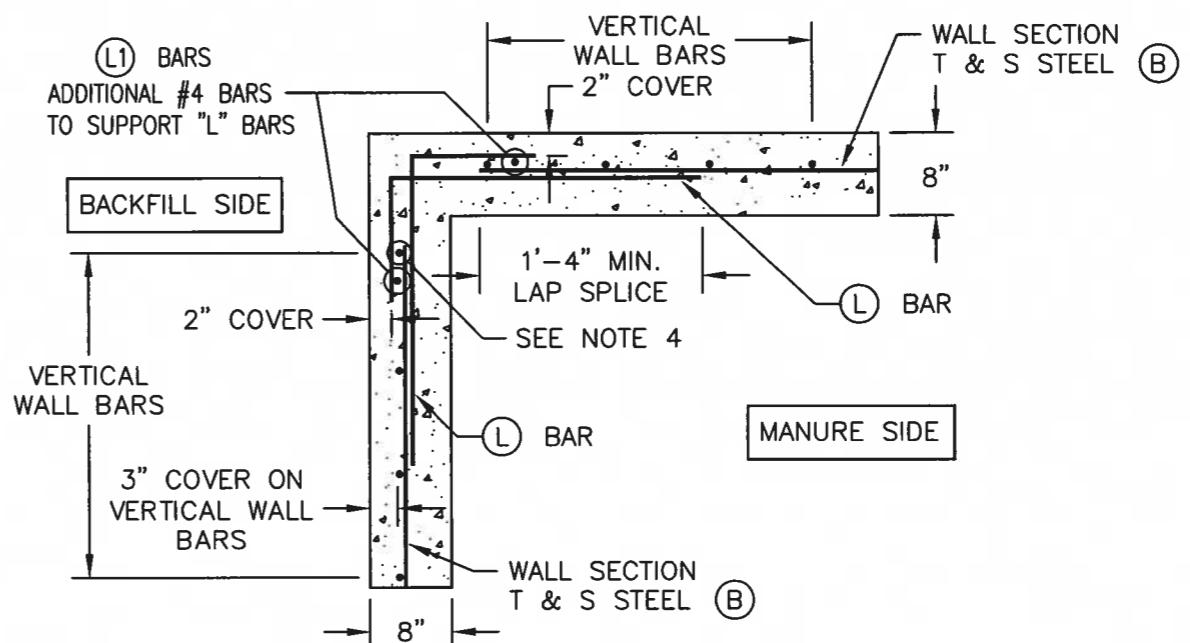

PLAN VIEW

WALL CORNER DETAIL

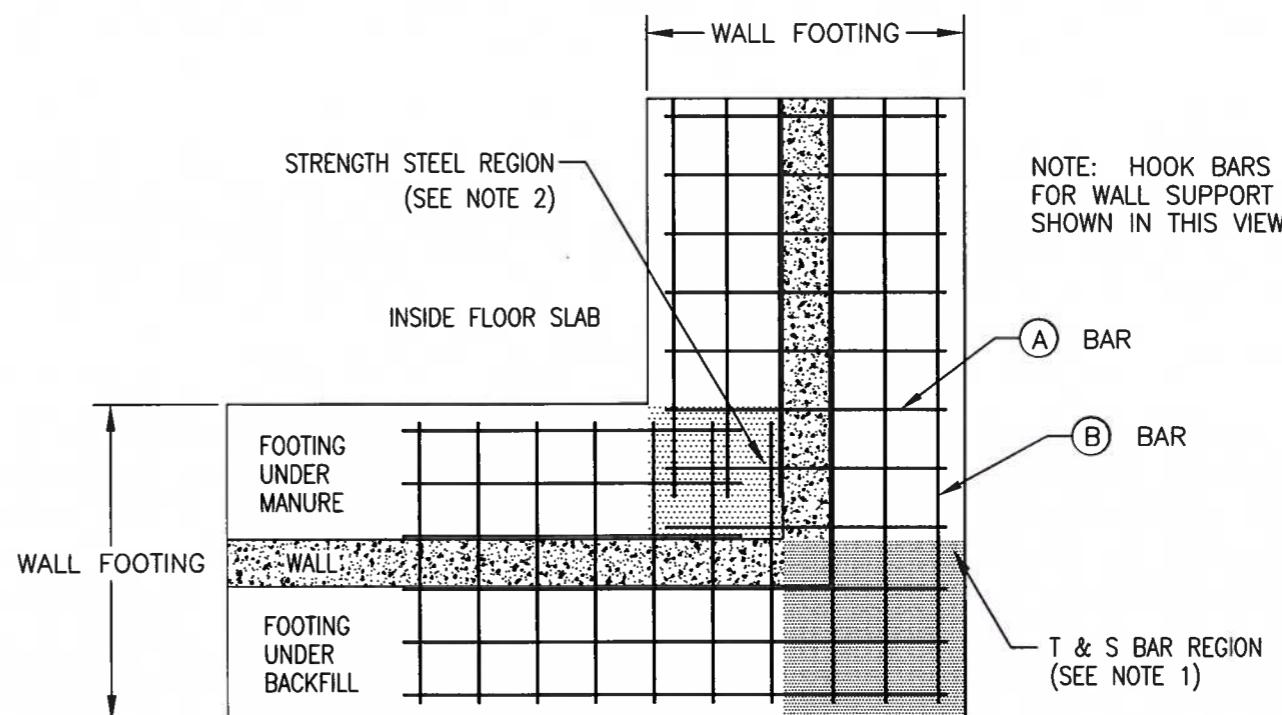

SLAB FOOTING CORNER DETAIL

File No.	
Drawing No.	
Sheet 34 of 39	

DATE \_\_\_\_\_  
 DESIGNED \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 CHECKED \_\_\_\_\_  
 APPROVED \_\_\_\_\_

CASSILYN SCHWEIGHOFER  
 WAYNE COUNTY, PA  
 POST ON WALL ANCHORING OPTIONS

DATE \_\_\_\_\_  
 DRAWN \_\_\_\_\_  
 CHECKED \_\_\_\_\_  
 APPROVED \_\_\_\_\_

POST ON WALL INSTALLATION

ALL BRACKETS ARE TO BE ATTACHED TO CONCRETE  
 USING  $\frac{5}{8}$ " DIA. X MIN. 6" LENGTH SCREW TYPE ANCHORS.  
 EXPANSION BOLTS ARE NOT PERMITTED.


SINGLE POST INSTALLATION  
 STURDI-WALL SW84GL, SW85GL,  
 SERIES OR EQUIVALENT DRILL SET  
 BRACKET ATTACHED TO TOP OF WALL  
 OR CURB.

END POSTS WHERE THERE IS NO  
 CORNER WALL ARE TO USE (2) SW80  
 UNIVERSAL SERIES BRACKETS  
 WITH THE FOOT OF THE OUTSIDE BRACKET  
 REVERSED AND INSTALLED UNDER THE POST.  
 POST TO BE PRE NOTCHED AND DRILLED  
 FOR ANCHOR BOLT AND FOOT OF BRACKET

NOTE: LOAD BEARING END POSTS AND  
 LOAD BEARING CORNER POSTS  
 ARE SET BACK  $1\frac{3}{8}$ " FROM  
 EDGE OF CONCRETE TO EDGE OF POST

NOTE: BRACKETS, ANCHORS, AND  
 POSTS CAN NOT BE INSTALLED  
 UNTIL WALL HAS CURED FOR  
 MINIMUM OF 7 DAYS.

A LAYER OF FELT (ASPHALT) PAPER  
 IS REQUIRED BETWEEN POST  
 BRACKET AND POST.

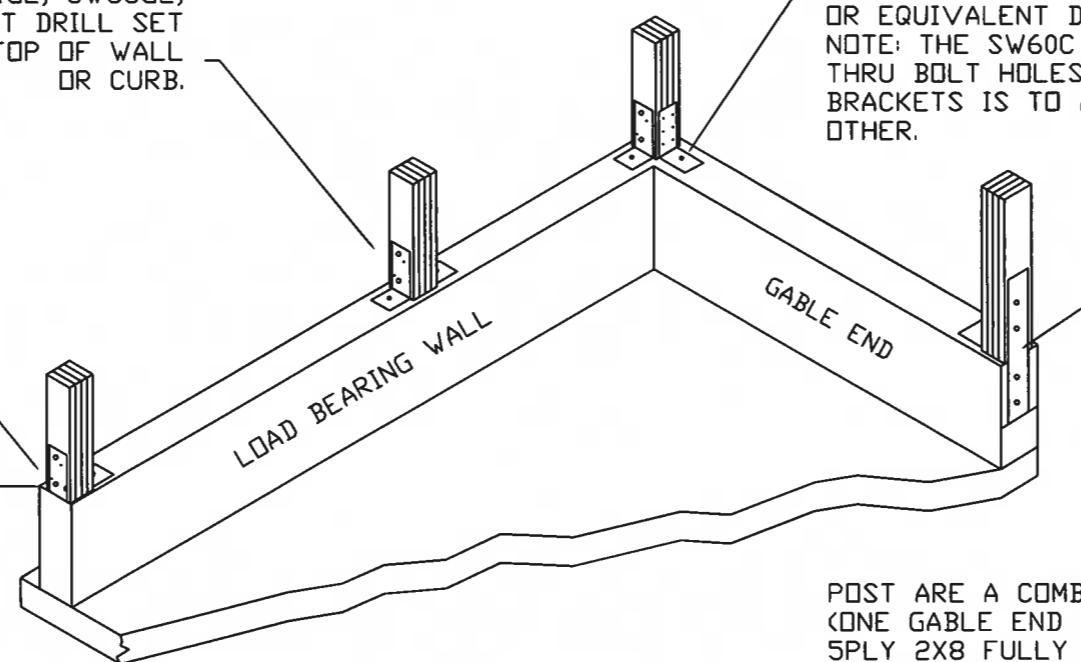

(1) STURDI WALL SW80 UNIVERSAL ON LOAD BEARING SIDE  
 AND (1) SW60C (CORNER SERIES) ON GABLE END SIDE  
 OR EQUIVALENT DRILL SET BRACKET AT CORNER LOCATIONS.  
 NOTE: THE SW60C SERIES HAS SCREW HOLES ONLY AND NO  
 THRU BOLT HOLES. THE COMBINATION OF THESE TWO  
 BRACKETS IS TO AVOID HAVING THRU BOLTS HIT EACH  
 OTHER.

USE ONE SW60 FLAT BRACKET AND ONE  
 SW60 C SERIES (EXCEPTS SCREWS ONLY  
 NO THRU BOLTS) FOR THE GABLE END POSTS  
 THAT ARE SET WITH THE EDGE OF POST FLUSH  
 WITH END OF GABLE END RETURN WALL.  
 FOUR LOCATIONS  
 ONLY.

POST ARE A COMBINATION OF 4PLY 2X6  
 (ONE GABLE END ONLY), 4PLY 2X8, AND  
 5PLY 2X8 FULLY PRESSURE TREATED  
 GLULAMS.

LOAD BEARING POST ARE ORIENTED WITH  
 PLYS RUNNING PARALLEL WITH  
 TRUSSES. GABLE END POST (NOT SHOWN)  
 ARE ORIENTED WITH PLYS RUNNING  
 PERPENDICULAR TO TRUSSES. GABLE END  
 POST ARE THE ONLY POST PERMITTED TO  
 BE 4PLY 2X6. GABLE END POSTS ARE TO  
 EXTEND TO THE TOP CHORD OF TRUSS.

NO SCALE


USDA	United States Department of Agriculture	Natural Resources Conservation Service
FILE NO.		
DRAWING NO.		

SHEET 35 OF 39

# LIQUID TIGHT SLAB JOINTS CROSS SECTIONS

(NOT TO SCALE)

JOINT 1

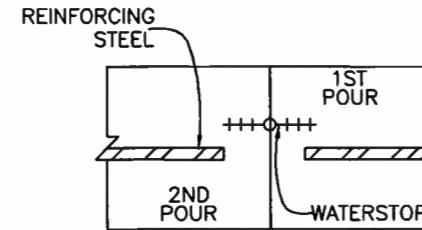


LIQUID TIGHT SLAB/FLOOR JOINTS


GENERAL NOTES:

1. BACKER ROD SHALL BE A LARGER WIDTH THAN THE WIDTH OF THE SAW CUT.
2. SAW CUT OR JOINT FORMER IS ACCEPTABLE FOR JOINT 2.
3. SEALANT DEPTH SHALL BE  $1/4"$  OR SLIGHTLY LESS THAN JOINT WIDTH, WHICHEVER IS LESS.
4. CUT 50% OF THE REINFORCING STEEL DIRECTLY UNDER THE JOINT.
5. USE JOINT 1 OR 2 FOR TWO POURS AND JOINT 3 FOR CONTINUOUS POURS.

JOINT 2

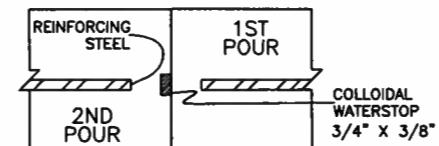

JOINT 3

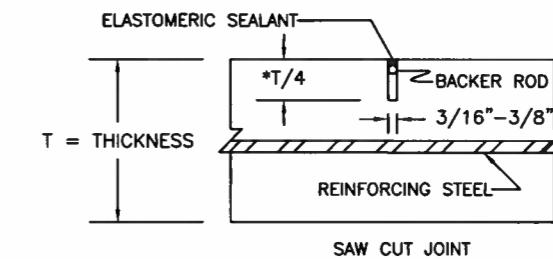


CONSTRUCTION  
CONTROL

## LIQUID TIGHT WALL JOINTS PLAN VIEW

(NOT TO SCALE)

JOINT 4

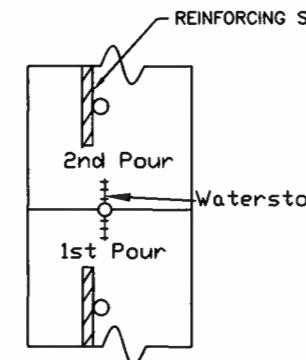


LIQUID TIGHT WALL JOINTS

GENERAL NOTES:

1. BE SURE TO CUT EVERY OTHER HORIZONTAL REINFORCING STEEL REBAR DIRECTLY AT THE JOINT.
2. SEALANT DEPTH SHALL BE  $1/4"$  OR SLIGHTLY LESS THAN JOINT WIDTH, WHICHEVER IS LESS.
3. USE JOINT 4 FOR TWO POURS AND JOINTS 5 OR 6 FOR CONTINUOUS POURS.


MANURE SIDE OF WALL

JOINT 5

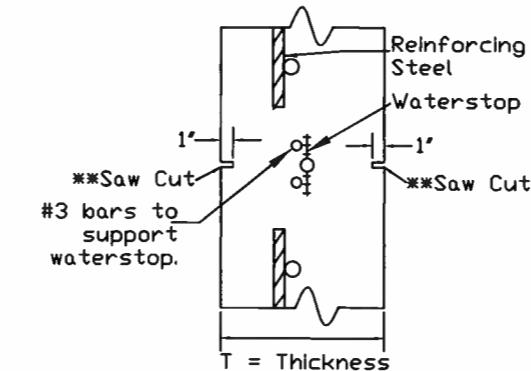

MANURE SIDE OF WALL

JOINT 6

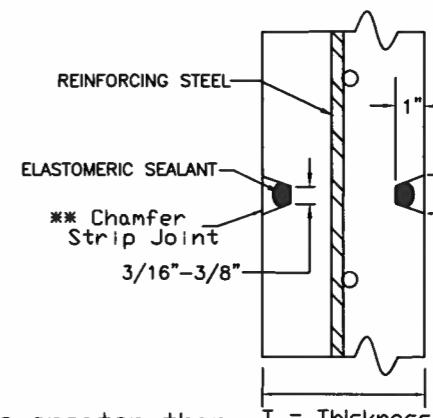

MANURE SIDE OF WALL

\* Saw cut need not be greater than  $1"$  for walls thicker than  $8"$ .  $T =$  Thickness

\*\* Joint former or chamfer strip optional, Backer Rod and Elastomeric sealant needed in a saw cut joint or if a joint former is used. Elastomeric sealant needed if a chamfer strip is used. Cut and/or joint former or chamfer shall be on both sides of wall and across the top.



DATE	
DESIGNED	
DRAWN	
CHECKED	
APPROVED	
CASSILYN SCHWEIGHOFER	
CONCRETE JOINT OPTIONS	
WAYNE COUNTY, PA	
United States Department of Agriculture	Natural Resources Conservation Service
FILE NO.	
DRAWING NO.	
SHEET 36 OF 39	

DATE \_\_\_\_\_  
 DESIGNED \_\_\_\_\_ DRAWN \_\_\_\_\_  
 DRAWN \_\_\_\_\_ CHECKED \_\_\_\_\_  
 APPROVED \_\_\_\_\_

CASSILYN SCHWEIGHOFER

GUTTER DETAIL

WAYNE COUNTY, PA

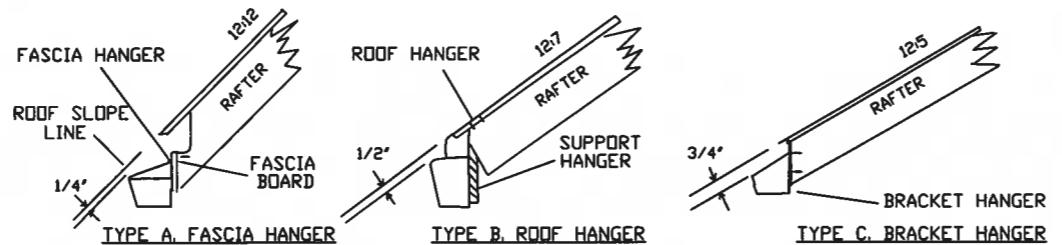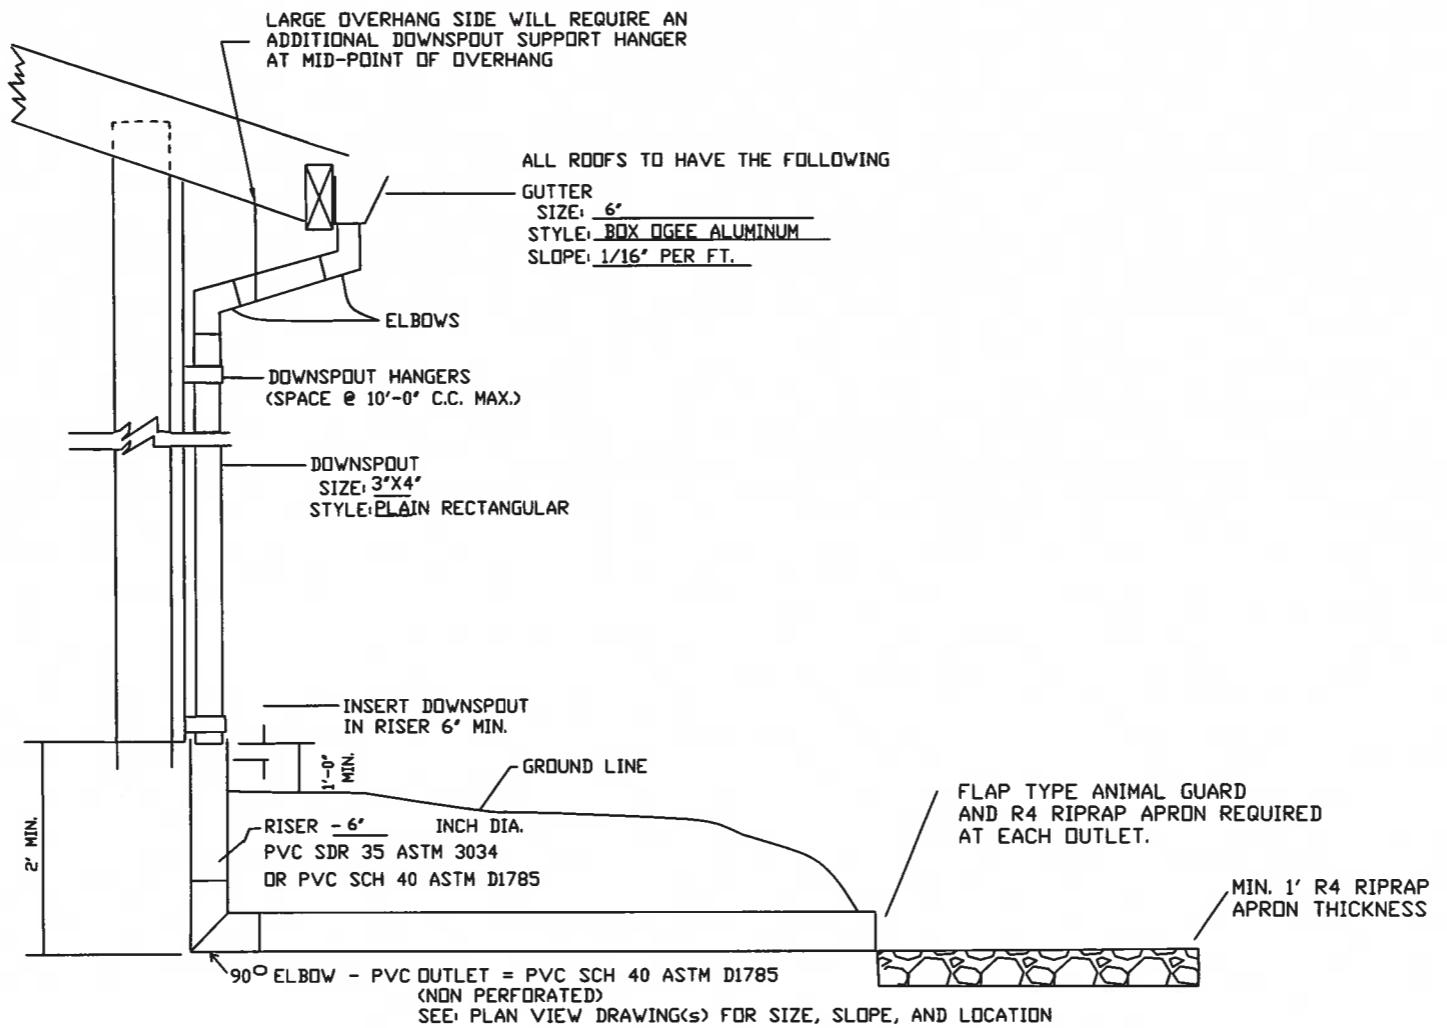

GUTTER HANGING DETAILS


(Clearances shown are guides for typical roof slopes,  
(regardless of hanger type.)

NOTES

- 1) GUTTER HANGERS SHALL BE NAILED TO FASCIA BOARD OR ROOF SHEATHING AT RAFTER LOCATIONS.
- 2) EXPANSION JOINTS SHALL BE INSTALLED EVERY 40' IF NOT FREE-FLOATING.
- 3) GUTTERS SHALL BE PLACED BELOW ROOF SLOPE LINE SO ICE AND SNOW CAN SLIDE CLEAR. STEEPER PITCH REQUIRES LESS CLEARANCE. (SEE DETAIL)
- 4) GUTTERS, TRANSFER LINES, AND OUTLETS SHALL BE PLACED AT THE MINIMUM SLOPES INDICATED IN THE PLAN VIEW.
- 5) MAXIMUM GUTTER SUPPORT SPACING 15 FT.
- 6) MAXIMUM DOWNSPOUT SUPPORT SPACING UNDER OVERHANGS = 3 FT.

NOTE :  
PERIMETER DRAIN MAY OUTLET IN SAME TRENCH AS ROOF RUNOFF OUTLETS. (2) PIPES IN ONE TRENCH. ALL PERIMETER DRAINS ARE TO BE 4" CORRUGATED PERFORATED PLASTIC DRAIN TUBING ASTM F-667 AND SHALL TRANSITION TO SOLID PVC SCH 40 ASTM D1785 ONCE BEYOND THE FOOTER. MINIMUM SLOPE ON PERIMETER DRAINS = 1%.

RIPRAP APRON PLAN VIEW

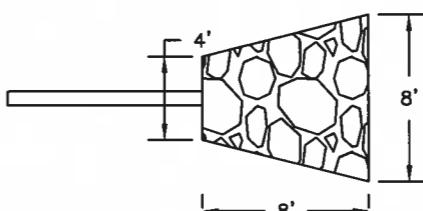

APPROXIMATELY 3 TON R4 PER APRON.  
5 APRONS REQUIRED

United States  
Department of  
Agriculture

USDA

Natural Resources  
Conservation Service

FILE NO. \_\_\_\_\_

DRAWING NO. \_\_\_\_\_



DATE

DESIGNED

DRAWN

CHECKED

APPROVED

United States  
Department of  
Agriculture

USDA  
Natural Resources  
Conservation Service

FILE NO.


DRAWING NO.

SHEET 39 OF 39

### REINFORCED CONCRETE DETAIL

NOT TO SCALE

6" X 6"-W2.9 X W2.9  
WELDED WIRE FABRIC,  
PLACED 2' FROM TOP OF  
SLAB.

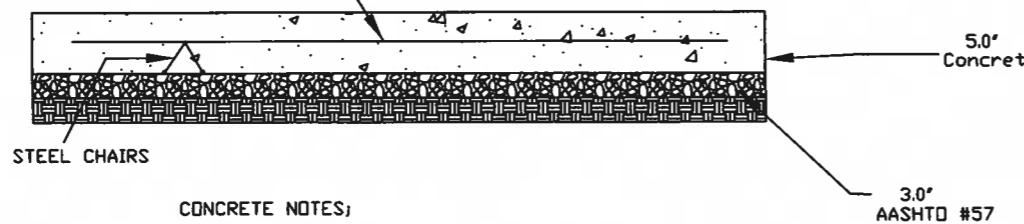

#### CONCRETE NOTES:

1. CONCRETE SHALL BE 4000 PSI.
2. STEEL SHALL BE GRADE 60.

### Access Road / ANIMAL WALKWAY Detail


(Typical)



#### Notes:

1. Geotextile for roads with normal farm machinery use shall be WOVEN or NON-WOVEN with a minimum tensile strength of 200 pounds. Geotextile for roads with heavy equipment shall be WOVEN or NON-WOVEN with a minimum tensile strength of 315 pounds.
2. Stone depth shall be measured after compaction.
3. All stone shall be compacted with a smooth drum, vibratory roller.
4. Surfacing material will be 2A modified.

### RAMP CURB DETAIL (POURED WITH SLAB)

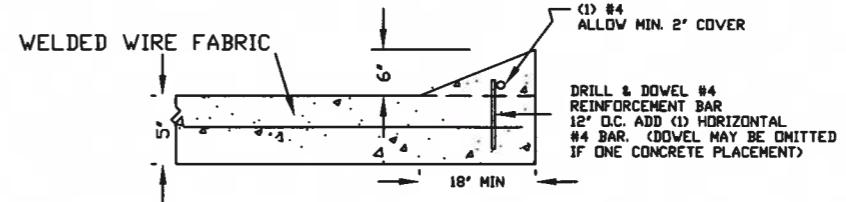


#### NOTES:

1. CONCRETE TO BE 4000 PSI.
2. DESIGN ADOPTED FROM PA-038.

### Perimeter Drain Detail


NOT TO SCALE

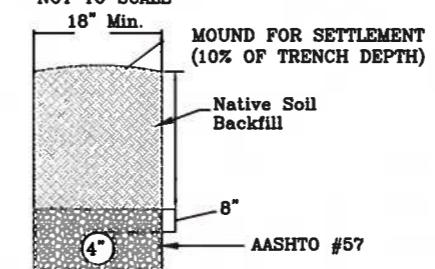

4" DIAMETER DRAINAGE TUBING  
WITH A 2" DEPTH OF AASHTO  
#57 BEDDING BENEATH PIPE.

PIPE USED FOR  
DRAINAGE TUBING  
SHALL BE  
PERFORATED  
CORRUGATED  
POLYETHYLENE,  
ASTM 405F. THE  
PIPE WILL OUTLET  
INTO SOLID SCH40  
PVC ASTM D-1758  
W/ MIN. OF 1%  
SLOPE.

### ROLL CURB DETAIL

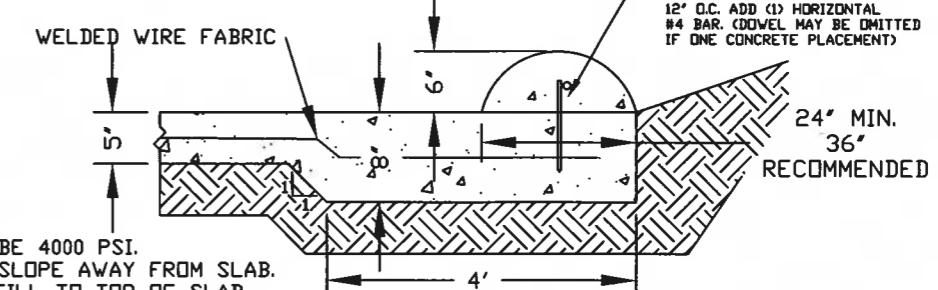


#### NOTES:

1. CONCRETE TO BE 4000 PSI.
2. BACKFILL TO SLOPE AWAY FROM SLAB.
3. MINIMUM BACKFILL TO TOP OF SLAB.
4. DESIGN ADOPTED FROM PA-038.

### TRENCH DETAIL

TRENCHING SHALL BE IN ACCORDANCE  
WITH OSHA RECOMMENDATIONS

HAND PLACE NATIVE  
SOIL MATERIAL UNDER  
HAUNCH OF PIPE

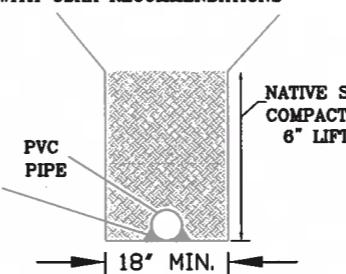

#### NOTES:

1. MATERIAL USED FOR INITIAL BACKFILL AND HAUNCHING SHALL HAVE A MAXIMUM SIZE OF 1.5 INCHES.
2. INSTALL PIPE TO MANUFACTURE'S RECOMMENDATIONS.
3. COMPACT BACKFILL WITH VIBRATORY COMPACTOR WHEN IN VEHICULAR TRAFFIC AREAS.
4. MAINTAIN A MINIMUM OF 30" OF COVER OVER TOP OF PIPE.
5. BACKFILL TRENCH DAILY AND SLIGHTLY MOUND AT SURFACE TO ALLOW FOR SETTLEMENT. SEED WITH COVER CROP ASAP. DIRECT ANY POSSIBLE SURFACE WATER AWAY FROM THE WORK AREA.

CASSILYN SCHWEIGHOFER  
DETAIL SHEET